



水務署

Water Supplies Department

Contract No. 13/WSD/17

**Design, Build and Operate First Stage of Tseung Kwan O
Desalination Plant**

**Monthly EM&A Report No.41
(Period from 1 July to 31 July 2023)**

Document No.

| | | | | | | |
|-----------|---|--------------|---|----------------|---|----------------|
| ASCL | / | 200168078 | / | MEMAR41 | / | 1 |
| Publisher | | Project Code | | Sequential No. | | Revision Index |

| | | |
|-----------|---|---|
| | Prepared by: | Reviewed and Certified by: |
| Name | Howard CHAN | Jacky LEUNG |
| Position | Environmental Team Member | Environmental Team Leader |
| Signature |  |  |
| Date: | 17 August 2023 | 17 August 2023 |



Water Supplies Department
New Works Branch
Consultants Management Division
6/F Sha Tin Government Offices
1 Sheung Wo Che Road
Sha Tin
New Territories

Your reference:

Our reference: HKWSD202/50/109142

Date: 17 August 2023

Attention: Mr Sam Hui/ Mr H L Lai

BY EMAIL & POST
**(email: wl_hui@wsd.gov.hk/
jack_hl_lai@wsd.gov.hk)**

Dear Sirs

Agreement No. CE 5/2019 (EP)
Independent Environmental Checker for
First Stage of Tseung Kwan O Desalination Plant – Investigation
Verification of Monthly EM&A Report No.41 (July 2023)

We refer to emails of 10 and 17 August 2023 attaching Monthly EM&A Report No.41 (July 2023) for the captioned project prepared by the ET.

We have no further comment and hereby verify the captioned report in accordance with Clause 3.5 of the Environmental Permit no. EP-503/2015/A and Further Environmental Permit no. FEP- 01/503/2015/A.

Should you have any queries regarding the above, please do not hesitate to contact the undersigned on 2618 2831.

Yours faithfully
ANEWR CONSULTING LIMITED

Alex Chan
Independent Environmental Checker

CYCA//lsmt

REVISION HISTORY

| REV. | DESCRIPTION OF MODIFICATION | DATE |
|------|---|------------|
| 1. | First Issue for Comments | 10/08/2023 |
| 2. | Revised according to IEC and SOR's comments | 17/08/2023 |

CONTENTS

| | |
|--|----|
| Executive Summary | 1 |
| 1. Basic Contract Information..... | 6 |
| 2. Noise..... | 11 |
| 3. Water Quality..... | 15 |
| 4. Waste..... | 23 |
| 5. Landfill Gas Monitoring..... | 24 |
| 6. Summary of Exceedance, Complaints, Notification of Summons and Prosecutions | 28 |
| 7. EM&A Site Inspection..... | 30 |
| 8. Future Key Issues..... | 31 |
| 9. Conclusions and Recommendations | 33 |

| | |
|------------|--|
| Appendix A | Master Programme |
| Appendix B | Overview of Desalination Plant in Tseung Kwan O |
| Appendix C | Summary of Implementation Status of Environmental Mitigation |
| Appendix D | Impact Monitoring Schedule |
| Appendix E | Event/Action Plan |
| Appendix F | Water Quality and Landfill Gas Equipment Calibration Certificate |
| Appendix G | Water Quality and Landfill Gas Monitoring Data |
| Appendix H | Waste Flow Table |
| Appendix I | Site Inspection Proforma |
| Appendix J | Complaint Log |
| Appendix K | Exceedance Report(s) |

EXECUTIVE SUMMARY

INTRODUCTION

- A1. The Project, Design, Build and Operate First Stage of Tseung Kwan O Desalination Plant (TKODP), is a Designated Project under the Environmental Impact Assessment Ordinance (Cap. 499) (EIAO) and is currently governed by a Further Environmental Permit (EP No. FEP – 01/503/2015/A) for the construction and operation of the Contract.
- A2. In accordance with the Environmental Monitoring and Audit (EM&A) Manual for the Contract, EM&A works for marine water quality, noise, waste management and ecology should be carried out by Environmental Team (ET), Acuity Sustainability Consulting Limited (ASCL), during the construction phase of the Contract.
- A3. This is the 41st Monthly EM&A Report, prepared by ASCL, for the Contract summarizing the monitoring results and audit findings of the EM&A programme at and around Tseung Kwan O Area 137 (TKO 137) during the reporting period from 1 July to 31 July 2023.
- A4. The EM&A programme for this contract has covered environmental monitoring on construction noise level at selected NSRs and Contractor’s environmental performance auditing in the aspects of construction dust, construction noise, water quality, waste management, Landscape and Visual and Ecology.

SUMMARY OF MAIN WORKS UNDERTAKEN & KEY MITIGATION MEASURES IMPLEMENTED

- A5. Key activities carried out in this reporting period for the Contract included the followings:

| |
|--|
| Administration Building <ul style="list-style-type: none"> • Carrying out the floor tiles works at 1/F and 2/F • Installation of building services, cable laying, electrical switchboard, doors and handrails • Construction of block wall in the pipe duct |
| Chemical building <ul style="list-style-type: none"> • Installation of permanent doors • Underground utility construction work • Construction of trunk load pits |
| Main Electrical & Central Chiller Plant Building <ul style="list-style-type: none"> • Installation of roof tile for fuel tank room, chillers, building services, electrical switchboard and cable laying |
| ActiDAFF <ul style="list-style-type: none"> • Underground utility construction work • Construction of staircase no 2 • Erection and dismantling of scaffolding, installation of underdrain media and electrical equipment and installation of access covers on roof |

| |
|---|
| <p>Product Water Storage Tank Building</p> <ul style="list-style-type: none"> • Resin Injection Work & Water Test for 1 Water Tanks • Installation of cat ladders in Water Tanks • Installation of metal cladding, building services, cable laying, mechanical equipment, steel pipe • Underground utility construction • Sealing slab opening |
| <p>OSCG Building</p> <ul style="list-style-type: none"> • Installation of Design for Manufacturing and Assembly (DfMA) Panel and metal door • Underground utility construction work • Installation of building services, mechanical equipment, metal cladding and roller shutters and window |
| <p>Reverse Osmosis Building</p> <ul style="list-style-type: none"> • Installation of building services, electrical switchboard, mechanical equipment, steel pipe, Glass Reinforced Plastics (GRP) pipe and cable laying • Installation of metal cladding, handrailing and louvers • Underground utility construction work • Pipe laying at corridor |
| <p>Post Treatment Building</p> <ul style="list-style-type: none"> • Installation of Louvres & Windows, cat ladders, handrailing and metal cladding • Installation of building services, mechanical equipment and GRP pipe • Underground utility construction work |
| <p>Inspection corridor</p> <ul style="list-style-type: none"> • Construction of roof concrete slab and column and wall |
| <p>CO₂ Tanks</p> <ul style="list-style-type: none"> • Installation of pipes and building services <p>Combined Shaft and Pump room</p> <ul style="list-style-type: none"> • Underground utility construction work • Installation of door, window and louver <p>Other</p> <ul style="list-style-type: none"> • Watermain works at CLP 132 kV Substation • Concrete breaking, structure construction of Wave Deflector Wall at seawall area • Foundation and staircases construction at elevated walkway • Foot plinth concreting and barrier erection at flexible barrier |

A6. The major environmental impacts brought by the above construction works include:

- Construction dust and noise generation from construction works, excavation works, rock cutting works and pipe piling driving works;

- Waste generation from the construction activities; and
- Impact on water quality from marine construction works and inland construction works.

A7. The key environmental mitigation measures implemented for the Contract in this reporting period associated with the above construction works include:

- Dust suppression by regular wetting and water spraying for construction works;
- Reduction of noise from equipment and machinery on-site and regular inspection to machinery and plants/vehicles on-site to ensure proper functioning;
- Deployment of temporary silt curtain in the area where marine construction works were conducted and deployment of water sedimentation tanks for treatment of wastewater at inland and marine areas before discharge; and
- Sorting and storage of general refuse and construction waste; and

SUMMARY OF EXCEEDANCE & INVESTIGATION & FOLLOW-UP

- A8. No noise monitoring was conducted during the reporting period since there are no Contract -related construction activities undertaken within a radius of 300m from the monitoring locations. No exceedance of the action Level was recorded during the reporting period.
- A9. The EM&A works for water quality were conducted during the reporting period in accordance with the EM&A Manual.
- A10. Eleven (11) of the general water quality monitoring results of Suspended Solids (SS) obtained had exceeded the Action Level. Nine (9) of the general water quality monitoring results of SS obtained during the reporting period had exceeded the Limit Level.
- A11. Investigation on the reason of exceedance has been carried out, where the exceedances of SS on 18 July 2023 were concluded to be unrelated to the Contract as detailed in the Incident Reports on Action Level or Limit Level Non-compliance along with supporting materials in **Appendix K**.
- A12. In this reporting period, 72 times of landfill gas monitoring were conducted at TKO Area 137 (Ch1+340 – Ch1+600). No action or limit level exceedance was recorded during the reporting period.
- A13. Joint site inspections of the construction work by ET and IEC were carried out on 4, 11, 18 and 25 July 2023 to audit the mitigation measures implementation status. Observations and reminders were recorded in the site inspection checklists and provided to the contractors together with the appropriate follow-up actions where necessary.

COMPLAINT HANDLING AND PROSECUTION

A14. No environmental complaint, notification of summons and prosecution was received in the reporting period.

REPORTING CHANGE

A15. There was no change to be reported that may affect the on-going EM&A programme.

SUMMARY OF UPCOMING KEY ISSUES AND KEY MITIGATION MEASURES

A16. Key activities anticipated in the next reporting period for the Contract will include the followings:

| |
|--|
| <p>Administration Building</p> <ul style="list-style-type: none"> • Carrying out the floor tiles works at 1/F and 2/F • Installation of building services, cable laying, electrical switchboard, doors and handrails • Construction of block wall in the pipe duct |
| <p>Chemical building</p> <ul style="list-style-type: none"> • Installation of permanent doors • Underground utility construction work • Construction of trunk load pits |
| <p>Main Electrical & Central Chiller Plant Building</p> <ul style="list-style-type: none"> • Installation of roof tile for fuel tank room, chillers, building services, electrical switchboard and cable laying |
| <p>ActiDAFF</p> <ul style="list-style-type: none"> • Underground utility construction work • Construction of staircase no 2 • Erection and dismantling of scaffolding, installation of underdrain media and electrical equipment and installation of access covers on roof |
| <p>Product Water Storage Tank Building</p> <ul style="list-style-type: none"> • Resin Injection Work & Water Test for 1 Water Tanks • Installation of metal cladding, building services, cable laying, mechanical equipment, steel pipe and cat ladders in Water Tanks • Underground utility construction • Sealing slab opening |
| <p>OSCG Building</p> <ul style="list-style-type: none"> • Installation of Design for Manufacturing and Assembly (DfMA) Panel and metal door • Underground utility construction work • Installation of building services, mechanical equipment, metal cladding and roller shutters and window |

| |
|---|
| <p>Reverse Osmosis Building</p> <ul style="list-style-type: none"> • Installation of building services, electrical switchboard, mechanical equipment, steel pipe, Glass Reinforced Plastics (GRP) pipe and cable laying • Installation of metal cladding, handrailing and louvers • Underground utility construction work • Pipe laying at corridor |
| <p>Post Treatment Building</p> <ul style="list-style-type: none"> • Installation of Louvres & Windows, cat ladders, handrailing and metal cladding • Installation of building services, mechanical equipment and GRP pipe • Underground utility construction work |
| <p>Inspection corridor</p> <ul style="list-style-type: none"> • Construction of roof concrete slab and column and wall |
| <p>CO₂ Tanks</p> <ul style="list-style-type: none"> • Installation of pipes and building services <p>Combined Shaft and Pump room</p> <ul style="list-style-type: none"> • Underground utility construction work • Installation of door, window and louver <p>Other</p> <ul style="list-style-type: none"> • Watermain works at CLP 132 kV Substation • Concrete breaking, structure construction of Wave Deflector Wall at seawall area • Foundation and staircases construction at elevated walkway • Foot plinth concreting and barrier erection at flexible barrier |

A17. The major environmental impacts brought by the above construction works will include:

- Construction dust and noise generation from excavation and construction works;
- Waste generation from construction activities; and
- Impact on water quality from marine construction works and inland construction works.

A18. The key environmental mitigation measures for the Contract in the coming reporting period associated with the above construction works will include:

- Reduction of noise from equipment and machinery on-site;
- Dust suppression by regular wetting and water spraying for construction works and at main haul road;
- Sorting and storage of general refuse and construction waste; and
- Deployment of temporary silt curtain in the area where marine construction works were conducted and deployment of water sedimentation tanks for treatment of wastewater at inland and marine areas before discharge.

1. BASIC CONTRACT INFORMATION

BACKGROUND

- 1.1. The Acciona Agua, S.A. Trading, Jardine Engineering Corporation, Limited and China State Construction Engineering (Hong Kong) Limited as AJC Joint Venture (AJCJV) is contracted to carry out the Design, Build and Operate First Stage of Tseung Kwan O Desalination Plant (DPTKO) under Contract No. 13/WSD/17 (the Contract).
- 1.2. Acuity Sustainability Consulting Limited (ASCL) is commissioned by AJCJV to undertake the Environmental Team (ET) services as required and/or implied, both explicitly and implicitly, in the Environmental Permit (EP), Environmental Impact Assessment Report (EIA Report) (Register No. AEIAR-192/2015) and Environmental Monitoring and Audit Manual (EM&A Manual) for the Contract; and to carry out the Environmental Monitoring and Audit (EM&A) programme in fulfillment of the EIA Report's EM&A requirements and Contract No. 13/WSD/17 Specification requirements.
- 1.3. Pursuant to the Environmental Impact Assessment Ordinance (EIAO), the Director of Environmental Protection granted the Environmental Permit (No. EP-01/503/2015) and Variation of Environmental Permit (No. EP-01/503/2015/A) to Water Supplies Department (WSD); and granted the Further Environmental Permit (No. FEP-01/503/2015/A) to AJCJV for the Contract.

THE REPORTING SCOPE

- 1.4. This is the 41st Monthly EM&A Report for the Contract which summarizes the key findings of the EM&A programme during the reporting period from 1 July to 31 July 2023.

CONTRACT ORGANIZATION

- 1.5. The Contract Organization structure for Construction Phase is presented in **Figure 1.1**.

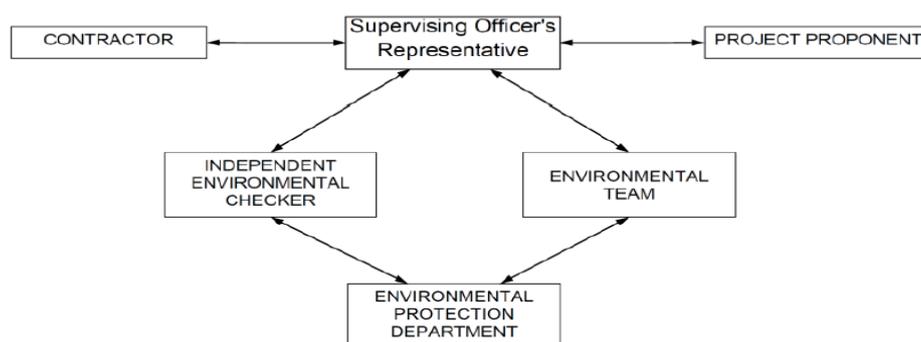


Figure 1.1 Contract Organization Chart

- 1.6. Contact details of the key personnel are presented in **Table 1.1** below:

Table 1.1 Contact Details of Key Personnel

| Party | Position | Name | Telephone no. |
|---|---|------------------------|---------------|
| Contract Proponent (Water Supplies Department) | SE/CM2 | Milton Law | 2634-3573 |
| Supervising Officer (Binnies Hong Kong Limited) | Project Manager | Christina Ko | 2608-7302 |
| | Chief Resident Engineer | Roger Wu | 6343-1002 |
| The Jardine Engineering Corporation, Limited, China State Construction Engineering (Hong Kong) Limited and Acciona Agua, S.A. Trading | Project Manager | Stephen Yeung | 2807-4665 |
| | Environmental Monitoring Manager | Brian Kam | 9456-9541 |
| Acuity Sustainability Consulting Limited | Environmental Team Leader | Jacky Leung | 2698-6833 |
| ANewR Consulting Limited | Independent Environmental Checker (IEC) | Mr. CHAN Yi Chun, Alex | 2618-2831 |

SUMMARY OF CONSTRUCTION WORKS

- 1.7. Details of the major construction activities undertaken in this reporting period are shown below. The master programme is presented in **Appendix A**.
- 1.8. Key activities carried out in this reporting period for the Contract included the followings:

| |
|--|
| Administration Building <ul style="list-style-type: none"> Carrying out the floor tiles works at 1/F and 2/F Installation of building services, cable laying, electrical switchboard, doors and handrails Construction of block wall in the pipe duct |
| Chemical building <ul style="list-style-type: none"> Installation of permanent doors Underground utility construction work Construction of trunk load pits |
| Main Electrical & Central Chiller Plant Building <ul style="list-style-type: none"> Installation of roof tile for fuel tank room, chillers, building services, electrical switchboard and cable laying |

| |
|---|
| <p>ActiDAFF</p> <ul style="list-style-type: none"> • Underground utility construction work • Construction of staircase no 2 • Erection and dismantling of scaffolding, installation of underdrain media and electrical equipment and installation of access covers on roof |
| <p>Product Water Storage Tank Building</p> <ul style="list-style-type: none"> • Resin Injection Work & Water Test for 1 Water Tanks • Installation of cat ladders in Water Tanks • Installation of metal cladding, building services, cable laying, mechanical equipment, steel pipe • Underground utility construction • Sealing slab opening |
| <p>OSCG Building</p> <ul style="list-style-type: none"> • Installation of Design for Manufacturing and Assembly (DfMA) Panel and metal door • Underground utility construction work • Installation of building services, mechanical equipment, metal cladding and roller shutters and window |
| <p>Reverse Osmosis Building</p> <ul style="list-style-type: none"> • Installation of building services, electrical switchboard, mechanical equipment, steel pipe, Glass Reinforced Plastics (GRP) pipe and cable laying • Installation of metal cladding, handrailing and louvers • Underground utility construction work • Pipe laying at corridor |
| <p>Post Treatment Building</p> <ul style="list-style-type: none"> • Installation of Louvres & Windows, cat ladders, handrailing and metal cladding • Installation of building services, mechanical equipment and GRP pipe • Underground utility construction work |
| <p>Inspection corridor</p> <ul style="list-style-type: none"> • Construction of roof concrete slab and column and wall |
| <p>CO₂ Tanks</p> <ul style="list-style-type: none"> • Installation of pipes and building services <p>Combined Shaft and Pump room</p> <ul style="list-style-type: none"> • Underground utility construction work • Installation of door, window and louver <p>Other</p> <ul style="list-style-type: none"> • Watermain works at CLP 132 kV Substation • Concrete breaking, structure construction of Wave Deflector Wall at seawall area • Foundation and staircases construction at elevated walkway • Foot plinth concreting and barrier erection at flexible barrier |

- 1.9. A summary of the valid permits, licences, and/or notifications on environmental protection for this Contract is presented in **Table 1.2**.

Table 1.2 Summary of the Status of Valid Environmental Licence, Notification, Permit and Documentations

| Permit/ Licences | Valid Period | | Status | Remark |
|--|-------------------------|------------|--------|-----------------------------|
| | From | To | | |
| Environmental Permit | | | | |
| EP-503/2015/A | Throughout the Contract | | Valid | - |
| FEP - 01/503/2015/A | Throughout the Contract | | Valid | - |
| Notification of Construction Works under the Air Pollution Control (Construction Dust) Regulation (Form NA) | | | | |
| 451539 | Throughout the Contract | | Valid | - |
| Billing Account for Disposal of Construction Waste | | | | |
| 7036276 | Throughout the Contract | | Valid | - |
| Chemical Waste Producer Registration | | | | |
| 5213-839-A2987-01 | Throughout the Contract | | Valid | - |
| Wastewater Discharge Licence (Land and Marine works) | | | | |
| WT00035775-2020 | 23/08/2021 | 31/07/2025 | Valid | - |
| WT00044188-2023 | 16/06/2023 | 30/06/2028 | Valid | For Plant T&C and operation |
| Construction Noise Permit | | | | |
| GW-RE0640-23 | 22/06/2023 | 21/12/2023 | Valid | - |

- 1.10. The status for all environmental aspects is presented in **Table 1.3**.

Table 1.3 Summary of Status for Key Environmental Aspects under the EM&A Manual

| Parameters | Status |
|---------------------------------------|--|
| Water Quality | |
| Baseline Monitoring under EM&A Manual | The baseline water quality monitoring was conducted between 12 May 2020 to 6 Jun 2020. |
| Impact Monitoring | On-going |
| Noise | |
| Baseline Monitoring | The baseline noise monitoring result has been reported in Baseline Monitoring Report and submitted to EPD under EP Condition 3.4 |
| Impact Monitoring | On-going |

| Parameters | Status |
|---|----------|
| Waste Management | |
| Mitigation Measures in Waste Management Plan | On-going |
| Landfill Gas | |
| Regular Monitoring when construction works are within the 250 m Consultation Zone | On-going |
| Environmental Audit | |
| Site Inspection covering Measures of Air Quality, Noise Impact, Water Quality, Waste, Ecological Quality, Fisheries, Landscape and Visual | On-going |

- 1.11. Other than the EM&A work by ET, environmental briefings, trainings, and regular environmental management meetings were conducted, in order to enhance environmental awareness and closely monitor the environmental performance of the contractors.
- 1.12. The EM&A programme has been implemented in accordance with the recommendations presented in the approved EIA Report and the EM&A Manual. A summary of implementation status of the environmental mitigation measures for the construction phase of the Contract during the reporting period is provided in **Appendix C**.

2. NOISE

MONITORING REQUIREMENTS

- 2.1. To ensure no adverse noise impact, noise monitoring is recommended to be carried out within 300m radius from the nearby noise sensitive receivers (NSRs), during construction phase. The NSRs selected as monitoring station are (i) NSR4 – Creative Secondary School, (ii) NSR24 – PLK Laws Foundation College, and (iii) NSR31 – School of Continuing and Professional Studies – CUHK respectively.
- 2.2. Construction noise level were measured in terms of the A-weighted equivalent continuous sound pressure level (LAeq). Leq 30min was used as the monitoring parameter for the time period between 0700 and 1900 on normal weekdays. Construction works would follow stipulations of the valid Construction Noise Permits if works had to be conducted during restricted hours or public holidays. **Table 2.1** summarizes the monitoring parameters, frequency, and duration of the impact noise monitoring.

Table 2.1 Noise Monitoring Parameters, Time, Frequency and Duration

| Time | Duration | Interval | Parameters |
|-----------------------|---|--|------------------------------------|
| Daytime: 0700-1900 | Day time: 0700-1900 (during normal weekdays) | Continuously in Leq 5min/Leq 30min (average of 6 consecutive Leq 5min) | Leq 30min L10 30min & L90 30min |

MONITORING LOCATIONS

- 2.3. The monitoring locations were normally made at a point 1m from the exterior of the NSRs building façade and be at a position 1.2m above the ground. A correction of +3dB(A) should be made to the free-field measurements.
- 2.4. According to the environmental findings detailed in the EIA report and Baseline Monitoring Report, the designated locations for the construction noise monitoring are listed in **Table 2.2** below.

Table 2.2 Noise Sensitive Receivers

| NSR ID | Noise Sensitive Receivers | Monitoring Location | Position |
|--------|---|------------------------------------|-----------------|
| NSR 4 | Creative Secondary School | Roof Floor | 1 m from facade |
| NSR 24 | PLK Laws Foundation College | Pedestrian Road on Ground Floor | Free-field |
| NSR 31 | School of Continuing and Professional Studies - CUHK | Roof Floor | 1 m from facade |

- 2.5. Three noise monitoring locations for impact monitoring at the nearby sensitive receivers are shown in **Figure 2.1-2.3**.



Figure 2.1 NSR4 Creative Secondary School



Figure 2.2 NSR24 PLK Laws Foundation College



IMPACT MONITORING METHODOLOGY

- 2.6. Integrated sound level meter will be used for the noise monitoring. The meter will be in compliance with the International Electrotechnical Commission Publications 651: 1979 (Type 1) and 804: 1985 (Type 1) specifications. Immediately prior to and following each noise measurement the accuracy of the sound level meter will be checked using an acoustic calibrator generating a known sound pressure level at a known frequency. Measurements will be accepted as valid only if the calibration levels before and after the noise measurements agree to within 1.0 dB(A).
- 2.7. Noise measurements were not made in the presence of fog, rain, wind with a steady speed exceeding 5 m/s or wind with gusts exceeding 10 m/s. The wind speed shall be checked with a portable wind speed meter capable of measuring the wind speed in m/s.

ACTION AND LIMIT LEVELS

- 2.8. The Action/Limit Levels are in line with the criteria of Practice Note for Professional Persons (ProPECC PN 2/93) "Noise from Construction Activities – Non-statutory Controls" and Technical Memorandum on Environmental Impact Assessment Process issued by HKSAR Environmental Protection Department ["EPD"] under the Environmental Impact Assessment Ordinance, Cap 499, S.16 are presented in **Table 2.3**.

Table 2.3 Action and Limit Levels for Noise per EM&A Manual

| Time Period | Action | Limit (dB(A)) |
|------------------------------|---|---|
| 0700-1900 on normal weekdays | When one documented complaint is received from any one of the noise sensitive receivers | <ul style="list-style-type: none"> 70 dB(A) for school and 65 dB(A) during examination period |

Note: Limits specified in the GW-TM and IND-TM for construction and operation noise, respectively.

2.9. If exceedances were found during noise monitoring, the actions in accordance with the Event and Action Plan shall be carried out according to **Appendix E**.

MONITORING RESULTS AND OBSERVATIONS

2.10. Referring to EM&A Manual Section 4.1.2, the impact noise monitoring should be carried out when there are Contract-related construction activities undertaken within a radius of 300m from the monitoring stations. No monitoring station was located within a radius of 300m of the Contract site as shown in **Figure 2.4**, no impact noise monitoring was conducted in the reporting period.

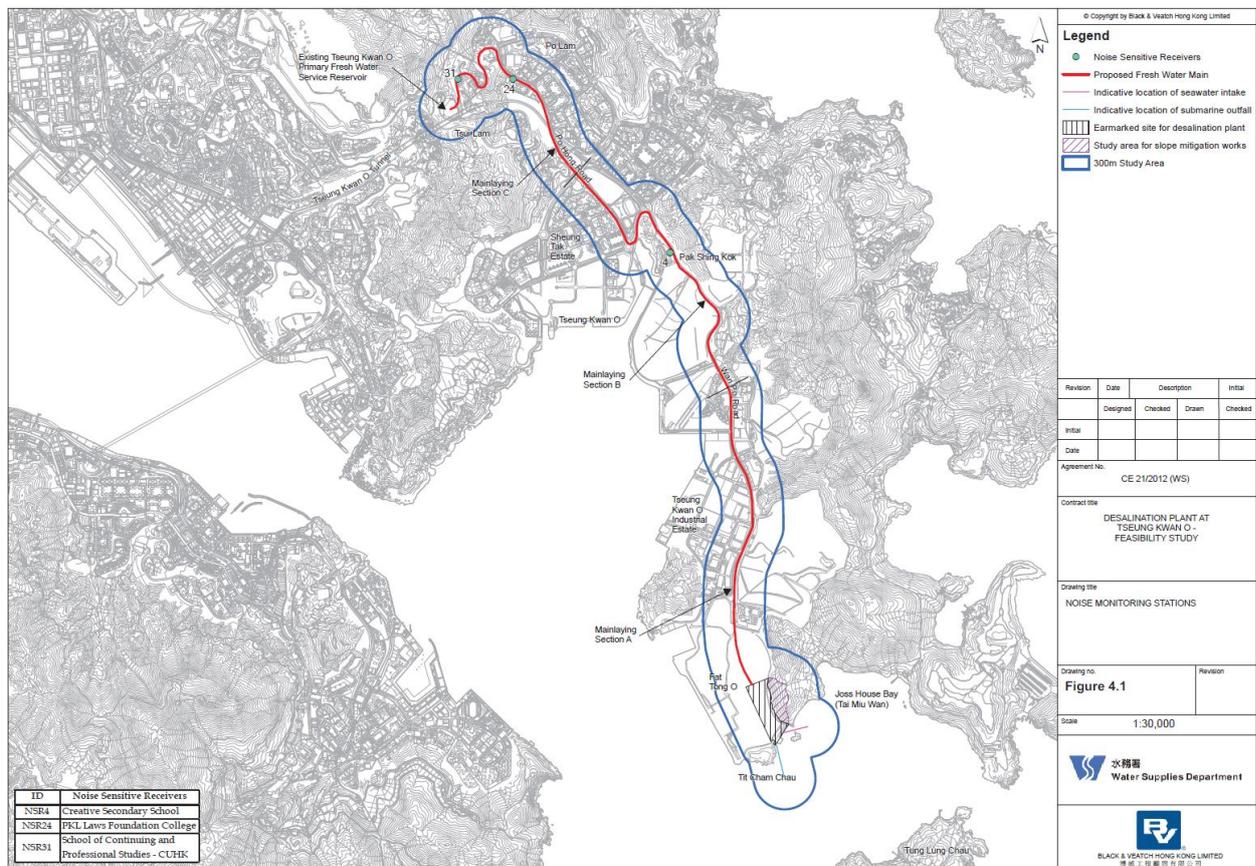


Figure 2.4 Site Layout Plan with Noise Sensitive Receivers and Desalination Plant

3. WATER QUALITY

- 3.1. In accordance with the recommendations of the EIA, water quality monitoring is required during dredging for the submarine pipelines and, during operation phase. The following Section provides details of the water quality monitoring to be undertaken by the Environmental Team (ET) to verify the distance of sediment and brine plume dispersion and to identify whether the potential exists for any indirect impacts to occur to ecological sensitive receivers.
- 3.2. The water quality monitoring programme will be carried out to allow any deteriorating water quality to be readily detected and timely action taken to rectify the situation.
- 3.3. Water quality monitoring for the Contract can be divided into the following stages:
 - Dredging activities during construction phase;
 - Discharge of effluent from main disinfection during construction phase;

WATER QUALITY PARAMETERS

- 3.4. The parameters that have been selected for measurement in situ and in the laboratory are those that were either determined in the EIA to be those with the most potential to be affected by the construction works or are a standard check on water quality conditions. Parameters to be measured in the impact monitoring are listed in **Table 3.1**.

Table 3.1 Parameters measured in the Impact Marine Water Quality Monitoring

| Parameters | Unit | Abbreviation |
|-------------------------------------|------|--------------|
| In-situ measurements | | |
| Dissolved oxygen | mg/L | DO |
| Temperature | oC | - |
| pH | - | - |
| Turbidity | NTU | - |
| Salinity | 0/00 | - |
| Total Residual Chlorine NOTE1 | mg/L | TRC |
| Laboratory measurements | | |
| Suspended Solids | mg/L | SS |
| Iron-Soluble | mg/L | Fe |
| Anti-scalant as Reactive Phosphorus | mg/L | PO4 as P- |

NOTE 1: Monitoring of Total Residual Chlorine will be conducted when cleaning and sterilization of the new freshwater main is carried out.

- 3.5. In addition to the water quality parameters, other relevant data were also being measured and recorded in Water Quality Monitoring Logs, including the location of the sampling stations, water depth, time, weather conditions, sea conditions, tidal stage, current direction and velocity, special phenomena and work activities undertaken around the monitoring and works area that may influence the monitoring results.

MONITORING EQUIPMENT

- 3.6. For water quality monitoring, the following equipment were used:

Dissolved Oxygen and Temperature Measuring Equipment - The instrument was a portable, weatherproof dissolved oxygen measuring instrument complete with cable, sensor, comprehensive operation manuals, and was operable from a DC power source. It was capable of measuring: dissolved oxygen levels in the range of 0 - 20 mg/L and 0 - 200% saturation; and a temperature of 0 - 45 degrees Celsius. It has a membrane electrode with automatic temperature compensation complete with a cable of not less than 35 m in length. Sufficient stocks of spare electrodes and cables were available for replacement where necessary (e.g. YSI model 59 DO meter, YSI 5739 probe, YSI 5795A submersible stirrer with reel and cable or an approved similar instrument).

Turbidity Measurement Equipment - The instrument was a portable, weatherproof turbidity-measuring unit complete with cable, sensor and comprehensive operation manuals. The equipment was operated from a DC power source, it has a photoelectric sensor capable of measuring turbidity between 0 - 1000 NTU and complete with a cable with at least 35 m in length (for example Hach 2100P or an approved similar instrument).

Salinity Measurement Instrument - A portable salinometer capable of measuring salinity in the range of 0 - 40 ppt was provided for measuring salinity of the water at each monitoring location.

Water Depth Gauge - A portable, battery-operated echo sounder (for example Seafarer 700 or a similar approved instrument) was used for the determination of water depth at each designated monitoring station. This unit will preferably be affixed to the bottom of the work boat if the same vessel is to be used throughout the monitoring programme. The echo sounder was suitably calibrated.

Positioning Device - A Global Positioning System (GPS) was used during monitoring to allow accurate recording of the position of the monitoring vessel before taking measurements. The Differential GPS, or equivalent instrument, was suitably calibrated at appropriate checkpoint (e.g. Quarry Bay Survey Nail) to verify that the monitoring station is at the correct position before the water quality monitoring commence.

Water Sampling Equipment - A water sampler, consisting of a PVC or glass cylinder of not less than two litres, which can be effectively sealed with cups at both ends, was used. The water sampler has a positive latching system to keep it open and prevent premature closure until released by a messenger when the sampler is at the selected water depth.

SAMPLING / TESTING PROTOCOLS

- 3.7. All in situ monitoring instruments were checked, calibrated, and certified by a laboratory accredited under HOKLAS or any other international accreditation scheme before use, and subsequently re-calibrated at monthly intervals throughout the stages of the water quality monitoring. Responses of sensors and electrodes were checked with certified standard solutions before each use.

3.8. **Table 3.2** summarizes the equipment used in the water quality monitoring program. The copies of the calibration certification of multi-parameter water quality system are shown in **Appendix F**.

Table 3.2 Water Quality Monitoring Equipment

| Model & Make | Serial Number | Calibration Date | Qty. |
|--------------------------------------|---------------|------------------|------|
| Water Sampler | | | |
| Kahlsico Water Sampler 13SWB20 | - | - | 1 |
| Multi-parameter Water Quality System | | | |
| YSI ProDSS | 22D100436 | 19 June 2023 | 2 |
| | 22C106561 | 26 July 2023 | |

3.9. On-site calibration of field equipment was following the “*Guide to On-Site Test Methods for the Analysis of Waters*”, BS 1427: 2009. Sufficient stocks of spare parts were maintained for replacements when necessary. Backup monitoring equipment was made available so that monitoring can proceed uninterrupted even when equipment is under maintenance, calibration etc.

LABORATORY MEASUREMENT AND ANALYSIS

3.10. Sufficient volume of each water sample was collected for carrying out the laboratory analyses. Using chain of custody forms, collected water samples were transferred to a HOKLAS accredited laboratory (Acumen Laboratory and Testing Limit - HOKLAS 241) for immediate processing. The determination work was start within the next working day after collection of the water samples. Analytical methodology and sample preservation of other parameters were based on the latest edition of Standard Methods for the Examination of Waste and Wastewater published by APHA, AWWA and WPCF and methods by USEPA, or suitable method in accordance with requirements of HOKLAS or another internationally accredited scheme. The QA/QC details were in accordance with the requirements of HOKLAS or another internationally accredited scheme.

3.11. Parameters for laboratory measurements, standard methods and detection limits are presented in **Table 3.3**.

Table 3.3 Laboratory measurements, standard methods, and corresponding detection limits of marine water quality monitoring

| Parameters | Standard Methods | Detection Limit | Reporting Limit | Precision |
|------------------|--------------------------------|-----------------|-----------------|-----------|
| Dissolved oxygen | Instrumental, CTD | 0.1 | - | ±25% |
| Temperature | Instrumental, CTD | 0.1 | - | ±25% |
| pH | Instrumental, CTD | 0.1 | - | ±25% |
| Turbidity | Instrumental, CTD | 0.1 | - | ±25% |
| Salinity | Instrumental, CTD | 0.1 | - | ±25% |
| Suspended Solids | APHA 23 rd Ed 2540D | 1.0 | 2.5 | ±17% |

MONITORING LOCATION

3.12. The Impact water quality monitoring locations are in accordance with the EM&A Manual and detailed in **Table 3.4** below. A schedule for water quality monitoring was prepared by the ET and submitted to IEC and EPD prior to the commencement of the monitoring.

Table 3.4 Location of Impact Water Quality Monitoring Stations

| Station | Easting | Northing | Description |
|---------|---------|----------|---|
| CE | 843550 | 815243 | Upstream control station at ebb tide |
| CF | 846843 | 810193 | Upstream control station at flood tide |
| WSR1 | 846864 | 812014 | Ecological sensitive receiver at Tung Lung Chau |
| WSR2 | 847645 | 812993 | Fisheries sensitive receiver at Tung Lung Chau |
| WSR3 | 848023 | 813262 | Ecological sensitive receiver at Tung Lung Chau |
| WSR4 | 847886 | 814154 | Ecological sensitive receiver at Tai Miu Wan |
| WSR16 | 845039 | 815287 | Ecological sensitive receiver at Fat Tong Chau |
| WSR33 | 847159 | 814488 | Ecological sensitive receiver at Tai Miu Wan |
| WSR36 | 846878 | 814081 | Ecological sensitive receiver at Kwun Tsai |
| WSR37 | 846655 | 813810 | Ecological sensitive receiver at Tit Cham Chau |

3.13. WSR1 to WSR37 were identified in accordance with Annex 14 of the EIAO-TM as well as Clause 3.4.4.2 of the Environmental Impact Assessment Study Brief for Desalination Plant at Tseung Kwan O (No. ESB-266/2013). WSR1 to WSR3 are sited near the Tung Lung Chau Fish Culture Zone; WSR16 and WSR36 are sited near the coral assemblages along the coastlines of Fat Tong Chau and Kwun Tsai respectively; WSR 4 and WSR33 are sited near the Coastal Protection Area and coral assemblages in waters of Tai Miu Wan; WSR37 is sited near the fisheries resource including spawning and nursery grounds at the coastal water of Tit Cham Chau.

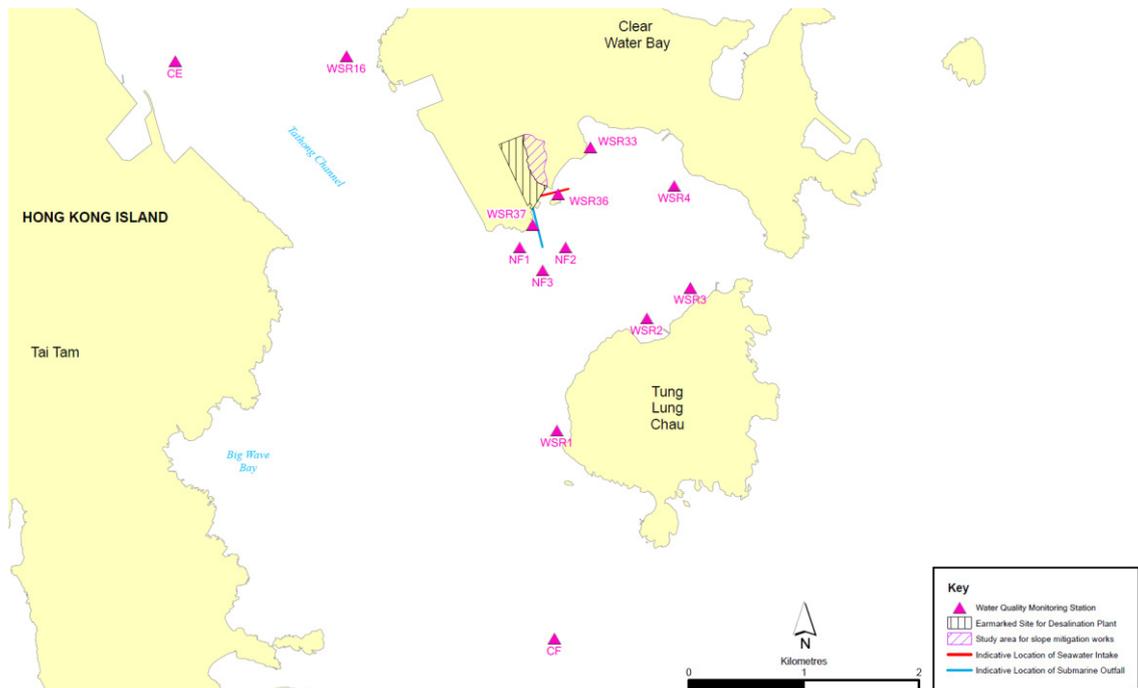


Figure 3.1 Impact water quality monitoring locations under EM&A Manual

SAMPLING FREQUENCY

- 3.14. Impact water quality monitoring were carried out three days per week during the construction phase after the commencement of marine construction works and dredging activities. Monitoring at each station was undertaken at both mid-ebb and mid-flood tides on the same day. The tidal range selected for the impact monitoring was at least 0.5 m for both flood and ebb tides as far as practicable. The interval between two sets of monitoring was not less than 36 hours. The monitoring frequency would be increased in the case of exceedances of Action/Limit Levels if considered necessary by ET. Monitoring frequency would be maintained as far as practicable.

SAMPLING DEPTHS & REPLICATION

- 3.15. During impact water quality monitoring, each station was sampled, and measurements/water samples were taken at three depths, 1 m below the sea surface, mid-depth, and 1 m above the seabed. For in situ measurements, duplicate readings were made at each water depth at each station. Duplicate water samples were collected at each water depth at each station. All water quality monitoring results were summarized in **Appendix G**.

ACTION AND LIMIT LEVELS

- 3.16. The Action and Limit Levels have been set based on the derivation criteria specified in the EM&A Manual. The Action/Limit Levels have been derived and are presented in **Table 3.5**.

Table 3.5 Derived Action and Limit Levels for Water Quality

| Parameters | Action | Limit |
|---|--|--|
| Construction Phase Impact Monitoring | | |
| DO in mg/L | <u>Surface and Middle</u> 7.30 mg L ⁻¹ <u>Bottom</u> 7.31 mg L ⁻¹ <u>Tung Lung Chau Fish Culture Zone</u> 5.1 mgL ⁻¹ or level at control station (Whichever the lower) | <u>Surface and Middle</u> 4 mg L ⁻¹ <u>Bottom</u> 2 mg L ⁻¹ <u>Tung Lung Chau Fish Culture Zone</u> 5.0 mgL ⁻¹ or level at control station (Whichever the lower) |
| SS in mg/L (Depth-averaged) | 5.00 mg L ⁻¹ or 20% exceedance of value at any impact station compared with corresponding data from control station | 6.00 mg L ⁻¹ or 30% exceedance of value at any impact station compared with corresponding data from control station |
| Turbidity in NTU (Depth-averaged) | 2.41 NTU or 20% exceedance of value at any impact station compared with corresponding data from control station | 2.84 NTU or 30% exceedance of value at any impact station compared with corresponding data from control station |

Notes:

- i. "Depth-averaged" is calculated by taking the arithmetic means of reading of all three depths.
- ii. For DO, non-compliance of the water quality limits occurs when monitoring result is lower than the limits.
- iii. For Turbidity, SS, iron and Salinity, non-compliance of the water quality limits occurs when monitoring result is higher than the limits.

MONITORING RESULTS AND OBSERVATIONS

- 3.17. General water quality monitoring at the ten monitoring stations (CE, CF, WSR1, WSR2, WSR3, WSR4, WSR16, WSR33, WSR36 and WSR37) were carried out on 1, 4, 6, 8, 11, 13, 15, 18, 20, 22, 25, 27 and 29 July 2023.
- 3.18. Eleven (11) of the general water quality monitoring results of SS obtained had exceeded the Action Level. Nine (9) of the general water quality monitoring results of SS obtained during the reporting period had exceeded the Limit Level.
- 3.19. Investigation on the reason of exceedance has been carried out, where the exceedances of SS on 18 July 2023 were concluded to be unrelated to the Contract as detailed in the Incident Reports on Action Level or Limit Level Non-compliance along with supporting materials in **Appendix K**.
- 3.20. Monitoring results of 6 key parameters: Salinity, DO, turbidity, SS, pH, and temperature in this reporting, are summarized in **Table 3.6** and **Table 3.7**, and detailed results are presented in **Appendix G**.

Table 3.6 Summary of Impact Water Quality Monitoring Results (Mid-Flood)

| Locations | | Parameters | | | | | | |
|-----------|------|----------------|-------------------------|--------|-----|-----------------|-------------------------|-----------|
| | | Salinity (ppt) | Dissolved Oxygen (mg/L) | | pH | Turbidity (NTU) | Suspended Solids (mg/L) | Temp.(°C) |
| | | | Surface & Middle | Bottom | | | | |
| CE | Avg. | 33.0 | 9.1 | 9.1 | 8.3 | 2.7 | 3.4 | 27.6 |
| | Min. | 31.7 | 8.3 | 8.3 | 8.2 | 2.4 | 2.5 | 21.5 |
| | Max. | 34.0 | 9.7 | 9.7 | 8.4 | 3.4 | 8.0 | 28.7 |
| CF | Avg. | 32.9 | 8.9 | 8.9 | 8.3 | 3.2 | 3.3 | 28.0 |
| | Min. | 31.6 | 8.2 | 8.3 | 8.1 | 2.8 | 2.5 | 26.7 |
| | Max. | 33.8 | 9.7 | 9.6 | 8.4 | 3.7 | 8.0 | 28.9 |
| WSR1 | Avg. | 33.0 | 8.9 | 8.9 | 8.3 | 2.1 | 3.2 | 27.9 |
| | Min. | 31.9 | 8.3 | 8.3 | 8.1 | 1.6 | 2.5 | 26.8 |
| | Max. | 34.0 | 9.4 | 9.4 | 8.4 | 2.5 | 6.0 | 28.6 |
| WSR2 | Avg. | 32.6 | 9.0 | 9.0 | 8.3 | 2.1 | 3.1 | 27.9 |
| | Min. | 31.0 | 8.5 | 8.6 | 8.2 | 1.6 | 2.5 | 26.9 |
| | Max. | 33.8 | 9.6 | 9.6 | 8.5 | 2.5 | 7.0 | 28.6 |
| WSR3 | Avg. | 32.8 | 9.0 | 9.0 | 8.3 | 2.1 | 3.0 | 27.9 |
| | Min. | 31.2 | 8.5 | 8.6 | 8.1 | 1.4 | 2.5 | 27.0 |
| | Max. | 33.7 | 9.4 | 9.4 | 8.4 | 2.5 | 7.0 | 28.9 |
| WSR4 | Avg. | 33.0 | 9.0 | 9.0 | 8.2 | 2.2 | 3.1 | 28.0 |
| | Min. | 31.2 | 8.3 | 8.3 | 8.1 | 1.6 | 2.5 | 27.0 |
| | Max. | 34.2 | 9.4 | 9.5 | 8.4 | 2.6 | 7.0 | 28.8 |
| WSR16 | Avg. | 33.0 | 8.7 | 8.7 | 8.3 | 2.2 | 3.2 | 28.0 |
| | Min. | 31.7 | 8.2 | 8.3 | 8.1 | 1.7 | 2.5 | 26.6 |
| | Max. | 33.7 | 9.2 | 9.2 | 8.4 | 2.5 | 8.0 | 28.9 |
| WSR33 | Avg. | 32.8 | 8.9 | 8.9 | 8.3 | 2.1 | 2.9 | 28.0 |
| | Min. | 31.8 | 8.4 | 8.4 | 8.1 | 1.7 | 2.5 | 27.3 |
| | Max. | 33.9 | 9.7 | 9.7 | 8.5 | 2.5 | 6.0 | 28.5 |
| WSR36 | Avg. | 32.8 | 8.8 | 8.8 | 8.3 | 2.2 | 3.1 | 28.0 |
| | Min. | 31.8 | 8.4 | 8.4 | 8.1 | 1.6 | 2.5 | 27.3 |
| | Max. | 33.5 | 9.4 | 9.3 | 8.4 | 2.5 | 7.0 | 28.6 |
| WSR37 | Avg. | 32.8 | 9.0 | 8.9 | 8.3 | 2.2 | 3.0 | 28.0 |
| | Min. | 31.6 | 8.4 | 8.4 | 8.1 | 1.5 | 2.5 | 27.0 |
| | Max. | 33.8 | 9.8 | 9.7 | 8.4 | 2.6 | 8.0 | 28.7 |

Notes:

- i. "Avg", "Min" and "Max" is the average, minimum and maximum respectively of the data from measurements conducted under mid-flood and mid-ebb tides at three water depths, except that of DO where the data for "Surface & Middle" and "Bottom" are calculated separately.
- ii. Measurement data of Suspending Solids would be rounding to 2.5mg/L if the value was less than 2.5mg/L to facilitate data analysing.

Table 3.7 Summary of Impact Water Quality Monitoring Results (Mid-Ebb)

| Locations | | Parameters | | | | | | |
|-----------|------|----------------|-------------------------|--------|-----|-----------------|-------------------------|-----------|
| | | Salinity (ppt) | Dissolved Oxygen (mg/L) | | pH | Turbidity (NTU) | Suspended Solids (mg/L) | Temp.(°C) |
| | | | Surface & Middle | Bottom | | | | |
| CE | Avg. | 32.8 | 9.0 | 9.1 | 8.3 | 3.1 | 3.4 | 28.0 |
| | Min. | 31.6 | 8.7 | 8.6 | 8.2 | 2.7 | 2.5 | 27.2 |
| | Max. | 33.6 | 9.8 | 9.8 | 8.4 | 3.4 | 9.0 | 28.7 |
| CF | Avg. | 32.8 | 8.9 | 8.9 | 8.3 | 2.7 | 3.3 | 28.0 |
| | Min. | 31.3 | 8.3 | 8.3 | 8.1 | 2.2 | 2.5 | 27.0 |
| | Max. | 34.1 | 9.5 | 9.5 | 8.4 | 3.0 | 9.0 | 28.7 |
| WSR1 | Avg. | 32.5 | 9.1 | 9.1 | 8.3 | 2.1 | 3.2 | 27.9 |
| | Min. | 31.6 | 8.3 | 8.4 | 8.1 | 1.4 | 2.5 | 27.3 |
| | Max. | 33.7 | 9.7 | 9.7 | 8.4 | 2.5 | 8.0 | 28.6 |
| WSR2 | Avg. | 32.9 | 8.8 | 8.8 | 8.3 | 2.1 | 3.2 | 28.0 |
| | Min. | 31.7 | 8.3 | 8.3 | 8.2 | 1.6 | 2.5 | 27.2 |
| | Max. | 34.2 | 9.5 | 9.6 | 8.4 | 2.5 | 8.0 | 29.0 |
| WSR3 | Avg. | 32.8 | 9.0 | 9.0 | 8.3 | 2.2 | 3.1 | 28.1 |
| | Min. | 31.7 | 8.3 | 8.3 | 8.1 | 1.7 | 2.5 | 27.0 |
| | Max. | 33.9 | 9.7 | 9.8 | 8.5 | 2.6 | 9.0 | 28.8 |
| WSR4 | Avg. | 32.7 | 8.8 | 8.8 | 8.2 | 2.1 | 3.2 | 27.8 |
| | Min. | 31.6 | 8.3 | 8.4 | 8.2 | 1.6 | 2.5 | 26.6 |
| | Max. | 34.1 | 9.6 | 9.6 | 8.4 | 2.5 | 7.0 | 28.6 |
| WSR16 | Avg. | 32.8 | 9.0 | 9.0 | 8.2 | 2.1 | 3.1 | 28.0 |
| | Min. | 31.4 | 8.5 | 8.4 | 8.1 | 1.6 | 2.5 | 27.2 |
| | Max. | 34.1 | 9.6 | 9.5 | 8.5 | 2.5 | 10.0 | 28.9 |
| WSR33 | Avg. | 32.8 | 8.9 | 8.9 | 8.3 | 2.1 | 3.1 | 27.9 |
| | Min. | 31.1 | 8.3 | 8.3 | 8.1 | 1.5 | 2.5 | 26.9 |
| | Max. | 33.8 | 9.6 | 9.6 | 8.4 | 2.5 | 8.0 | 29.0 |
| WSR36 | Avg. | 32.9 | 8.9 | 8.9 | 8.3 | 2.1 | 3.2 | 27.9 |
| | Min. | 31.2 | 8.3 | 8.3 | 8.1 | 1.6 | 2.5 | 27.3 |
| | Max. | 34.2 | 9.3 | 9.5 | 8.4 | 2.5 | 10.0 | 28.8 |
| WSR37 | Avg. | 32.9 | 8.8 | 8.8 | 8.2 | 2.1 | 3.3 | 27.9 |
| | Min. | 31.9 | 8.3 | 8.3 | 8.1 | 1.5 | 2.5 | 26.9 |
| | Max. | 33.7 | 9.3 | 9.3 | 8.4 | 2.5 | 10.0 | 28.9 |

Notes:

- i. "Avg", "Min" and "Max" is the average, minimum and maximum respectively of the data from measurements conducted under mid-flood and mid-ebb tides at three water depths, except that of DO where the data for "Surface & Middle" and "Bottom" are calculated separately.
- ii. Measurement data of Suspending Solids would be rounding to 2.5mg/L if the value was less than 2.5mg/L to facilitate data analysing.

4. WASTE

4.1. The waste generated from this Contract includes inert construction and demolition (C&D) materials, and non-inert C&D materials. Non-inert C&D materials are made up of general refuse, vegetative wastes and recyclable wastes such as plastics and paper/cardboard packaging waste. Steel materials generated from the Contract are also grouped into non-inert C&D materials as the materials were not disposed of with other inert C&D materials. With reference to relevant handling records and trip tickets of this Contract, the quantities of different types of waste generated in the reporting month are summarized in **Table 4.1**. Details of cumulative waste management data are presented as a waste flow table in **Appendix H**.

Table 4.1 Quantities of Waste Generated from the Contract during the reporting period

| Reporting Month | Actual Quantities of Inert C&D Materials Generated Monthly | | | | | | Actual Quantities of C&D Wastes Generated Monthly | | | | |
|-----------------|--|-------------------------------------|------------------------|--------------------------|-------------------------|---------------|---|-----------------------------|-------------------------|----------------|------------------------------|
| | Total Quantity Generated | Hard Rock and Large Broken Concrete | Reused in the Contract | Reused in other Projects | Disposed as Public Fill | Imported Fill | Metals | Paper / cardboard packaging | Plastics ⁽¹⁾ | Chemical Waste | Others, e.g., general refuse |
| | (in '000kg) | (in '000kg) | (in '000kg) | (in '000kg) | (in '000kg) | (in '000kg) | (in '000kg) | (in '000kg) | (in '000kg) | (in '000kg) | (in '000kg) |
| Jul 2023 | 121.060 | 0.000 | 0.000 | 0.000 | 121.060 | 0.000 | 0.008 | 0.150 | 0.042 | 0.000 | 182.910 |

Notes: (1) Plastics refer to plastic bottles / containers, plastic sheets / foam from packaging material

5. LANDFILL GAS MONITORING

MONITORING REQUIREMENT

- 5.1. In accordance with Section 11 of the EM&A Manual, monitoring of landfill gas is required for construction works within the 250m Consultation Zone. Part of the desalination plant and the indicative area of natural slope mitigation works fall within the SENT Landfill Extension Consultation Zone; and part of the 1,200 mm diameter fresh water mains along Wan Po Road falls within the SENT Landfill and SENT Landfill Extension Consultation Zones, TKO Stage II/III Restored Landfill and TKO Stage I Restored Landfill Consultation Zones.

MONITORING PROGRAMME

- 5.2. Since part of the desalination plant (Wan Po Road and MIC compound/Basketball Court) and the indicative area of natural slope mitigation works fall within the SENT Landfill Extension Consultation Zone in this contract (Figure 5.1), landfill gas monitoring would be required for Wan Po Road and MIC compound/Basketball Court (Figure 5.2) if excavations were conducted at more than 300mm deep. Although SENT Landfill Extension has commenced operation since November 2021, no excavation works were conducted at MIC compound/Basketball Court. Hence no landfill gas monitoring would be scheduled for MIC compound/Basketball Court at the current stage.

MONITORING LOCATION

- 5.3. Monitoring of oxygen, methane, carbon dioxide and barometric pressure would be performed for excavations at 1m depth or more within the consultation Zone.
- 5.4. During construction of works within the consultation zones, excavations of 1m depth or more was monitored:
- At the ground surface before excavation commences;
 - Immediately before any worker enters the excavation;
 - At the beginning of each working day for the entire period the excavation remains open; and
 - Periodically through the working day whilst workers are in the excavation.
- 5.5. For excavations between 300mm and 1m deep, measurements were carried out:
- Directly after the excavation has been completed; and
 - Periodically whilst the excavation remains open.
- 5.6. The area required to be monitored for landfill gas in the reporting period is shown in **Figure 5.1**.

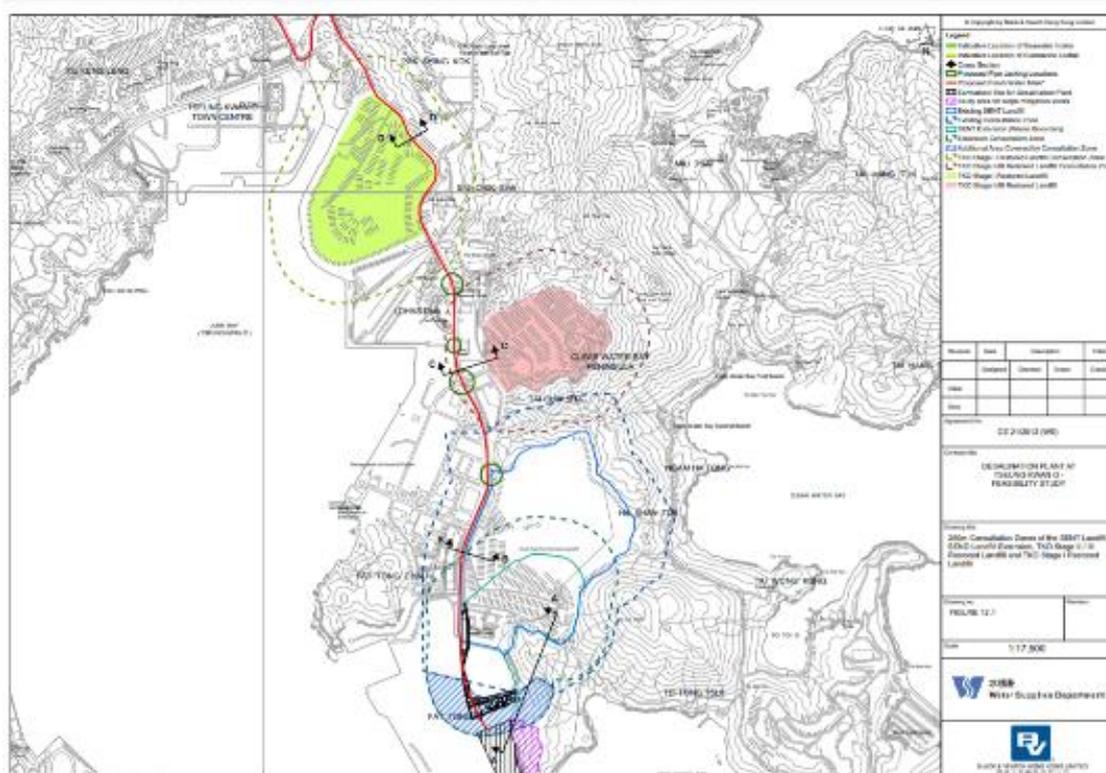


Figure 5.1 Overview of the SENT Extension Consultation Zone and the Contract Site Area

MONITORING PARAMETERS

5.7. The landfill gas monitoring parameters and the action and limit level are summarized in **Table 5.1**.

Table 5.1 Action and Limit Level for Landfill Gas Monitoring Equipment

| Parameters | Action Level | Limit Level |
|-----------------------------------|-----------------------|-----------------------|
| Oxygen (O ₂) | <19% O ₂ | <19% O ₂ |
| Methane (CH ₄) | >10% LEL | >20% LEL |
| Carbon Dioxide (CO ₂) | >0.5% CO ₂ | >1.5% CO ₂ |

MONITORING EQUIPMENT

5.8. Landfill Gas monitoring was carried out using intrinsically-safe, portable multi-gas monitoring instruments. The gas monitoring equipment is:

- Complying with the Landfill Gas Hazard Assessment Guidance Note as intrinsically safe;
- Capable of continuous barometric pressure and gas pressure measurements;
- Normally operated in diffusion mode unless required for spot sampling, when it should be capable of operating by means of an aspirator or pump;
- Having low battery, fault and over range indication incorporated;
- Capable of storing monitoring data, and shall be capable of being downloaded directly;
- Measure in the following ranges:

| | |
|---------------------|--|
| methane | 0-100% LOWER EXPLOSION LIMIT (LEL) AND 0-100% v/v; |
| oxygen | 0-25% v/v; |
| carbon dioxide | 0-5% v/v; and |
| barometric pressure | mBar (absolute) |

- alarm (both audibly and visually) in the event that the concentrations of the following are exceeded:

| | |
|---------------------|-----------------|
| methane | >10% LEL; |
| oxygen | <19% |
| carbon dioxide | >0.5% by volume |
| barometric pressure | mBar (absolute) |

5.9. Monitoring equipment used in the reporting period are summarized in **Table 5.2**. The Landfill Gas monitoring equipment calibration certificate is presented in **Appendix F**.

Table 5.2 Landfill Gas Monitoring Equipment

| Equipment | Brand and Model | Calibration Expiry Date |
|-----------------------|-------------------------|-------------------------|
| Portable Gas Detector | GMI PS500 – 25492809/21 | 1 September 2023 |

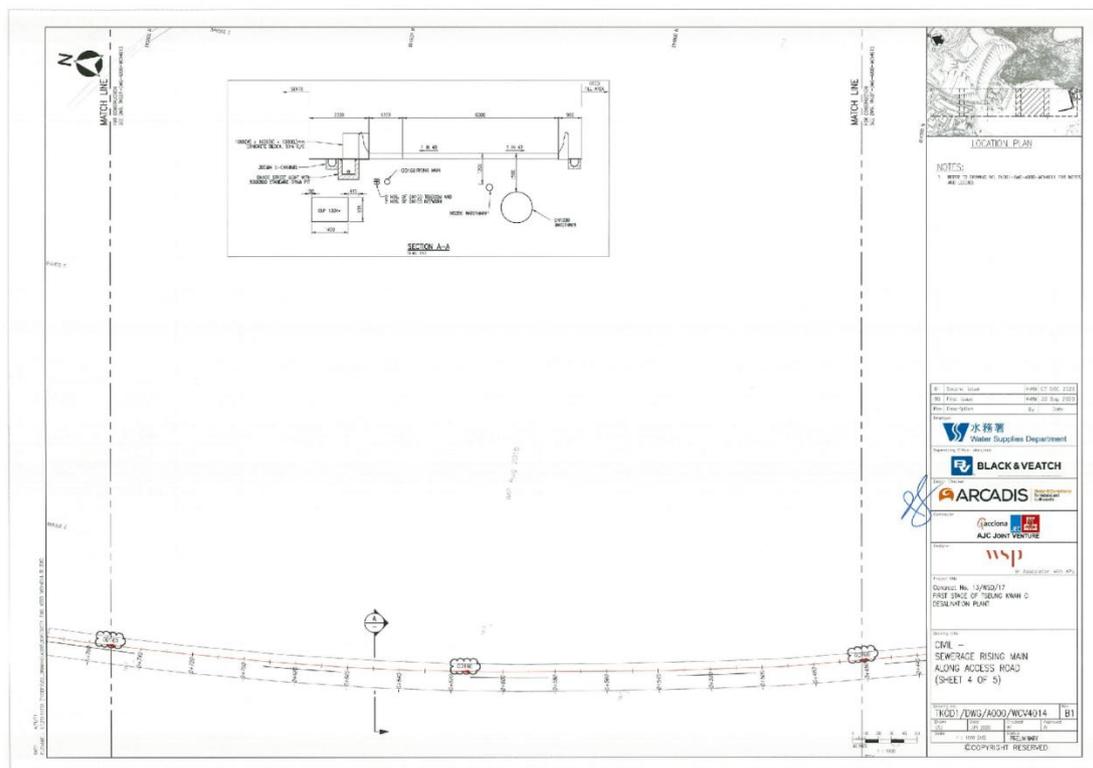


Figure 5.2 Location Map for Landfill Gas Monitoring at TKO Area 137 (-0+440 – -0+760)

6. SUMMARY OF EXCEEDANCE, COMPLAINTS, NOTIFICATION OF SUMMONS AND PROSECUTIONS

6.1. The Environmental Complaint Handling Procedure is shown in below **Figure 6.1**:

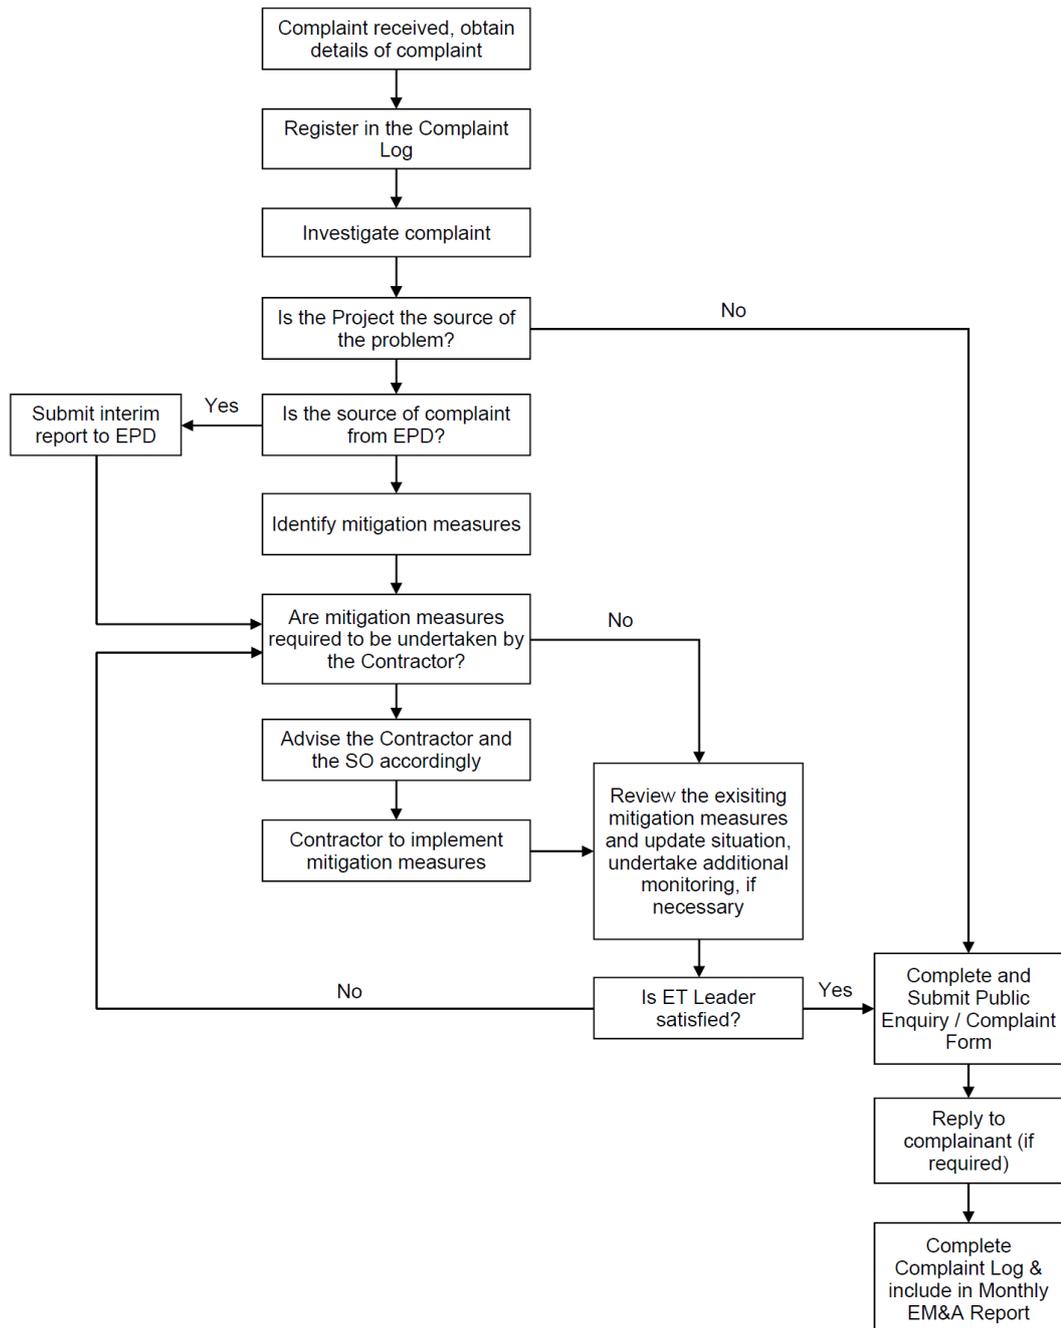


Figure 6.1 Environmental Complaint Handling Procedures

- 6.2. No noise monitoring was conducted during the reporting period since there are no Contract-related construction activities undertaken within a radius of 300m from the monitoring locations. No action Level exceedance for construction noise monitoring was recorded in the reporting month.
- 6.3. General water quality monitoring at the ten monitoring stations (CE, CF, WSR1, WSR2, WSR3, WSR4, WSR16, WSR33, WSR36 and WSR37) were conducted on 1, 4, 6, 8, 11, 13, 15, 18, 20, 22, 25, 27 and 29 July 2023.
- 6.4. Eleven (11) of the general water quality monitoring results of SS obtained had exceeded the Action Level. Nine (9) of the general water quality monitoring results of SS obtained during the reporting period had exceeded the Limit Level.
- 6.5. Investigation on the reason of exceedance has been carried out, where the exceedances of SS on were 18 July 2023 were concluded to be unrelated to the Contract as detailed in the Incident Reports on Action Level or Limit Level Non-compliance along with supporting materials in **Appendix K**.
- 6.6. In this reporting period, 72 times of landfill gas monitoring were conducted at TKO Area 137 (Ch1+340 – Ch1+600). No action or limit level exceedance was recorded during the reporting period.
- 6.7. No environmental complaint, notification of summons and prosecution was received in the reporting month. Statistics on complaint and notification of summons and prosecution are summarized in **Appendix J**.

7. EM&A SITE INSPECTION

7.1. Site inspections were carried out on a weekly basis to monitor the implementation of proper environmental pollution control and mitigation measures under the Contract. In the reporting period, site inspections were carried out on 4, 11, 18 and 25 July 2023 at the site portions listed in **Table 7.1** below.

Table 7.1 Summaries of Site Inspection Record

| Date | Inspected Site Portion | Time |
|--------------|------------------------|---------------|
| 4 July 2023 | TKO Area 137 | 14:30 – 15:30 |
| 11 July 2023 | TKO Area 137 | 14:30 – 16:00 |
| 18 July 2023 | TKO Area 137 | 14:30 – 16:00 |
| 25 July 2023 | TKO Area 137 | 09:15 – 12:00 |

7.2. Joint site inspections with IEC were carried out on 4, 11, 18 and 25 July 2023.

7.3. Environmental deficiencies were observed during weekly site inspection. Key observations during the site inspections and during the reporting period are summarized in **Table 7.2**.

Table 7.2 Site Observations

| Date | Environmental Observations | Follow-up Status |
|-------------|--|---|
| 4 Jul 2023 | No major environmental deficiency was observed. | N/A |
| 11 Jul 2023 | No major environmental deficiency was observed. | N/A |
| 18 Jul 2023 | 1. The Chemical containers found near the R.O. Building shall be stored on a drip tray or proper storage. | 1. Chemical container near the R.O. Building was removed. |
| 25 Jul 2023 | 1. The chemical containers found near the R.O. Building shall store on a drip tray or provide proper storage to prevent leakage. | 1. Chemical container near the R.O. Building was removed. |

7.1. According to the EIA Study Report, Environmental Permit, contract documents and EM&A Manual, the mitigation measures detailed in the documents should be implemented as much as practical during the reporting period. An updated Implementation Status of Environmental Mitigation Measures (EMIS) is provided in **Appendix C**. Site inspection proforma of the reporting period is provided in **Appendix I**.

8. FUTURE KEY ISSUES

8.1. Works to be undertaken in the next reporting month are:

| |
|---|
| <p>Administration Building</p> <ul style="list-style-type: none"> • Carrying out the floor tiles works at 1/F and 2/F • Installation of building services, cable laying, electrical switchboard, doors and handrails • Construction of block wall in the pipe duct |
| <p>Chemical building</p> <ul style="list-style-type: none"> • Installation of permanent doors • Underground utility construction work • Construction of trunk load pits |
| <p>Main Electrical & Central Chiller Plant Building</p> <ul style="list-style-type: none"> • Installation of roof tile for fuel tank room, chillers, building services, electrical switchboard and cable laying |
| <p>ActiDAFF</p> <ul style="list-style-type: none"> • Underground utility construction work • Construction of staircase no 2 • Erection and dismantling of scaffolding, installation of underdrain media and electrical equipment and installation of access covers on roof |
| <p>Product Water Storage Tank Building</p> <ul style="list-style-type: none"> • Resin Injection Work & Water Test for 1 Water Tanks • Installation of cat ladders in Water Tanks • Installation of metal cladding, building services, cable laying, mechanical equipment, steel pipe • Underground utility construction • Sealing slab opening |
| <p>OSCG Building</p> <ul style="list-style-type: none"> • Installation of Design for Manufacturing and Assembly (DfMA) Panel and metal door • Underground utility construction work • Installation of building services, mechanical equipment, metal cladding and roller shutters and window |
| <p>Reverse Osmosis Building</p> <ul style="list-style-type: none"> • Installation of building services, electrical switchboard, mechanical equipment, steel pipe, Glass Reinforced Plastics (GRP) pipe and cable laying • Installation of metal cladding, handrailing and louvers • Underground utility construction work • Pipe laying at corridor |

| |
|---|
| Post Treatment Building <ul style="list-style-type: none">• Installation of Louvres & Windows, cat ladders, handrailing and metal cladding• Installation of building services, mechanical equipment and GRP pipe• Underground utility construction work |
| Inspection corridor <ul style="list-style-type: none">• Construction of roof concrete slab and column and wall |
| CO ₂ Tanks <ul style="list-style-type: none">• Installation of pipes and building services Combined Shaft and Pump room <ul style="list-style-type: none">• Underground utility construction work• Installation of door, window and louver Other <ul style="list-style-type: none">• Watermain works at CLP 132 kV Substation• Concrete breaking, structure construction of Wave Deflector Wall at seawall area• Foundation and staircases construction at elevated walkway• Foot plinth concreting and barrier erection at flexible barrier |

8.2. The major environmental impacts brought by the above construction works will include:

- Construction dust and noise generation from excavation and construction works;
- Waste generation from construction activities; and
- Impact on water quality from marine construction works and inland construction works.

8.3. The key environmental mitigation measures for the Project in the coming reporting period associated with the above construction works will include:

- Dust suppression by regular wetting and water spraying for construction works
- Reduction of noise from equipment and machinery on-site by regular checking of on-site plant/vehicle to ensure proper functioning
- Sorting and storage of general refuse and construction waste
- Deployment of temporary silt curtain in the area where marine construction works were conducted and deployment of water sedimentation tanks for treatment of wastewater at inland and marine areas before discharge

9. CONCLUSIONS AND RECOMMENDATIONS

- 9.1. This is the 41st Monthly EM&A Report for the Project which summarizes the key findings of the EM&A programme during the reporting period from 1 July to 31 July 2023, in accordance with the EM&A Manual and the requirement under FEP-01/503/2015/A.
- 9.2. No noise monitoring was conducted in the reporting period due to the over distant monitoring station from the works location, in which construction activities were not undertaken within a radius of 300m from the monitoring locations.
- 9.3. The EM&A works for water quality were conducted during the reporting period in accordance with the EM&A Manual.
- 9.4. Eleven (11) of the general water quality monitoring results of SS obtained had exceeded the Action Level. Nine (9) of the general water quality monitoring results of SS obtained during the reporting period had exceeded the Limit Level. After investigation, all exceedances were concluded unrelated to the Project.
- 9.5. In this reporting period, 72 times of landfill gas monitoring were conducted at TKO Area 137 (Ch2+340 -Ch1+600). No action or limit level exceedance was recorded in the reporting period.
- 9.6. Weekly environmental site inspections were conducted during the reporting period. Observations and reminders were reported during the site inspections. All items are rectified within the reporting period. The environmental performance of the project was therefore considered satisfactory.
- 9.7. According to the environmental site inspections performed in the reporting month, the Contractor is reminded to pay attention on chemical storage, site hygiene and dust suppression mitigation measures.
- 9.8. No environmental complaint, notification of summons and prosecution was received in the reporting period.
- 9.9. The ET will keep track on the construction works to confirm compliance of environmental requirements and the proper implementation of all necessary mitigation measures.

Appendix A

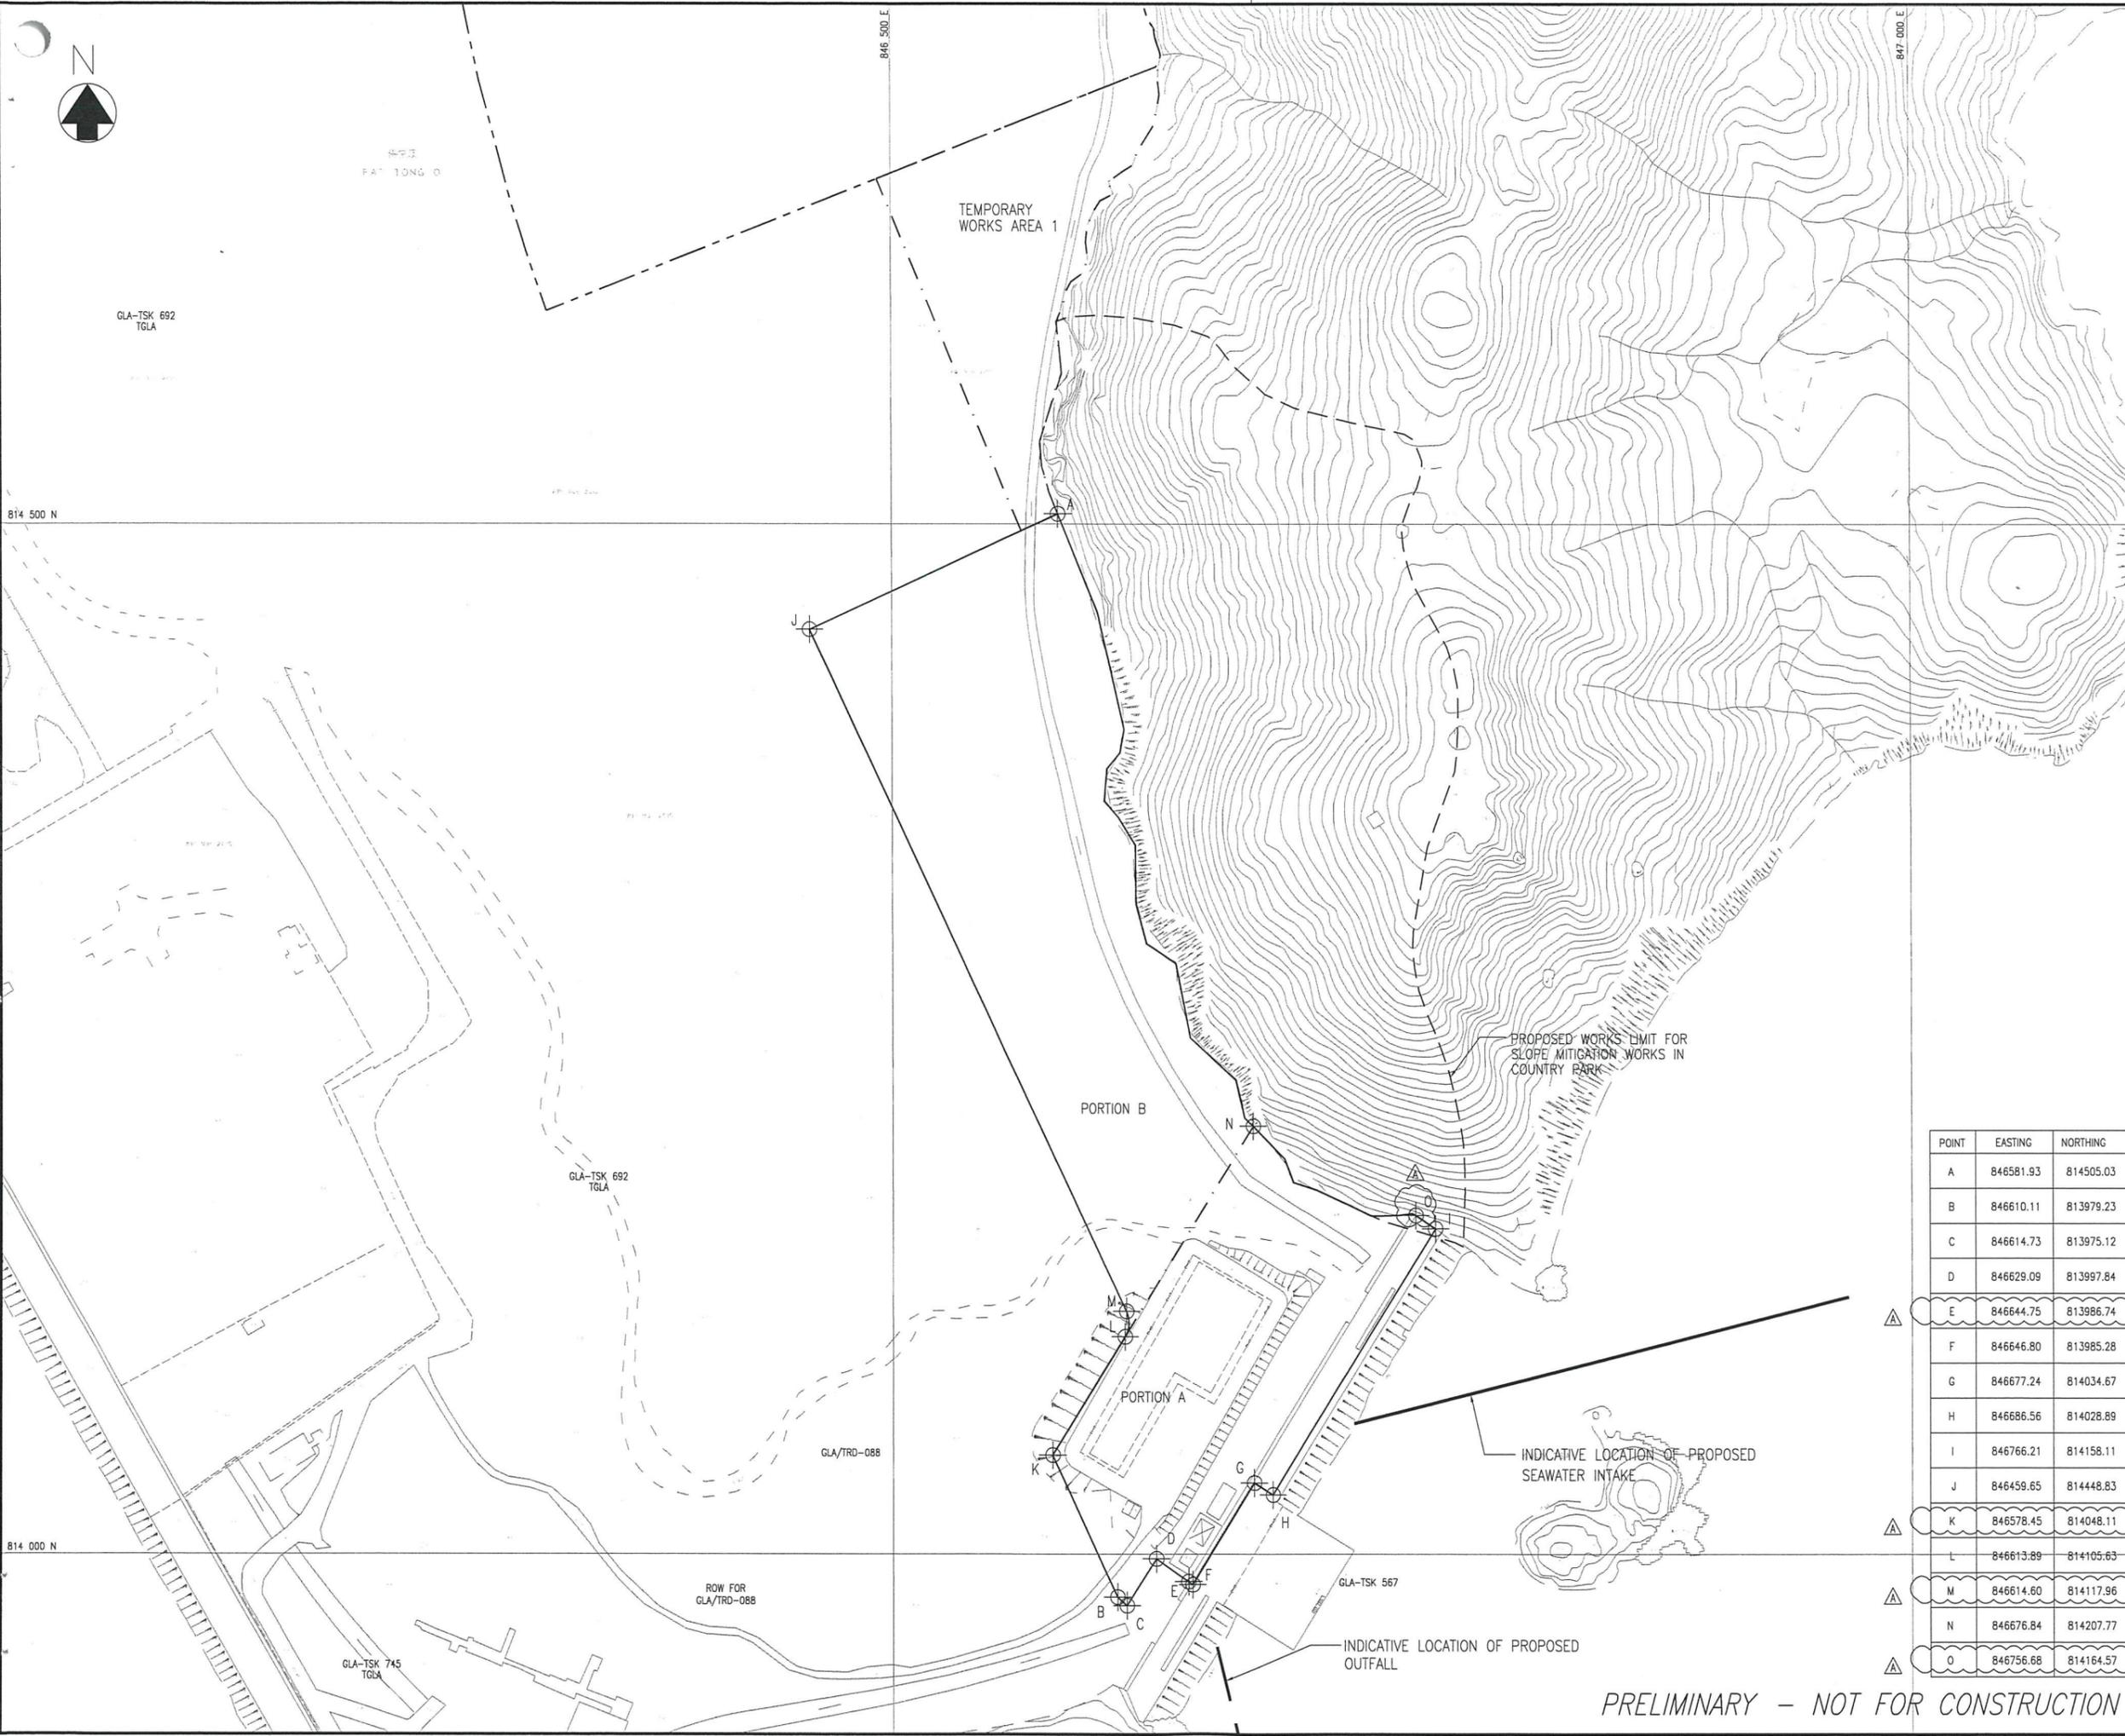
Construction Programme

Appendix B

Overview of Desalination Plant in Tseung Kwan O

- LEGEND:**
- BOUNDARY OF SENT LANDFILL EXTENSION
 - BOUNDARY OF WORKS AREA FOR TKO DESALINATION PLANT
 - - - SITE PHASING
 - ALLOCATED LAND BOUNDARIES

NOTE: TEMPORARY WORKS AREA 1 WILL BE HANDED OVER AT +6 MPD WITH A TOLERANCE OF ±500mm.



| B | 10/03 | UPDATE NOTES | YLC |
|----------|-------|--------------------|---------|
| A | 07/18 | UPDATE COORDINATES | YLC |
| Revision | Date | Description | Initial |
| | | Designed | Checked |
| Initial | YLC | CKH | SZ |
| Date | 02/18 | 02/18 | 02/18 |

Approved
Christina Go

Agreement No. CE 8/2015 (WS)

Contract No. 13/WSD/17

Contract Title
DESIGN, BUILD AND OPERATE FIRST STAGE OF TSEUNG KWAN O DESALINATION PLANT

Drawing Title
SITE HANDOVER WORKS AREAS

Drawing No. 190495/K/TEND/10/0003
Revision B

Scale A1 1 : 1500
A3 1 : 3000



BLACK & VEATCH HONG KONG LIMITED
博威工程顧問有限公司

| POINT | EASTING | NORTHING |
|-------|-----------|-----------|
| A | 846581.93 | 814505.03 |
| B | 846610.11 | 813979.23 |
| C | 846614.73 | 813975.12 |
| D | 846629.09 | 813997.84 |
| E | 846644.75 | 813986.74 |
| F | 846646.80 | 813985.28 |
| G | 846677.24 | 814034.67 |
| H | 846686.56 | 814028.89 |
| I | 846766.21 | 814158.11 |
| J | 846459.65 | 814448.83 |
| K | 846578.45 | 814048.11 |
| L | 846613.89 | 814105.63 |
| M | 846614.60 | 814117.96 |
| N | 846676.84 | 814207.77 |
| O | 846756.68 | 814164.57 |

PRELIMINARY - NOT FOR CONSTRUCTION

BUILDINGS IN FIRST STAGE

| CODE | NAME OF BUILDING | TOTAL G.F.A. (m ²) | SITE COVERAGE (m ²) |
|---------|--|--------------------------------|---------------------------------|
| B | COMBINE SHAFT | 759,876 | 759,876 |
| C | ACTIDAFF | 10027,547 | 5455,346 |
| G | REVERSE OSMOSIS BUILDING AND ELECTRICAL BUILDING | 4511,455 | 5367,935 |
| H | CO2 TANKS AREA | - | - |
| J | PRODUCT WATER STORAGE TANK, PUMP STATION AND ELECTRICAL BUILDING | 1974,610 | 2933,980 |
| K | SLUDGE TREATMENT BUILDING, TANK AND PUMP ROOM | 2531,044 | 1228,361 |
| M | ADMINISTRATION BUILDING & ELECTRICAL BUILDING C | 2450,713 | 1114,062 |
| N | MAIN ELECTRICAL AND CENTRAL CHILLER PLANT BUILDING | - | 499,893 |
| R1 | ELECTROCHLORINATION BUILDING & ELECTRICAL BUILDING A | 657,992 | 825,776 |
| S | 132 KV SUBSTATION | - | 943,560 |
| T | IRRIGATION WATER TANK AND PUMP ROOM | - | 156,148 |
| R2 | CHEMICAL BUILDING | 813,056 | 813,056 |
| V | VISITOR GALLERY | 1330,410 | 1330,410 |
| X1 | GUARD HOUSE AND FS CONTROL ROOM | 39,585 | 39,585 |
| X2 | GUARD HOUSE | 22,035 | 22,035 |
| Y | R + D OUTDOOR | - | - |
| Z | WASTE WATER TREATMENT PLANT | 48,000 | 48,000 |
| TOTAL = | | 25175,323 | 21490,023 |

LEGEND / ABBREVIATION

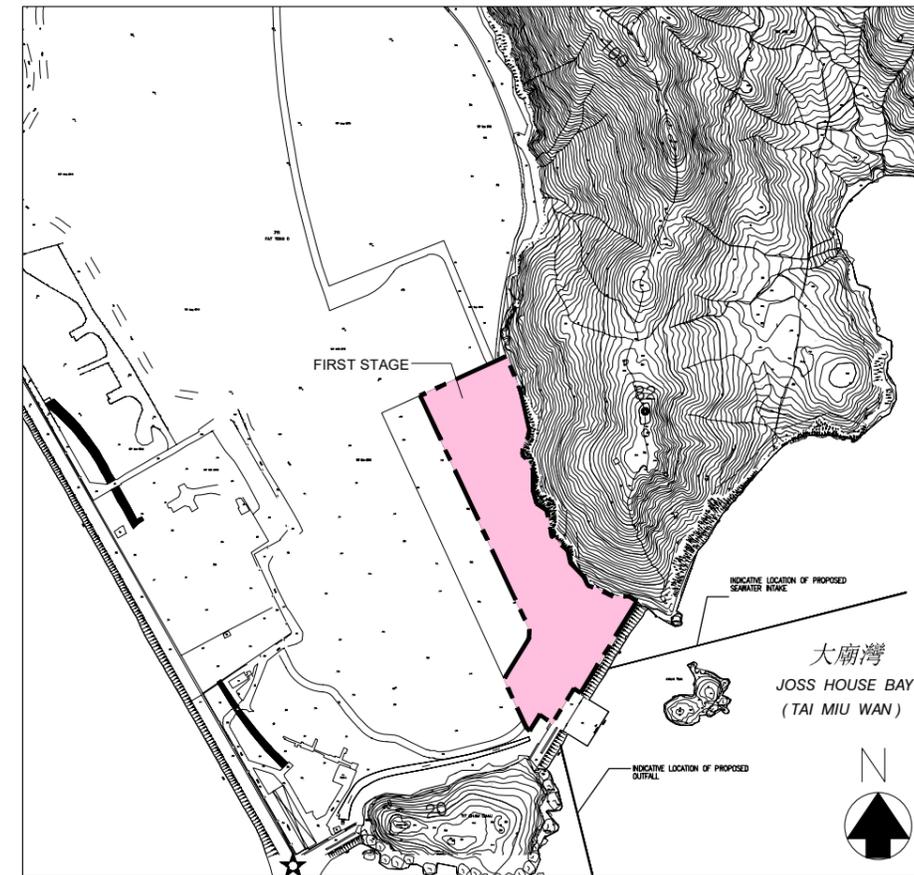
- HL WINDOW HIGH LEVEL WINDOW
- M.L. METAL LOUVRES
- C.L. CAT LADDER
- A.U.T. ACCESSIBLE UNISEX TOILET
- ⊕ PROPOSED FINISH FLOOR LEVEL IN METER ABOVE P.D.
- ⊖ STRUCTURAL FLOOR LEVEL IN METER ABOVE P.D.
- M.V.I.A.L. MECHANICAL VENTILATION & ARTIFICIAL LIGHTING
- F.E. 4.5kg CO₂ FIRE EXTINGUISHER
- H.R. HOSE REEL
- ⊙ FIREMANS LIFT
- ⊕ LIFT FOR THE BARRIER FREE ACCESS
- P.D. PIPE DUCT

PLOT RATIO & SITE COVERAGE CALCULATION:

| | | |
|------------------------------|---|--------------------------|
| SITE AREA OF THE FIRST STAGE | = | 56108 m ² |
| TOTAL G.F.A. | = | 25092.141 m ² |
| TOTAL SITE COVERAGE | = | 21414.841 m ² |
| PLOT RATIO | = | 25092.141 / 56108 |
| | = | 0.447 < PERMITTED |
| SITE COVERAGE | = | 21414.841 / 56108 x 100 |
| | = | 38.167% |

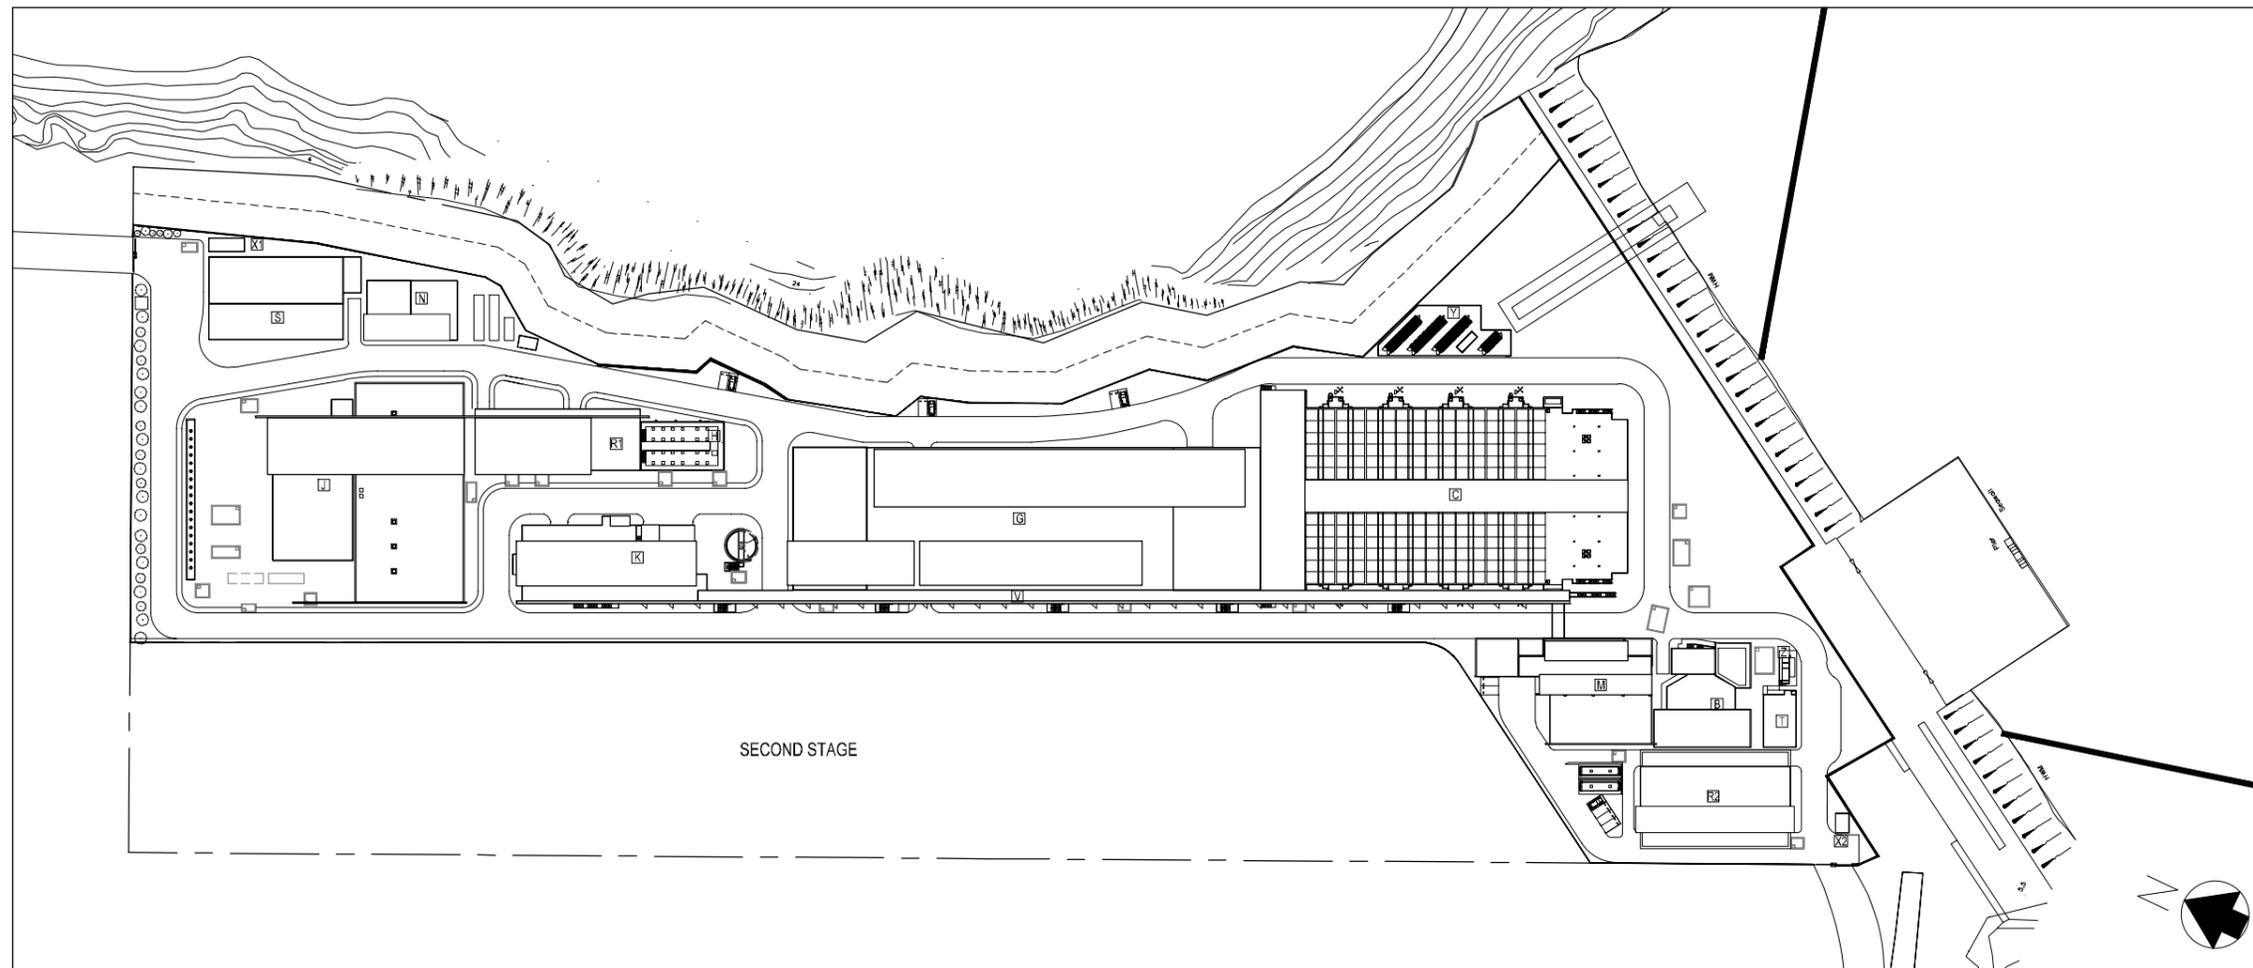
SITE LOCATION PLAN

1 : 5000



FIRST STAGE OF TSEUNG KWAN O DESALINATION PLANT

1 : 1000



| | | | |
|---|-------------------|---------|----------|
| 0 | TENDER SUBMISSION | CAD | JAN 19 |
| Rev | Description | By | Date |
| Employer | | | |
| | | | |
| Employer's Consultant | | | |
| | | | |
| Tenderer | | | |
| | | | |
| Designer | | | |
| | | | |
| Project title | | | |
| CONTRACT NO. 13/WSD/17 | | | |
| DESIGN, BUILD AND OPERATE FIRST STAGE OF TSEUNG KWAN O DESALINATION PLANT | | | |
| Drawing title | | | |
| ARCHITECTURAL – PLOT RATIO AND SITE COVERAGE CALCULATION, LEGEND ABBREVIATION | | | |
| Drawing no. | | Rev. | |
| TKO/AJC/W/A000/AR/001 | | 0 | |
| Drawn | Date | Checked | Approved |
| OKAL | JAN 19 | S.C. | T.C. |
| Scale | N.T.S. | Status | - |

Appendix C

Summary of Implementation Status of Environmental Mitigation

| EIA Reference | Recommended Environmental Protection Measures/ Mitigation Measures | Objectives of the recommended measures & main concerns to address | Implementation Agent | Implementation Stage | | | Implementation status | Relevant Legislation & Guidelines |
|--------------------|--|---|----------------------|----------------------|---|---|----------------------------|---|
| | | | | D | C | O | | |
| Air Quality | | | | | | | | |
| S4.8.1 | Impervious dust screen or sheeting will be provided to enclose scaffolding from the ground floor level of building for construction of superstructure of the new buildings. | Land site/ During Construction | Contractor(s) | | ✓ | | Implemented | Air Pollution Control (Construction Dust) |
| S4.8.1 | Impervious sheet will be provided for skip hoist for material transport. | Land site/ During Construction, particularly dry season | Contractor(s) | | ✓ | | NA | - |
| S4.8.1 | The area where dusty work takes place should be sprayed with water or a dust suppression chemical immediately prior to, during and immediately after dusty activities as far as practicable. | Land site/ During Construction | Contractor(s) | | ✓ | | Implemented | - |
| S4.8.1 | All dusty materials should be sprayed with water or a dust suppression chemical immediately prior to any loading, unloading or transfer operation. | Land site/ During Construction | Contractor(s) | | ✓ | | Implemented | - |
| S4.8.1 | Dropping heights for excavated materials should be controlled to a practical height to minimize the fugitive dust arising from unloading. | Land site/ During Construction | Contractor(s) | | ✓ | | Implemented | - |
| S4.8.1 | During transportation by truck, materials should not be loaded to a level higher than the side and tail boards and should be dampened or covered before transport. | Land site/ During Construction | Contractor(s) | | ✓ | | Implemented | - |
| S4.8.1 | Wheel washing device should be provided at the exits of the work sites. Immediately before leaving a construction site, every vehicle shall be washed to remove any dusty material from its body and wheels as far as practicable. | Land site/ During Construction | Contractor(s) | | ✓ | | Implemented | - |
| S4.8.1 | Road sections between vehicle-wash areas and vehicular entrance will be paved. | Land site/ During Construction | Contractor(s) | | ✓ | | Implemented | - |
| S4.8.1 | Hoarding of not less than 2.4m high from ground level will be provided along the length of the Project Site boundary. | Land site/ During construction | Contractor(s) | ✓ | ✓ | | N/A | - |
| S4.8.1 | Haul roads will be kept clear of dusty materials and will be sprayed with water so as to maintain the entire road surface wet at all times. | Land site/ During construction | Contractor(s) | | ✓ | | Implemented after reminder | - |

| EIA Reference | Recommended Environmental Protection Measures/ Mitigation Measures | Objectives of the recommended measures & main concerns to address | Implementation Agent | Implementation Stage | | | Implementation status | Relevant Legislation & Guidelines |
|---------------|---|---|---|----------------------|---|---|-------------------------------|--|
| | | | | D | C | O | | |
| S4.8.1 | Temporary stockpiles of dusty materials will be either covered entirely by impervious sheets or sprayed with water to maintain the entire surface wet all the time. | Land site/ During construction | Contractor(s) | | ✓ | | Implemented after reminder | - |
| S4.8.1 | Stockpiles of more than 20 bags of cement, dry pulverised fuel ash and dusty construction materials will be covered entirely by impervious sheeting sheltered on top and 3-sides. | Land site/ During construction | Contractor(s) | | ✓ | | Implemented | - |
| S4.8.1 | All exposed areas will be kept wet always to minimise dust emission. | Land site/ During construction | Contractor(s) | | ✓ | | Implemented | - |
| S4.8.1 | Ultra-low-sulphur diesel (ULSD) will be used for all construction plant on-site, as defined as diesel fuel containing not more than 0.005% sulphur by weight) as stipulated in Environment, Transport and Works Bureau Technical Circular (ETWB-TC(W)) No 19/2005 on Environmental Management on Construction Sites. | Land site/ During construction/ During Operation | Contractor(s) | | ✓ | ✓ | Implemented | Environment, Transport and Works Bureau Technical Circular (ETWB-TC(W)) No 19/2005 on Environmental Management on Construction Sites |
| S4.8.1 | The engine of the construction equipment during idling will be switched off. | Land site/ During construction | Contractor(s) | | ✓ | | Implemented | - |
| S4.8.1 | Concrete batching plant will be required on site. control measures recommended in the Guidance Note on a Best Practicable Means for Cement Works (Concrete Batching Plant) (BPM 3/2 (93)) will be implemented. The control measures recommended in the Guidance Note on a Best Practicable Means for Cement Works (Concrete Batching Plant) (BPM 3/2 (93)) will be implemented. | Land site/ During construction | Contractor(s) | | ✓ | | N/A | - |
| S4.8.1 | Regular maintenance of construction equipment deployed on-site will be conducted to prevent black smoke emission. | Land site/ During construction | Contractor(s) | | ✓ | | Implemented after observation | - |
| S4.10 | To ensure proper implementation of the recommended dust mitigation measures and good construction site practices during the construction phase, environmental site audits on weekly basis is recommended throughout the construction period. | Land site/ During construction | Contractor(s)/ Environmental Team (ET) & Independent Environmental Checker (IEC) | | ✓ | | Implemented | - |

Note: D – Design stage C – Construction O – Operation

| EIA Reference | Recommended Environmental Protection Measures/ Mitigation Measures | Objectives of the recommended measures & main concerns to address | Implementation Agent | Implementation Stage | | | Implementation status | Relevant Legislation & Guidelines |
|---------------|--|---|----------------------|----------------------|---|---|-----------------------|--|
| | | | | D | C | O | | |
| Noise | | | | | | | | |
| S5.7 | Only well-maintained plant will be operated on-site and plant will be serviced regularly during the construction phase. | All area/ During construction | Contractor(s) | | ✓ | | Implemented | A Practical Guide for the Reduction of Noise from Construction Works |
| S5.7 | Silencers or mufflers on construction equipment will be utilised and will be properly maintained during the construction phase. | Noise control/ During construction | Contractor(s) | | ✓ | | N/A | A Practical Guide for the Reduction of Noise from Construction Works |
| S5.7 | Mobile plant, if any, will be sited as far away from NSRs as possible. | Noise control/ During construction | Contractor(s) | | ✓ | | N/A | A Practical Guide for the Reduction of Noise from Construction Works |
| S5.7 | Machines and plant (such as trucks) that may be in intermittent use will be shut down between work periods or will be throttled down to a minimum. | Noise control/ During construction | Contractor(s) | | ✓ | | Implemented | A Practical Guide for the Reduction of Noise from Construction Works |
| S5.7 | Plants known to emit noise strongly in one direction will, wherever possible, be orientated so that the noise is directed away from the nearby NSRs. | Noise control/ During construction | Contractor(s) | | ✓ | | N/A | A Practical Guide for the Reduction of Noise from Construction Works |
| S5.7 | Material stockpiles and other structures will be effectively utilised, wherever practicable, in screening noise from on-site construction activities. | Noise control/ During construction | Contractor(s) | | ✓ | | N/A | A Practical Guide for the Reduction of Noise from Construction Works |
| S5.7 | Use of Quite Powered Mechanical Equipment (QPME). | Noise control/ During construction | Contractor(s) | | ✓ | | Implemented | A Practical Guide for the Reduction of Noise from Construction Works |
| S5.7 | Movable noise barriers of 3m in height with skid footing should be used and located within a few metres of stationary plant and mobile plant such that the line of sight to the NSR is blocked by the barriers. The length of the barrier should be at least five times greater than its height. The noise barrier material should have a superficial surface density of at least 7 kg m ⁻² and have no or gappingss. | Noise control/ During construction | Contractor(s) | | ✓ | | N/A | A Practical Guide for the Reduction of Noise from Construction Works |
| S5.7 | The noise insulating sheet should be deployed such that there would be no opening or gaps on the joints. | Noise control/ During construction | Contractor(s) | | ✓ | | N/A | A Practical Guide for the Reduction of Noise from Construction Works |
| S5.7 | Construction activities (e.g. excavation/shoring, reinstatement (asphalt), and pipe jacking) will be planned and carried out in sequence, such that items of PME proposed for these activities will not be operated simultaneously. | Noise control/ During construction | Contractor(s) | ✓ | ✓ | | Implemented | A Practical Guide for the Reduction of Noise from Construction Works |
| S5.7 | PMEs will not be used at the works areas near educational institutions with residual impact (ie the "influence area" within a | Noise control / During construction | Contractor(s) | | ✓ | | N/A | A Practical Guide for the Reduction of Noise from |

| EIA Reference | Recommended Environmental Protection Measures/ Mitigation Measures | Objectives of the recommended measures & main concerns to address | Implementation Agent | Implementation Stage | | | Implementation status | Relevant Legislation & Guidelines |
|---------------|--|--|---|----------------------|---|---|-----------------------|-----------------------------------|
| | | | | D | C | O | | |
| | radius of 40m) during school hours in order to reduce impact to the educational institutions. | | | | | | | Construction Works |
| S5.7 | Noise enclosures or acoustic sheds would be used to cover stationary PME such as generators. Portable/Movable noise enclosure made of material with superficial surface density of at least 7 kg m-2 may be used for screening the noise from operation of the saw/groover, concrete. | Noise control/ Pre-construction/ During construction | Contractor(s) | ✓ | ✓ | | N/A | - |
| S5.9 | Sawcutting pavement, breaking up of pavement, excavation /shoring, pipe laying, backfilling, reinstatement (concrete) and pipe jacking shall be scheduled outside the examination period. | Noise control/ Pre-construction/ During construction | Contractor(s) | ✓ | ✓ | | N/A | - |
| S5.9 | In view the duration of noise exceedance at Creative Secondary School, PLK Laws Foundation College, TKO Kei Tak Primary School and School of Continuing and Professional Studies-CUHK is limited to 8 weeks, the construction work in the influence areas near the four schools shall be scheduled during long school holidays (eg summer holiday, Easter holiday or Christmas holiday, etc) as far as practicable. Scheduling the construction work for the four schools. | Noise control/ Pre-construction/ During construction | Contractor(s) | ✓ | ✓ | | N/A | - |
| S5.10 | A noise monitoring programme shall be implemented for the construction phase. | Designated monitoring stations as defined in EM&A Manual/During construction phase | Environmental Team | | ✓ | | N/A | - |
| S5.10 | The effectiveness of on-site control measures could also be evaluated through the regular site audits. | All facilities/ During construction | Contractor(s)/ ET & Independent Environmental Checker (IEC) | | ✓ | | Implemented | - |

Note: D – Design stage C – Construction O – Operation

| EIA Reference | Recommended Environmental Protection Measures/ Mitigation Measures | Objectives of the recommended measures & main concerns to address | Implementation Agent | Implementation Stage | | | Implementation status | Relevant Legislation & Guidelines |
|----------------------|---|---|----------------------|----------------------|---|---|-----------------------|--|
| | | | | D | C | O | | |
| Water Quality | | | | | | | | |
| S6.9 | Dredged marine sediment will be disposed of in a gazetted marine disposal area in accordance with marine dumping permit conditions of the Dumping at Sea Ordinance (DASO). | Marine Dredging/ During construction | Contractor(s) | | ✓ | | Implemented | Dumping at Sea Ordinance (DASO) |
| S6.9 | Disposal vessels will be fitted with tight bottom seals in order to prevent leakage of material during transport. | Marine Dredging/ During construction | Contractor(s) | | ✓ | | Implemented | - |
| S6.9 | Barges will be filled to a level, which ensures that material does not spill over during transport to the disposal site and that adequate freeboard is maintained to ensure that the decks are not washed by wave action. | Marine Dredging/ During construction | Contractor(s) | | ✓ | | Implemented | - |
| S6.9 | After dredging, any excess materials will be cleaned from decks and exposed fittings before the vessel is moved from the dredging area. | Marine Dredging/ During construction | Contractor(s) | | ✓ | | Implemented | - |
| S6.9 | All vessels should be well maintained and inspected before use to limit any potential discharges to the marine environment. | Marine Dredging/ During construction | Contractor(s) | | ✓ | | Implemented | - |
| S6.9 | All vessels must have a clean ballast system. | Marine Dredging/ During construction | Contractor(s) | | ✓ | | Implemented | - |
| S6.9 | No discharge of sewage/grey wastewater should be allowed. Wastewater from potentially contaminated area on working vessels should be minimized and collected. These kinds of wastewater should be brought back to port and discharged at appropriate collection and treatment system. | Marine Dredging/ During construction | Contractor(s) | | ✓ | | Implemented | - |
| S6.9 | No soil waste is allowed to be disposed overboard. | Marine Dredging/ During construction | Contractor(s) | | ✓ | | N/A | - |
| S6.9 | Silt removal facilities such as silt traps or sedimentation facilities will be provided to remove silt particles from runoff to meet the requirements of the TM standard under the WPCO. The design of silt removal facilities will be based on the guidelines provided in ProPECC PN 1/94. All drainage facilities and erosion and sediment control structures will be inspected on a regular basis and maintained to confirm proper and efficient operation at all times and particularly during rainstorms. Deposited silt and grit will be removed regularly. | Land site & drainage/ During construction | Contractor(s) | | ✓ | | Implemented | ProPECC PN 1/94 TM Standard under the WPCO |
| S6.9 | Earthworks to form the final surfaces will be followed up with surface protection and drainage works to prevent erosion caused by rainstorms. | Land site & drainage/ During construction | Contractor(s) | | ✓ | | Implemented | - |

| EIA Reference | Recommended Environmental Protection Measures/ Mitigation Measures | Objectives of the recommended measures & main concerns to address | Implementation Agent | Implementation Stage | | | Implementation status | Relevant Legislation & Guidelines |
|----------------|--|---|-------------------------|----------------------|---|---|-----------------------|--|
| | | | | D | C | O | | |
| S6.9 | Appropriate surface drainage will be designed and provided where necessary. | Land site & drainage/ During construction | Contractor(s) | | ✓ | | Implemented | - |
| S6.9 | The precautions to be taken at any time of year when rainstorms are likely together with the actions to be taken when a rainstorm is imminent or forecasted and actions to be taken during or after rainstorms are summarized in Appendix A2 of ProPECC PN 1/94. | Land site & drainage/ During construction | Contractor(s) | ✓ | ✓ | | Implemented | ProPECC PN 1/94 |
| S6.9 | Oil interceptors will be provided in the drainage system where necessary and regularly emptied to prevent the release of oil and grease into the storm water drainage system after accidental spillages. | Land site & drainage/ During construction | Contractor(s) | | ✓ | | N/A | - |
| S6.9 | Temporary and permanent drainage pipes and culverts provided to facilitate runoff discharge, if any, will be adequately designed for the controlled release of storm flows. | Land site & drainage/ During construction | Contractor(s) | | ✓ | | Implemented | - |
| S6.9 | The temporary diverted drainage, if any, will be reinstated to the original condition when the construction work has finished or when the temporary diversion is no longer required. | Land site & drainage/ During construction | Contractor(s) | | ✓ | | N/A | - |
| S6.9 | Appropriate numbers of portable toilets shall be provided by a licensed contractor to serve the construction workers over the construction site to prevent direct disposal of sewage into the water environment. | Land site & drainage/ During construction | Contractor(s) | | ✓ | | Implemented | - |
| S6.9 and S6.12 | The sterilization water should be dechlorinated with total residual chlorine (TRC) level below 1 mg/L before discharge to public sewer. In situ testing of TRC should also be conducted for the discharge of chlorinated water for pipeline disinfection to ensure sufficient dechlorination before discharge to public sewer. | Sterilization of water mains prior to commissioning | Contractor(s) | | ✓ | ✓ | N/A | Technical Memorandum for Effluents Discharged into Drainage and Sewerage Systems Inland and Coastal Waters |
| S6.9 | The cleaning and flushing water should also be treated and desilted to the relevant discharge requirement stipulated in TM-DSS before discharging. | Sterilization of water mains prior to commissioning | Contractor(s) | | ✓ | ✓ | Implemented | |
| S6.9 | Site drainage should be well maintained, and good construction practices should be observed to ensure that oil, fuels, solvents, and other chemicals are managed, stored and handled properly and do not enter the nearby water streams. | Land site & drainage/ During construction/ During operation | Contractor(s) | | ✓ | ✓ | Implemented | - |
| S6.12 | Regular site inspections will be carried out in order to confirm that regulatory requirements are being met and that contractors are implementing the standard site practice and mitigation measures as proposed to reduce potential impacts to water quality. | During construction | Contractor(s)/ ET & IEC | | ✓ | | Implemented | - |

Note: D – Design stage C – Construction O – Operation

| EIA Reference | Recommended Environmental Protection Measures/ Mitigation Measures | Objectives of the recommended measures & main concerns to address | Implementation Agent | Implementation Stage | | | Implementation Status | Relevant Legislation & Guidelines |
|-------------------------|--|---|----------------------|----------------------|---|---|-----------------------|---|
| | | | | D | C | O | | |
| Waste Management | | | | | | | | |
| S8.5 | Nomination of approved personnel to be responsible for standard site practices, arrangements for collection and effective disposal to an appropriate facility of all wastes generated at the site. | Contract mobilization/ During construction | Contractor(s) | | ✓ | | Implemented | - |
| S8.5 | Training of site personnel in proper waste management and chemical handling procedures. Training will be provided to workers on the concepts of site cleanliness and appropriate waste management procedures, including waste reduction, reuse, and recycling at the beginning of the construction works. | Contract mobilization/ During construction | Contractor(s) | | ✓ | | Implemented | - |
| S8.5 | Provision of sufficient waste disposal points and regular collection for disposal. | All area/ During construction/ During operation | Contractor(s) | | ✓ | ✓ | Implemented | DEVB TC(W) No. 8/2010, Enhanced Specification for Site Cleanliness and Tidiness. |
| S8.5 | Appropriate measures to reduce windblown litter and dust transportation of waste by either covering trucks or by transporting wastes in enclosed containers. | All area/ During construction | Contractor(s) | | ✓ | | Implemented | DEVB TC(W) No. 8/2010, Enhanced Specification for Site Cleanliness and Tidiness. |
| S8.5 | A waste management plan (WMP) as stated in the "ETWB TC(W) No. 19/2005, Environmental Management on Construction Sites" for the amount of waste generated, recycled and disposed of (including the disposal sites) will be established and implemented during the construction phase as part of the Environmental Management Plan (EMP). The Contractor will be required to prepare the EMP and submits it to the Architect/ Engineer under the Contract for approval prior to implementation. | All area/ During construction | Contractor(s) | | ✓ | | Implemented | ETWB TC(W) No. 19/2005, Environmental Management on Construction Sites |
| S8.5 | Separation of chemical wastes for special handling and appropriate treatment at the Chemical Waste Treatment Centre at Tsing Yi. | All area/ During construction | Contractor(s) | | ✓ | | Implemented | Chapters 2 & 3 Code of Practice on the Packaging, Labelling & Storage of Chemical Wastes published under the Waste Disposal Ordinance (Cap 354), Section 35 |
| S8.5 | Regular cleaning and maintenance programme for drainage systems, sumps and oil interceptors. | Land site/ During construction | Contractor(s) | | ✓ | | Implemented | Waste Disposal Ordinance (Cap 354) |

| EIA Reference | Recommended Environmental Protection Measures/ Mitigation Measures | Objectives of the recommended measures & main concerns to address | Implementation Agent | Implementation Stage | | | Implementation Status | Relevant Legislation & Guidelines |
|---------------|---|---|----------------------|----------------------|---|---|-----------------------|---|
| | | | | D | C | O | | |
| S8.5 | A recording system for the amount of wastes generated/ recycled and disposal sites. The trip- ticket system will be included as one of the contractual requirements and implemented by the contractor(s). | Land site/ During construction | Contractor(s) | | ✓ | | Implemented | DEVB TC(W) No. 6/2010, Trip Ticket System for Disposal of Construction & Demolition Materials |
| S8.5 | Segregation and storage of different types of waste in different containers, skips or stockpiles to enhance reuse or recycling of material and their proper disposal. | Land site/ During construction/ During operation | Contractor(s) | | ✓ | | Implemented | WBTC 32/92, The Use of Tropical Hard Wood on Construction Site |
| S8.5 | Encourage collection of aluminium cans and wastepaper by individual collectors during construction with separate labelled bins provided to segregate these wastes from other general refuse by the workforce. | Land site/ During construction | Contractor(s) | | ✓ | | Implemented | ETWB TCW No. 33/2002, Management of Construction and Demolition Material Including Rock |
| S8.5 | Any unused chemicals and those with remaining functional capacity will be recycled as far as possible. | Land site/ During construction | Contractor(s) | | ✓ | | N/A | - |
| S8.5 | Use of reusable non-timber formwork to reduce the amount of C&D materials. | All areas/ During construction | Contractor(s) | | ✓ | | Implemented | WBTC 32/92, The Use of Tropical Hard Wood on Construction Site |
| S8.5 | Prior to disposal of construction waste, wood, steel, and other metals will be separated to the extent practical, for re-use and/or recycling to reduce the quantity of waste to be disposed of to landfill. | All areas/ During construction | Contractor(s) | | ✓ | | Implemented | DEVB TC(W) No. 6/2010, Trip Ticket System for Disposal of Construction & Demolition Materials |
| S8.5 | Proper storage and site practices to reduce the potential for damage or contamination of construction materials. | All areas/ During construction | Contractor(s) | | ✓ | | Implemented | - |
| S8.5 | Plan and stock construction materials carefully to reduce amount of waste generated and avoid unnecessary generation of waste. | All areas/ During construction | Contractor(s) | | ✓ | | Implemented | - |
| S8.5 | A Sediment Quality Report (SQR) for sampling and chemical testing of the sediment will be prepared and submitted to the EPD for approval. The approved detailed sampling and chemical testing will be carried out prior to the commencement of the dredging activities to confirm the sediment disposal method. | Marine works/ During construction | Contractor(s) | | ✓ | | N/A | ETWB TC(W) No. 34/2002 and Dumping at Sea Ordinance (DASO) |

| EIA Reference | Recommended Environmental Protection Measures/ Mitigation Measures | Objectives of the recommended measures & main concerns to address | Implementation Agent | Implementation Stage | | | Implementation Status | Relevant Legislation & Guidelines |
|---------------|---|---|--|----------------------|---|---|-----------------------|---|
| | | | | D | C | O | | |
| S8.5 | The management of dredged/ excavated sediment management requirement from ETWB TC(W) No. 34/2002 will be incorporated in the Specification of the Contract Documents. | Marine works/ During construction | WSD/ Contractor(s) | | ✓ | | Implemented | ETWB TC(W) No. 34/2002 and Dumping at Sea Ordinance (DASO) |
| S8.5 | The contractor will open a billing account with EPD in accordance with the Waste Disposal (Charges for Disposal of Construction Waste) Regulation for the payment of disposal charges. | Contract mobilization/ During construction | Contractor(s) | | ✓ | | Implemented | Cap 354N Waste Disposal (Charges for Disposal of Construction Waste) Regulation |
| S8.5 | A trip-ticket system will be established in accordance with DEVB TC(W) No. 6/2010 to monitor the reuse of surplus excavated materials off-site and disposal of construction waste and general refuse at transfer facilities/ landfills, and to control fly-tipping. | Contract mobilization/ During construction | Contractor(s) | | ✓ | | Implemented | DEVB TC(W) No. 6/2010, Trip Ticket System for Disposal of Construction & Demolition Materials |
| S8.5 | The project proponent will also conduct regular inspection of the waste management measures implemented on site as described in the Waste Management Plan. | All area/ During construction | Contractor(s)/ Environmental Team (ET) & Independent Environmental Checker (IEC) | | ✓ | | Implemented | ETWB TC(W) No. 19/2005, Environmental Management on Construction Sites |
| S8.5 | A recording system (similar to summary table as shown in Annex 5 and Annex 6 of Appendix G of ETWB TC(W) No. 19/2005) for the amount of waste generated, recycled and disposed of (including the disposal sites) will be established during the construction phase. | All area/ During construction | Contractor(s) | | ✓ | | Implemented | Annex 5 and Annex 6 of Appendix G of ETWB TC(W) No. 19/2005 |
| S8.5 | Inert C&D materials (public fill) will be reused within the Project as far as practicable. | All area/ During construction | Contractor(s) | | ✓ | | Implemented | - |
| S8.5 | Public fill and construction waste shall be segregated and stored in different containers or skips to facilitate reuse or recycling of materials and their proper disposal. | All area/ During construction | Contractor(s) | | ✓ | | Implemented | - |
| S8.5 | Specific areas of the work site will be designated for such segregation and storage if immediate use is not practicable. | All area/ During construction | Contractor(s) | | ✓ | | Implemented | - |
| S8.5 | To reduce the potential dust and water quality impacts of site formation works, C&D materials will be wetted as quickly as possible to the extent practice after filling. | All area/ During construction | Contractor(s) | | ✓ | | Implemented | Air Pollution Control (Construction Dust) Regulation (Cap 311R); WPCO (Cap 358) |

| EIA Reference | Recommended Environmental Protection Measures/ Mitigation Measures | Objectives of the recommended measures & main concerns to address | Implementation Agent | Implementation Stage | | | Implementation Status | Relevant Legislation & Guidelines |
|---------------|---|---|----------------------|----------------------|---|---|----------------------------|--|
| | | | | D | C | O | | |
| S8.5 | Open stockpiles of excavated/ fill materials or construction wastes on-site should be covered with tarpaulin or similar fabric. | Land site/ During Construction, particularly dry season | Contractor(s) | | ✓ | | Implemented | Air Pollution Control (Construction Dust) Regulation (Cap 311R) |
| S8.5 | Chemical waste container shall be suitable for the substance they are holding, resistant to corrosion, maintained in a good condition, and securely closed. | All area/ During construction/ During operation | Contractor(s)/ WSD | | ✓ | ✓ | Implemented | Waste Disposal (Chemical Waste) (General) Regulation; Code of Practice on the Packaging, Handling and Storage of Chemical Wastes |
| S8.5 | Chemical waste container shall have a capacity of less than 450 L unless the specifications have been approved by the EPD. | All area/ During construction/ During operation | Contractor(s)/ WSD | | ✓ | ✓ | Implemented | |
| S8.5 | A label in English and Chinese shall be displayed on the chemical container in accordance with instructions prescribed in Schedule 2 of the Regulations. | All area/ During construction/ During operation | Contractor(s)/ WSD | | ✓ | ✓ | Implemented | |
| S8.5 | Storage areas for chemical waste shall be enclosed on at least 3 sides. | All area/ During construction/ During operation | Contractor(s)/ WSD | | ✓ | ✓ | Implemented | |
| S8.5 | Storage areas for chemical waste shall have an impermeable floor and bunding, of capacity to accommodate 110% of the volume of the largest container or 20% by volume of the chemical waste stored in that area, whichever is the greatest. | All area/ During construction/ During operation | Contractor(s)/ WSD | | ✓ | ✓ | Implemented | |
| S8.5 | Storage areas for chemical waste shall have adequate ventilation. | All area/ During construction/ During operation | Contractor(s)/ WSD | | ✓ | ✓ | Implemented | |
| S8.5 | Storage areas for chemical waste shall be covered to prevent rainfall entering (water collected within the bund must be tested and disposed of as chemical waste, if necessary). | All area/ During construction/ During operation | Contractor(s)/ WSD | | ✓ | ✓ | Implemented | |
| S8.5 | Storage areas for chemical waste shall be arranged so that incompatible materials are appropriately separated. | All area/ During construction/ During operation | Contractor(s)/ WSD | | ✓ | ✓ | Implemented | |
| S8.5 | General refuse will be stored in enclosed bins or compaction units separately from construction and chemical wastes. | All area/ During construction/ During operation | Contractor(s)/ WSD | | ✓ | ✓ | Implemented after reminder | |
| S8.5 | Adequate number of waste containers will be provided to avoid over-spillage of waste. | All area/ During construction/ During operation | Contractor(s)/ WSD | | ✓ | ✓ | Implemented | |

| EIA Reference | Recommended Environmental Protection Measures/ Mitigation Measures | Objectives of the recommended measures & main concerns to address | Implementation Agent | Implementation Stage | | | Implementation Status | Relevant Legislation & Guidelines |
|---------------|--|---|----------------------|----------------------|---|---|-----------------------|---|
| | | | | D | C | O | | |
| S8.5 | A reputable waste collector will be employed by the Contractor to remove general refuse from the site, separately from construction and chemical wastes, on a daily basis to minimize odour, pest and litter impacts. | All area/ During construction/ During operation | Contractor(s)/ WSD | | ✓ | ✓ | Implemented | - |
| S8.5 | Recycling bins will be provided at strategic locations within the Site to facilitate recovery of recyclable materials (including aluminum can, wastepaper, glass bottles and plastic bottles) from the Site. Materials recovered will be sold for recycling. | All area/ During construction/ During operation | Contractor(s)/ WSD | | ✓ | ✓ | Implemented | - |
| S8.5 | To avoid any odour and litter impact, accurate number of portable toilets will be provided for workers on-site. | All area/ During construction | Contractor(s) | | ✓ | | Implemented | - |
| S8.5 | The burning of refuse on construction sites is prohibited by law. | All area/ During construction | Contractor(s) | | ✓ | | Implemented | Air Pollution Control Ordinance (Cap 311) |
| S8.7 | To facilitate monitoring and control over the contractors' performance on waste management, a waste inspection and audit programme will be implemented throughout the construction phase. | All facilities/ During construction | ET/ IEC | | ✓ | | Implemented | - |

Note: D – Design stage C – Construction O – Operation

| EIA Reference | Recommended Environmental Protection Measures/ Mitigation Measures | Objectives of the recommended measures & main concerns to address | Implementation Agent | Implementation Stage | | | Implementation Status | Relevant Legislation & Guidelines |
|----------------|--|---|----------------------|----------------------|---|---|-----------------------|-----------------------------------|
| | | | | D | C | O | | |
| Ecology | | | | | | | | |
| S9.7 | For slope mitigation works within the Clear Water Bay Country Park, to avoid tree felling and damages to trees, the exact locations of the flexible barrier foundation plates, soil nails and rock dowels can be adjusted during detailed design, and a setback distance from existing trees is recommended to be maintained as far as practical. A detailed specification describing the exact locations of the flexible barrier foundation plates, soil nails and rock dowels will be prepared to illustrate how the setback distance from existing trees would be implemented for tree avoidance. | Slope mitigation works area/ During detailed design/ During construction | Contractor(s) | ✓ | ✓ | | Implemented | - |
| S9.7 | Pruning of tree canopies along the alignment of the flexible barriers shall be limited to a minimum. | Slope mitigation works area/ During construction | Contractor(s) | | ✓ | | Implemented | - |
| S9.7 | The alignment of flexible barriers shall be optimized to preserve all species of conservation interest and minimize the impact to the existing vegetation as far as practicable. All individuals of <i>Marsdenia lachnostoma</i> within the slope mitigation areas shall be retained <i>in-situ</i> , by positioning the alignment of flexible barrier at a minimum 1.5m in a radius away from these individuals. | Slope mitigation works area/ During detailed design/ During construction | Contractor(s) | ✓ | ✓ | | Implemented | - |
| S9.7 and 9.10 | At the detailed design stage prior to the commencement of the slope mitigation works, a vegetation survey shall be carried out at the slope mitigation areas within the Clear Water Bay Country Park to assess the condition and identify the location of each individual of <i>Marsdenia lachnostoma</i> and other flora species of conservation interest that may be directly affected by the construction works. | Slope mitigation works area/ During detailed design/ During construction | Contractor(s) | ✓ | | | Implemented | - |
| S9.7 | Temporary fencing will be installed to fence off the concerned species either in groups of individually within the works area and in the close proximity to prevent from being damaged and disturbed during construction. A sign identifying the site shall be attached to the fence and flagging tape shall be attached to the individuals to visualize their locations. | Slope mitigation works area/ During construction | Contractor(s) | | ✓ | | Implemented | - |
| S9.7 and S9.10 | A specification for fencing and demarcating individuals of <i>Marsdenai lachnostoma</i> (or other flora species of conservation interest, if found) adjacent to the proposed alignment of the flexible barriers will be prepared to protect the species. | Slope mitigation works area/ During construction | Contractor(s) | | ✓ | | Implemented | - |
| S9.7 | Induction training shall also be provided to all site personnel in order to brief them on this flora of conservation interest including the locations and their importance. | Slope mitigation works area/ During construction | Contractor(s) | | ✓ | | Implemented | - |

| EIA Reference | Recommended Environmental Protection Measures/ Mitigation Measures | Objectives of the recommended measures & main concerns to address | Implementation Agent | Implementation Stage | | | Implementation Status | Relevant Legislation & Guidelines |
|---------------|---|---|----------------------|----------------------|---|---|-----------------------|-----------------------------------|
| | | | | D | C | O | | |
| S9.7 | The resident site supervisory staff will closely monitor the conditions of concerned individuals during construction of flexible barriers in the close proximity. | Slope mitigation works area/ During construction | Contractor(s) | | ✓ | | Implemented | - |
| S9.7 | Erect fences along the boundary of the works area before the commencement of works to prevent vehicle movements and encroachment of personnel onto adjacent areas. | All area/ During construction | Contractor(s) | | ✓ | | Implemented | - |
| S9.7 | Regularly check the work site boundaries to ensure that they are not breached, and that damage does not occur to surrounding areas. | All area/ During construction | Contractor(s)/ ET | | ✓ | | Implemented | - |
| S9.7 | Avoid any damage and disturbance, particularly those caused by filling and illegal dumping, to the surrounding habitats through proper management of waste disposal. | All area/ During construction | Contractor(s) | | ✓ | | Implemented | - |
| S9.7 | Reinstate temporarily affected areas, particularly the habitats of plantation and shrubland-grassland immediately after completion of construction works, through on-site tree/shrub planting. The tree/shrub species will be chosen with reference to those in the surrounding area. | All area/ During construction | Contractor(s) | | ✓ | | To be implemented | - |
| S9.7 | Affected habitats within the Clear Water Bay Country Bay shall be reinstated by hydro-seeding and planting of climbers and native shrub seedlings where practical upon completion of the slope mitigation works. | All area/ During construction | Contractor(s) | | ✓ | | To be implemented | - |

Note: D – Design stage C – Construction O – Operation

| EIA Reference | Recommended Environmental Protection Measures/ Mitigation Measures | Objectives of the recommended measures & main concerns to address | Implementation Agent | Implementation Stage | | | Implementation Status | Relevant Legislation & Guidelines |
|-------------------------------|--|---|----------------------|----------------------|---|---|-----------------------|---|
| | | | | D | C | O | | |
| Landscape & Visual | | | | | | | | |
| S11.10 & 11.11 | The construction area and area allowed for temporary structures, such as the contractor's office, will be minimized to a practical minimum. (MM1) | All area/ Detailed design/ During construction/ During operation | WSD/ Contractor(s) | ✓ | ✓ | ✓ | Implemented | - |
| S11.10 & 11.11 | At the detailed design stage, the design team will seek to minimize the landscape footprint of the Project and above ground facilities, while satisfying all other requirements. (MM2) | All area/ Detailed design/ During construction/ During operation | WSD/ Contractor(s) | ✓ | ✓ | ✓ | Implemented | - |
| S11.10 & 11.11 | Design principles will be adopted to take into account the surrounding area, particularly Clear Water Bay Country Park behind and the nearby waterfront, with due consideration given to: - green roofs where practical (i.e. without equipment on the roof); - roadside planting; - aesthetic treatment of all structures; - vertical greening; - screen planting along application site; and - landscape enhancement with amenity planting where practical including planting along the edge (site boundary) fence with native shrubs where feasible, to reduce their visual impact and blend them into the surrounding landscape. (MM3) | All area/ Detailed design/ During construction/ During operation | WSD/ Contractor(s) | ✓ | ✓ | ✓ | Implemented | - |
| S11.10 & 11.11 | All trees within the Project Site or the potential slope mitigation works area will be carefully protected during construction according to DEVB TCW No. 10/2013 – Tree Preservation (MM4) | All area/ Detailed design/ During construction/ During operation | WSD/ Contractor(s) | ✓ | ✓ | ✓ | Implemented | ETWB TCW No. 3/2006 - Tree Preservation. |
| S11.10 & 11.11 | No tree within the Country Park will be felled. Trees within the Site unavoidably affected by the works will be transplanted where necessary and practical. For trees that need to be felled, compensatory planting will be provided to the satisfaction of relevant Government departments. A compensatory tree planting proposal including locations of tree compensation will be submitted to seek relevant government department's approval, in accordance with DEVB TC(W) No. 10/2013. (MM5) | All area/ Detailed design/ During construction/ During operation | WSD/ Contractor(s) | ✓ | ✓ | ✓ | Implemented | DEVB TC(W) No. 10/2013 |
| S11.10 & 11.11 | Any slope mitigation works necessary to address natural terrain hazards, will be minimized to minimize any potential environmental impact to the Country Park e.g. soil nailing and rock stabilization will aim to avoid existing trees e.g. should any restoration of vegetation be necessary, the best planting matrix with native species will be established, with the aim of resembling the existing vegetation. (MM6) | All area/ Detailed design/ During construction/ During operation | WSD/ Contractor(s) | ✓ | ✓ | ✓ | Implemented | |

| EIA Reference | Recommended Environmental Protection Measures/ Mitigation Measures | Objectives of the recommended measures & main concerns to address | Implementation Agent | Implementation Stage | | | Implementation Status | Relevant Legislation & Guidelines |
|----------------|--|---|----------------------|----------------------|---|---|-----------------------|-----------------------------------|
| | | | | D | C | O | | |
| S11.10 & 11.11 | Dredging works for the installation of intake structures and outfall diffusers should be minimized to avoid or reduce any potential environmental impacts to as low as reasonably practicable (ALARP). The intake and outfall structures (e.g. intake openings and diffuser heads) will be prefabricated and transferred to site for installation. (MM7) | All area/ Detailed design/ During construction/ During operation | WSD/ Contractor(s) | ✓ | ✓ | ✓ | Implemented | |
| S11.10 & 11.11 | All night-time lighting will be reduced to a practical minimum both in terms of number of level and will be hooded and directional. (MM8) units and lux level and will be hooded and directional. (MM8) | All area/ Detailed design/ During construction/ During operation | WSD/ Contractor(s) | ✓ | ✓ | ✓ | Implemented | - |

Note: D – Design stage C – Construction O – Operation

| EIA Reference | Recommended Environmental Protection Measures/ Mitigation Measures | Objectives of the recommended measures & main concerns to address | Implementation Agent | Implementation Stage | | | Implementation Status | Relevant Legislation & Guidelines |
|----------------------------|--|---|----------------------|----------------------|---|---|-----------------------|-----------------------------------|
| | | | | D | C | O | | |
| Landfill Gas Hazard | | | | | | | | |
| S12.7 | During all works, safety procedures should be implemented to minimize the risks of fires and explosions, asphyxiation of workers and toxicity effects resulting from contact with contaminated soil and groundwater. | All area/ Detailed design/ During construction/operation | Contractor(s) | ✓ | ✓ | ✓ | Implemented | - |
| S12.7 | During trenching and excavation as well as creation of confined spaces at near to or below ground level, precautions should be clearly laid down and rigidly Gas detection equipment and appropriate breathing apparatus should be available and used when entering confined spaces or trenches deeper than 1 meter. | All area/ Detailed design/ During construction/operation | Contractor(s) | ✓ | ✓ | ✓ | Implemented | |
| S12.7 | The Contractor should make the workers are aware of potential hazards of working in confined spaces (any chamber, manhole or culvert which is large enough to permit access to personnel). Such work in confined spaces is controlled by the Factories and Industrial Undertakings (Confined Spaces) Regulations of the Factories and Industrial Undertakings Ordinance. Following the Safety Guide to Working in Confined Spaces ensures compliance with the above regulations. | All area/ Detailed design/ During construction/operation | Contractor(s) | ✓ | ✓ | ✓ | Implemented | |
| S12.7 | Safety officers, specifically trained with regard to landfill gas and leachate related hazards and the appropriate actions to take in adverse circumstances, should be present on the site throughout the works, in particular, when works are undertaken below grade. | All area/ Detailed design/ During construction/operation | Contractor(s) | ✓ | ✓ | ✓ | Implemented | |
| S12.7 | All personnel who work on site and all visitors to the site should be made aware of the possibility of ignition of gas in the vicinity of the works, the possible presence of contaminated water and the need to avoid physical contact with it. | All area/ Detailed design/ During construction/operation | Contractor(s) | ✓ | ✓ | ✓ | Implemented | |
| S12.7 | Monitoring for landfill gas should be undertaken in all excavations, manholes, chambers (particularly during pipe jacking) and any confined spaces through the use of an intrinsically safe portable instrument, appropriately calibrated and capable of measuring the concentrations of methane. carbon dioxide and oxygen. | All area/ Detailed design/ During construction/operation | Contractor(s) | ✓ | ✓ | ✓ | Implemented | |
| S12.7 | Monitoring frequency and areas to be monitored should be specified prior to commencement of groundwork, either by the Safety Officer, or by an appropriately qualified person. All measurements should be recorded and documented. | All area/ Detailed design/ During construction/operation | Contractor(s) | ✓ | ✓ | ✓ | Implemented | |
| S12.7 | Proceed drilling with adequate care and precautions against the potential hazards which may be encountered. | All area/ Detailed design/ During construction/operation | Contractor(s) | ✓ | ✓ | ✓ | Implemented | |

| EIA Reference | Recommended Environmental Protection Measures/ Mitigation Measures | Objectives of the recommended measures & main concerns to address | Implementation Agent | Implementation Stage | | | Implementation Status | Relevant Legislation & Guidelines |
|---------------|---|---|----------------------|----------------------|---|---|-----------------------|-----------------------------------|
| | | | | D | C | O | | |
| S12.7 | Prior to the commencement of the site works, the drilling contractor should devise a 'method-of- working' statement covering all normal and emergency procedures (including but not limited to number of operatives, experience and special skills of operatives, normal method of operations, emergency procedures, supervisors responsibilities, storage and use of safety equipment, safety procedures and signs, barriers and guarding). The site supervisor and all operatives must be familiar with this statement. | All area/ During construction/operation | Contractor(s) | ✓ | ✓ | ✓ | Implemented | |
| S12.7 | Where below ground service entries are necessary to the Incoming Switchgear Room, 132 kV Substation and Chlorine Store (I) and (II), the entry point should be sealed to prevent gas entry. In addition, any below grade cable trenches entering the Incoming Switchgear Room and 132 kV Substation can become the pathway for landfill gas and hence grilled metal covers should be used. | All area/ Detailed design/ During construction/operation | Contractor(s) | ✓ | ✓ | ✓ | N/A | |
| S12.7 | It is recommended regular landfill gas monitoring should be carried out at the Incoming Switchgear Room, 132 kV Substation and Chlorine Store (I) and (II). The monitoring frequency will be monthly for the first year of operation. If the monitoring results show no sign of landfill gas migration, reduce the monitoring frequency to once every six months. | All area/ Detailed design/ During construction/operation | Contractor(s) | ✓ | ✓ | ✓ | N/A | |
| S12.7 | The manholes and utility pits within the Project Site and along the fresh water mains. Each manhole/ utility pit should be monitored with two measurements (at mid depth and base). Each measurement should be monitored for a minimum of 10 minutes. A steady reading and peak reading should be recorded at each manhole/ utility pit and for each measurement. The need for venting the manhole/ utility pit and further monitoring will be reviewed after the initial monitoring. | All area/ Detailed design/ During construction/operation | Contractor(s) | ✓ | ✓ | ✓ | Implemented | |
| S12.7 | All construction, operation and maintenance personnel working on-site as well as visitors should be made aware of the hazards of landfill gas and its possible presence on-site. This should be achieved through a combination of posting warning signs in prominent places and also by access to detailed information on landfill gas hazards and the designs and procedural means by which these hazards are being minimized on-site. | All area/ Detailed design/ During construction/operation | Contractor(s) | ✓ | ✓ | ✓ | Implemented | |

Note: D – Design stage C – Construction O – Operation

Appendix D

Impact Monitoring Schedule

Contract No. 13/WSD/17
Design, Build and Operate First Stage of Tseung Kwan O Desalination Plant
Water Quality Monitoring Schedule (July 2023)

| Sun | Mon | Tue | Wed | Thu | Fri | Sat |
|---|-----|---|-----|---|-----|---|
| | | | | | | 1 Impact Water Quality monitoring for CE, CF, WSR1, WSR2, WSR3, WSR4, WSR16, WSR33, WSR36, WSR37 <u>Tidal Period:</u> Ebb Tide: 06:30-14:12 Flood Tide: 14:12-21:15 <u>Monitoring Time:</u> Mid-ebb: 09:00-11:00 Mid-flood: 16:00-18:00 |
| 2 | 3 | 4 Impact Water Quality monitoring for CE, CF, WSR1, WSR2, WSR3, WSR4, WSR16, WSR33, WSR36, WSR37 <u>Tidal Period:</u> Ebb Tide: 08:48-16:36 Flood Tide: 16:36-23:47 <u>Monitoring Time:</u> Mid-ebb: 09:00-11:00 Mid-flood: 17:00-19:00 | 5 | 6 Impact Water Quality monitoring for CE, CF, WSR1, WSR2, WSR3, WSR4, WSR16, WSR33, WSR36, WSR37 <u>Tidal Period:</u> Ebb Tide: 10:56-19:29 Flood Tide: 05:41-12:55 <u>Monitoring Time:</u> Mid-ebb: 11:00-13:00 Mid-flood: 09:00-11:00 | 7 | 8 Impact Water Quality monitoring for CE, CF, WSR1, WSR2, WSR3, WSR4, WSR16, WSR33, WSR36, WSR37 <u>Tidal Period:</u> Ebb Tide: 12:55-19:29 Flood Tide: 05:41-12:55 <u>Monitoring Time:</u> Mid-ebb: 13:00-15:00 Mid-flood: 09:00-11:00 |
| 9 | 10 | 11 Impact Water Quality monitoring for CE, CF, WSR1, WSR2, WSR3, WSR4, WSR16, WSR33, WSR36, WSR37 <u>Tidal Period:</u> Ebb Tide: 05:00-10:00 Flood Tide: 11:00-16:28 <u>Monitoring Time:</u> Mid-ebb: 08:00-10:00 Mid-flood: 13:00-15:00 | 12 | 13 Impact Water Quality monitoring for CE, CF, WSR1, WSR2, WSR3, WSR4, WSR16, WSR33, WSR36, WSR37 <u>Tidal Period:</u> Ebb Tide: 06:00-12:46 Flood Tide: 12:46-18:00 <u>Monitoring Time:</u> Mid-ebb: 09:00-11:00 Mid-flood: 14:00-16:00 | 14 | 15 Impact Water Quality monitoring for CE, CF, WSR1, WSR2, WSR3, WSR4, WSR16, WSR33, WSR36, WSR37 <u>Tidal Period:</u> Ebb Tide: 08:00-15:00 Flood Tide: 15:00-21:00 <u>Monitoring Time:</u> Mid-ebb: 09:00-11:00 Mid-flood: 16:00-18:00 |
| 16 | 17 | 18 Impact Water Quality monitoring for CE, CF, WSR1, WSR2, WSR3, WSR4, WSR16, WSR33, WSR36, WSR37 <u>Tidal Period:</u> Ebb Tide: 09:03-16:36 Flood Tide: 16:36-23:29 <u>Monitoring Time:</u> Mid-ebb: 09:30-11:30 Mid-flood: 17:00-19:00 | 19 | 20 Impact Water Quality monitoring for CE, CF, WSR1, WSR2, WSR3, WSR4, WSR16, WSR33, WSR36, WSR37 <u>Tidal Period:</u> Ebb Tide: 10:13-17:39 Flood Tide: 02:55-10:13 <u>Monitoring Time:</u> Mid-ebb: 13:00-15:00 Mid-flood: 08:00-10:00 | 21 | 22 Impact Water Quality monitoring for CE, CF, WSR1, WSR2, WSR3, WSR4, WSR16, WSR33, WSR36, WSR37 <u>Tidal Period:</u> Ebb Tide: 11:07-18:35 Flood Tide: 04:34-11:07 <u>Monitoring Time:</u> Mid-ebb: 12:00-14:00 Mid-flood: 09:00-11:00 |
| 23 | 24 | 25 Impact Water Quality monitoring for CE, CF, WSR1, WSR2, WSR3, WSR4, WSR16, WSR33, WSR36, WSR37 <u>Tidal Period:</u> Ebb Tide: 12:38-20:04 Flood Tide: 07:25-12:38 <u>Monitoring Time:</u> Mid-ebb: 13:00-15:00 Mid-flood: 09:00-11:00 | 26 | 27 Impact Water Quality monitoring for CE, CF, WSR1, WSR2, WSR3, WSR4, WSR16, WSR33, WSR36, WSR37 <u>Tidal Period:</u> Ebb Tide: 03:54-10:25 Flood Tide: 10:25-17:25 <u>Monitoring Time:</u> Mid-ebb: 08:00-10:00 Mid-flood: 13:00-15:00 | 28 | 29 Impact Water Quality monitoring for CE, CF, WSR1, WSR2, WSR3, WSR4, WSR16, WSR33, WSR36, WSR37 <u>Tidal Period:</u> Ebb Tide: 05:08-13:28 Flood Tide: 13:28-23:59 <u>Monitoring Time:</u> Mid-ebb: 09:00-11:00 Mid-flood: 15:00-17:00 |
| 30 | 31 | | | | | |
| Remarks: 1. Monitoring Parameters: Dissolved oxygen, Temperature, pH, Turbidity, Salinity, Suspended Solids Note: - Due to safety concern of vessel transportation earlier than 0700, Water Quality Monitoring would start at 0800. - Prioritized routing: Mid-Ebb: CE→WSR16→WSR37→WSR36→WSR33→Remaining stations and Mid-Flood: CF→WSR1→WSR2→WSR3→WSR4→Remaining stations - Due to storm Signal No. 8 in force on 17 July 2023, the water quality monitoring scheduled on 17 July 2023 was rescheduled to 18 July 2023. | | | | | | |

Contract No. 13/WSD/17
Design, Build and Operate First Stage of Tseung Kwan O Desalination Plant
Tentative Water Quality Monitoring Schedule (August 2023)

| Sun | Mon | Tue | Wed | Thu | Fri | Sat |
|--|-----|---|-----|---|-----|---|
| | | 1 Impact Water Quality monitoring for CE, CF, WSR1, WSR2, WSR3, WSR4, WSR16, WSR33, WSR36, WSR37 <u>Tidal Period:</u> Ebb Tide: 07:38-15:40 Flood Tide: 15:40-22:48 <u>Monitoring Time:</u> Mid-ebb: 09:00-11:00 Mid-flood: 16:00-18:00 | 2 | 3 Impact Water Quality monitoring for CE, CF, WSR1, WSR2, WSR3, WSR4, WSR16, WSR33, WSR36, WSR37 <u>Tidal Period:</u> Ebb Tide: 09:55-16:58 Flood Tide: 03:00-09:55 <u>Monitoring Time:</u> Mid-ebb: 11:00-13:00 Mid-flood: 08:00-09:55 | 4 | 5 Impact Water Quality monitoring for CE, CF, WSR1, WSR2, WSR3, WSR4, WSR16, WSR33, WSR36, WSR37 <u>Tidal Period:</u> Ebb Tide: 11:50-18:06 Flood Tide: 04:49-11:50 <u>Monitoring Time:</u> Mid-ebb: 13:00-15:00 Mid-flood: 08:00-10:00 |
| 6 | 7 | 8 Impact Water Quality monitoring for CE, CF, WSR1, WSR2, WSR3, WSR4, WSR16, WSR33, WSR36, WSR37 <u>Tidal Period:</u> Ebb Tide: 14:54-19:33 Flood Tide: 07:53-14:54 <u>Monitoring Time:</u> Mid-ebb: 16:00-18:00 Mid-flood: 09:00-11:00 | 9 | 10 Impact Water Quality monitoring for CE, CF, WSR1, WSR2, WSR3, WSR4, WSR16, WSR33, WSR36, WSR37 <u>Tidal Period:</u> Ebb Tide: 04:30-11:53 Flood Tide: 11:53-23:59 <u>Monitoring Time:</u> Mid-ebb: 08:00-10:00 Mid-flood: 12:00-14:00 | 11 | 12 Impact Water Quality monitoring for CE, CF, WSR1, WSR2, WSR3, WSR4, WSR16, WSR33, WSR36, WSR37 <u>Tidal Period:</u> Ebb Tide: 06:10-13:58 Flood Tide: 13:58-23:59 <u>Monitoring Time:</u> Mid-ebb: 09:00-11:00 Mid-flood: 15:00-17:00 |
| 13 | 14 | 15 Impact Water Quality monitoring for CE, CF, WSR1, WSR2, WSR3, WSR4, WSR16, WSR33, WSR36, WSR37 <u>Tidal Period:</u> Ebb Tide: 08:13-15:37 Flood Tide: 15:37-22:33 <u>Monitoring Time:</u> Mid-ebb: 09:00-11:00 Mid-flood: 16:00-18:00 | 16 | 17 Impact Water Quality monitoring for CE, CF, WSR1, WSR2, WSR3, WSR4, WSR16, WSR33, WSR36, WSR37 <u>Tidal Period:</u> Ebb Tide: 09:31-16:33 Flood Tide: 16:33-23:11 <u>Monitoring Time:</u> Mid-ebb: 10:00-12:00 Mid-flood: 17:00-19:00 | 18 | 19 Impact Water Quality monitoring for CE, CF, WSR1, WSR2, WSR3, WSR4, WSR16, WSR33, WSR36, WSR37 <u>Tidal Period:</u> Ebb Tide: 10:46-17:20 Flood Tide: 03:59-10:46 <u>Monitoring Time:</u> Mid-ebb: 11:00-13:00 Mid-flood: 08:00-10:00 |
| 20 | 21 | 22 Impact Water Quality monitoring for CE, CF, WSR1, WSR2, WSR3, WSR4, WSR16, WSR33, WSR36, WSR37 <u>Tidal Period:</u> Ebb Tide: 12:49-18:33 Flood Tide: 06:15-12:49 <u>Monitoring Time:</u> Mid-ebb: 13:00-15:00 Mid-flood: 08:00-10:00 | 23 | 24 Impact Water Quality monitoring for CE, CF, WSR1, WSR2, WSR3, WSR4, WSR16, WSR33, WSR36, WSR37 <u>Tidal Period:</u> Ebb Tide: 15:29-19:11 Flood Tide: 08:24-15:29 <u>Monitoring Time:</u> Mid-ebb: 16:00-18:00 Mid-flood: 10:00-12:00 | 25 | 26 Impact Water Quality monitoring for CE, CF, WSR1, WSR2, WSR3, WSR4, WSR16, WSR33, WSR36, WSR37 <u>Tidal Period:</u> Ebb Tide: 03:35-12:49 Flood Tide: 12:49-23:59 <u>Monitoring Time:</u> Mid-ebb: 09:00-11:00 Mid-flood: 14:00-16:00 |
| 27 | 28 | 29 Impact Water Quality monitoring for CE, CF, WSR1, WSR2, WSR3, WSR4, WSR16, WSR33, WSR36, WSR37 <u>Tidal Period:</u> Ebb Tide: 06:34-14:39 Flood Tide: 14:39-21:48 <u>Monitoring Time:</u> Mid-ebb: 11:00-13:00 Mid-flood: 15:00-17:00 | 30 | 31 Impact Water Quality monitoring for CE, CF, WSR1, WSR2, WSR3, WSR4, WSR16, WSR33, WSR36, WSR37 <u>Tidal Period:</u> Ebb Tide: 08:53-15:48 Flood Tide: 15:48-22:43 <u>Monitoring Time:</u> Mid-ebb: 10:00-12:00 Mid-flood: 16:00-18:00 | | |
| <p>Remarks: 1. Monitoring Parameters: Dissolved oxygen, Temperature, pH, Turbidity, Salinity, Suspended Solids</p> <p>Note: - Due to safety concern of vessel transportation earlier than 0700, Water Quality Monitoring would start at 0800. - Prioritized routing: Mid-Ebb: CE→WSR16→WSR37→WSR36→WSR33→Remaining stations and Mid-Flood: CF→WSR1→WSR2→WSR3→WSR4→Remaining stations</p> | | | | | | |

Appendix E

Event / Action Plan

Table E1 Event and Action Plan for Construction Noise Monitoring

| Event | Action | | | |
|--------------|---|---|--|---|
| | ET | IEC | ER | Contractor |
| Action Level | <ol style="list-style-type: none"> 1. Carry out investigation to identify the source and cause of the complaint/ exceedance(s) 2. Notify IEC, ER, and Contractor and report the results of investigation to the Contractor, ER and the IEC 3. Discuss with the Contractor and IEC for remedial measures required 4. If the complaint is related to the Project, conduct additional monitoring for checking mitigation effectiveness and report the findings and results to the IEC, ER and the Contractor | <ol style="list-style-type: none"> 1. Review the analyzed results submitted by the ET 2. Review the proposed remedial measures by the Contractor and advise the ER accordingly 3. Supervise the implementation of remedial measures | <ol style="list-style-type: none"> 1. Confirm receipt of Notification of Exceedance in writing 2. Require Contractor to propose remedial measures for the analysed noise problem 3. Ensure remedial measures are properly implemented | <ol style="list-style-type: none"> 1. Submit noise mitigation proposals, if required, to the IEC and ER 2. Implement noise mitigation proposals. |
| Limit Level | <ol style="list-style-type: none"> 1. Carry out investigation to identify the source and cause of the exceedance 2. Notify IEC, ER, Project Proponent, EPD and Contractor 3. Repeat measurements to confirm findings 4. Provide investigation report to IEC, ER, EPD and Contractor he causes of the exceedances 5. If the exceedance is related to the Project, assess effectiveness by additional monitoring. 6. Report the remedial action implemented and the additional monitoring results to IEC, EPD, ER and Contractor 7. If exceedance stops, cease additional monitoring | <ol style="list-style-type: none"> 1. Review the analyzed results submitted by the ET 2. Discuss the potential remedial measures with ER, ET Leader and Contractor 3. Review Contractors remedial actions whenever necessary to assure their effectiveness and advise the ER accordingly 4. Supervise the implementation of remedial measures | <ol style="list-style-type: none"> 1. Confirm receipt of Notification of Exceedance in writing 2. Require the Contractor to propose remedial measures for the analysed noise problem 3. Ensure remedial measures are properly implemented 4. If exceedance continues, consider what activity of the work is responsible and instruct the Contractor, in agreement with the Project Proponent, to stop that activity of work until the exceedance is abated | <ol style="list-style-type: none"> 1. Take immediate action to avoid further exceedance 2. Submit proposals for remedial actions to IEC and ER within 3 working days of notification 3. Implement the agreed proposals 4. Resubmit proposals if problem still not under control 5. Stop the relevant activity of works as determined by the Project Proponent until the exceedance is abated |

Notes : ET = Environmental Team, IEC = Independent Environmental Checker; ER = Engineering Representatives

Table E2 Event and Action Plan for Water Quality Monitoring

| Event | Action ET | IEC | Contractor(s) | ER |
|--|--|---|--|--|
| Action Level being exceeded by one sampling day | <ol style="list-style-type: none"> Repeat <i>in situ</i> measurement on the next day of exceedance to confirm findings; Check monitoring data, plant, equipment and Contractor(s)'s working methods; Identify source(s) of impact and record in notification of exceedance; Inform IEC, Contractor(s) and ER. | <ol style="list-style-type: none"> Check monitoring data submitted by ET and Contractor(s)'s working methods; Inform EPD. | <ol style="list-style-type: none"> Confirm receipt of notification of exceedance in writing; Check plant and equipment and rectify unacceptable practice | <ol style="list-style-type: none"> Confirm receipt of notification of exceedance in writing. |
| Action Level being exceeded by two or more consecutive sampling days | <ol style="list-style-type: none"> Repeat <i>in situ</i> measurement on the next day of exceedance to confirm findings; Check monitoring data, plant, equipment and Contractor(s)'s working methods; Identify source(s) of impact and record in notification of exceedance; Inform IEC, Contractor(s) and ER; Discuss with IEC and Contractor(s) on additional mitigation measures and ensure that they are implemented | <ol style="list-style-type: none"> Check monitoring data submitted by ET and Contractor(s)'s working methods; Inform EPD; Discuss with ET and Contractor(s) on additional mitigation measures and advise ER accordingly; Assess the effectiveness of the implemented mitigation measures. | <ol style="list-style-type: none"> Confirm receipt of notification of exceedance in writing; Check plant and equipment and rectify unacceptable practice; Consider changes of working methods; Discuss with ET and IEC on additional mitigation measures and propose them to ER within 3 working days; Implement the agreed mitigation measures. | <ol style="list-style-type: none"> Confirm receipt of notification of exceedance in writing; Discuss with the IEC on the proposed additional mitigation measures and agree on the mitigation measures to be implemented. Ensure additional mitigation measures are properly implemented. |
| Limit Level being exceeded by one sampling day | <ol style="list-style-type: none"> Repeat <i>in situ</i> measurement on the next day of exceedance to confirm findings; Check monitoring data, plant, equipment and Contractor(s)'s working methods; Identify source(s) of impact and record in notification of exceedance; Inform IEC, Contractor(s) and ER; Discuss with IEC and Contractor(s) on additional mitigation measures and ensure that they are implemented | <ol style="list-style-type: none"> Check monitoring data submitted by ET and Contractor(s)'s working methods; Inform EPD; Discuss with ET and Contractor(s) on additional mitigation measures and advise ER accordingly; Assess the effectiveness of the implemented mitigation measures. | <ol style="list-style-type: none"> Confirm receipt of notification of exceedance in writing; Check plant and equipment and rectify unacceptable practice; Critically review the need to change working methods; Discuss with ET and IEC on additional mitigation measures and propose them to ER within 3 working days; Implement the agreed mitigation measures. | <ol style="list-style-type: none"> Confirm receipt of notification of exceedance in writing; Discuss with the IEC on the proposed additional mitigation measures and agree on the mitigation measures to be implemented. Ensure additional mitigation measures are properly implemented. Request Contractor(s) to critically review the working methods. |
| Limit Level being exceeded by two or more consecutive sampling days | <ol style="list-style-type: none"> Repeat <i>in situ</i> measurement on the next day of exceedance to confirm findings; Check monitoring data, plant, equipment and Contractor(s)'s working methods; Identify source(s) of impact and record in notification of exceedance; Inform IEC, Contractor(s) and ER; Discuss with IEC and Contractor(s) on additional mitigation measures and ensure that they are implemented | <ol style="list-style-type: none"> Check monitoring data submitted by ET and Contractor(s)'s working methods; Inform EPD; Discuss with ET and Contractor(s) on additional mitigation measures and advise ER accordingly; Assess the effectiveness of the implemented mitigation measures. | <ol style="list-style-type: none"> Confirm receipt of notification of exceedance in writing; Check plant and equipment and rectify unacceptable practice; Critically review the need to change working methods; Discuss with ET and IEC on additional mitigation measures and propose them to ER within 3 working days; Implement the agreed mitigation measures. As directed by ER, slow down or stop all or part of the marine construction works/ production volume of the desalination plant until no exceedance of Limit Level. | <ol style="list-style-type: none"> Confirm receipt of notification of exceedance in writing; Discuss with the IEC on the proposed additional mitigation measures and agree on the mitigation measures to be implemented. Ensure additional mitigation measures are properly implemented. Request Contractor(s) to critically review the working methods; Consider and instruct, if necessary, the Contractor(s) to slow down or to stop all or part of the marine construction works/ production volume of the desalination plant until no exceedance of Limit Level. |

Notes : ET = Environmental Team, IEC = Independent Environmental Checker; ER = Engineering Representatives
The above actions should be taken within 1 working day after the exceedance is identified during operation phase.

Table E2 Event and Action Plan for Ecology during Construction Phase

| Event | Action | | | |
|--------------------------------|---|--|---|--|
| | ET | IEC | Contractor(s) | ER |
| Non-conformity on one occasion | 1. Identify source | 1. Check monitoring/ auditing results | 1. Take immediate action to avoid further problem | 1. Notify Contractor |
| | 2. Inform IEC and ER | 2. Check the Contractor's working method | 2. Amend working methods if needed | 2. Ensure remedial measures are properly implemented |
| | 3. Discuss remedial actions with IEC, the ER and the Contractor | 3. Discuss with the ET and Contractor on possible remedial measures | 3. Submit proposals for remedial actions to ET, ER and IEC | 3. Consider and instruct, if necessary, the Contractor to slow down or to stop all or part of the works in case of serious non-conformity until situation is rectified |
| | 4. Monitor/ audit/ review remedial actions until rectification has been completed | 4. Advise the ER on effectiveness of proposed remedial measures | 4. Rectify damage and implement the agreed remedial actions | |
| | | 5. Check the implementation of remedial measures | | |
| Repeated Non-conformity | 1. Identify source | 1. Check monitoring/ auditing results | 1. Take immediate action to avoid further problem | 1. Notify Contractor |
| | 2. Inform IEC, ER, EPD and AFCD | 2. Check the Contractor's working method | 2. Amend working methods if needed | 2. Ensure remedial measures are properly implemented |
| | 3. Increase monitoring and audit frequency | 3. Discuss with the ET and Contractor on possible remedial measures | 3. Submit proposals for remedial actions to ET, ER and IEC | 3. Consider and instruct, if necessary, the Contractor to slow down or to stop all or part of the works in the case of serious non-conformity until situation is rectified |
| | 4. Discuss remedial actions with the IEC, the ER and the Contractor | 4. Supervise the implementation of remedial measures | 4. Rectify damage and implement the agreed remedial actions | |
| | 5. Monitor/ audit/ review remedial actions until rectification has been completed | 5. Advise the ER on effectiveness of proposed remedial measures and keep EPD and AFCD informed | | |
| | 6. If non-conformity stops, cease additional monitoring/ auditing | | | |

Notes : ET = Environmental Team, IEC = Independent Environmental Checker; ER = Engineering Representatives

Appendix F

Water Quality and Landfill Gas Equipment Calibration Certification



專業化驗有限公司
QUALITY PRO TEST-CONSULT LIMITED

Unit 10, 5/F, Wah Wai Centre, 38-40 Au Pui Wan St., Fotan, Hong Kong
Email: info@qualityprotest.com; Website: www.qualityprotest.com
Tel: (852) 3956 8717; Fax: (852) 3956 3928

REPORT OF EQUIPMENT PERFORMANCE CHECK/ CALIBRATION

Test Report No. : R-BC060078
Date of Issue : 21 June 2023
Page No. : 1 of 2

PART A - CUSTOMER INFORMATION

Acuity Sustainability Consulting Limited
Unit E, 12/F, Ford Glory Plaza 37-39 Wing Hong Street, Cheung Sha Wan, Kowloon, Hong Kong

PART B - SAMPLE INFORMATION

Name of Equipment : YSI ProDSS (Multi-Parameters)
Manufacturer : YSI (a xylem brand)
Serial Number : 22D100436
Date of Received : 19 June 2023
Date of Calibration : 19 June 2023
Date of Next Calibration : 18 September 2023
Request No. : D-BC060078

PART C - REFERENCE METHODS/ DOCUMENTS FOR THE CALIBRATION

| Test Parameter | Reference Method |
|------------------|---|
| pH value | APHA 21e 4500 H ⁺ |
| Temperature | Section 6 of international Accreditation New Zealand Technical Guide no. 3 Second edition March 2008: Working Thermometer Calibration Procedure |
| Salinity | APHA 21e 2520 B |
| Dissolved oxygen | APHA 21e 4500 O |
| Turbidity | APHA 21e 2130 B |

PART D - CALIBRATION RESULT

(1) pH value

| Target (pH unit) | Display Reading (pH unit) | Tolerance | Result |
|------------------|---------------------------|-----------|--------------|
| 4.00 | 4.11 | 0.11 | Satisfactory |
| 7.42 | 7.43 | 0.01 | Satisfactory |
| 10.01 | 9.99 | -0.02 | Satisfactory |

Tolerance of pH value should be less than ± 0.2 (pH unit)

(2) Temperature

| Reading of Ref. thermometer (°C) | Display Reading (°C) | Tolerance | Result |
|----------------------------------|----------------------|-----------|--------------|
| 36 | 35.8 | -0.2 | Satisfactory |
| 26 | 25.1 | -0.9 | Satisfactory |
| 17 | 16.8 | -0.2 | Satisfactory |

Tolerance of Temperature should be less than ± 2.0 (°C)


(3) Salinity


| Expected Reading (g/L) | Display Reading (g/L) | Tolerance (%) | Result |
|------------------------|-----------------------|---------------|--------------|
| 10 | 9.36 | -6.40 | Satisfactory |
| 20 | 19.09 | -4.55 | Satisfactory |
| 30 | 29.55 | -1.50 | Satisfactory |

Tolerance of Salinity should be less than ± 10.0 (%)

--- CONTINUED ON NEXT PAGE ---

AUTHORIZED
SIGNATORY:


LEE Chun-ning
Assistant Manager (Chemical Testing)



REPORT OF EQUIPMENT PERFORMANCE CHECK/ CALIBRATION

Test Report No. : R-BC060078
Date of Issue : 21 June 2023
Page No. : 2 of 2

(4) Dissolved oxygen

| Expected Reading (mg/L) | Display Reading (mg/L) | Tolerance | Result |
|---------------------------|--------------------------|-----------|--------------|
| 7.84 | 8.11 | 0.27 | Satisfactory |
| 6.87 | 6.71 | -0.16 | Satisfactory |
| 4.89 | 4.36 | -0.53 | Satisfactory |
| 1.00 | 0.96 | -0.04 | Satisfactory |

Tolerance of Dissolved oxygen should be less than ± 0.5 (mg/L)

(5) Turbidity

| Expected Reading (NTU) | Display Reading (NTU) | Tolerance (%) | Result |
|--------------------------|-------------------------|-----------------|--------------|
| 0 | 0.10 | -- | Satisfactory |
| 10 | 9.91 | -0.90 | Satisfactory |
| 20 | 20.09 | 0.40 | Satisfactory |
| 100 | 105.37 | 5.40 | Satisfactory |
| 800 | 799.11 | -0.10 | Satisfactory |

Tolerance of Turbidity should be less than ± 10.0 (%)

Remark(s)

- The "Date of Next Calibration" is recommended according to best practice principals as practiced by QPT or quoted form relevant international standards.
- The results relate only to the calibrated equipment as received
- The performance of the equipment stated in this report is checked with independent reference material and results compared against a calibrated secondary source.
- "Displayed Reading" denotes the figure shown on item under calibration/ checking regardless of equipment precision or significant figures.
- The "Tolerance Limit" mentioned is the acceptance criteria applicable for similar equipment used by Quality Pro Test-Consult Ltd. or quoted form relevant international standards.

--- END OF REPORT ---



專業化驗有限公司

QUALITY PRO TEST-CONSULT LIMITED

Unit 10, 5/F, Wah Wai Centre, 38-40 Au Pui Wan St., Fotan, Hong Kong
 Email: info@qualityprotest.com; Website: www.qualityprotest.com
 Tel: (852) 3956 8717; Fax: (852) 3956 3928

REPORT OF EQUIPMENT PERFORMANCE CHECK/ CALIBRATION

Test Report No. : R-BC070089
 Date of Issue : 31 July 2023
 Page No. : 1 of 2

PART A - CUSTOMER INFORMATION

Acuity Sustainability Consulting Limited
 Unit E, 12/F, Ford Glory Plaza 37-39 Wing Hong Street, Cheung Sha Wan, Kowloon, Hong Kong

PART B - SAMPLE INFORMATION

Name of Equipment : YSI ProDSS (Multi-Parameters)
 Manufacturer : YSI (a xylem brand)
 Serial Number : S/N: 22C106561
 Date of Received : 26 July 2023
 Date of Calibration : 26 July 2023
 Date of Next Calibration : 25 October 2023
 Request No. : D-BC070089

PART C - REFERENCE METHODS/ DOCUMENTS FOR THE CALIBRATION

| Test Parameter | Reference Method |
|------------------|---|
| pH value | APHA 21e 4500-H ⁺ B |
| Temperature | Section 6 of international Accreditation New Zealand Technical Guide no. 3 Second edition March 2008: Working Thermometer Calibration Procedure |
| Salinity | APHA 21e 2520 B |
| Dissolved oxygen | APHA 23e 4500-O G (Membrane Electrode Method) |
| Turbidity | APHA 21e 2130 B (Nephelometric Method) |

PART D - CALIBRATION RESULT

(1) pH value

| Target (pH unit) | Display Reading (pH unit) | Tolerance | Result |
|------------------|---------------------------|-----------|--------------|
| 4.00 | 4.08 | 0.08 | Satisfactory |
| 7.42 | 7.36 | -0.06 | Satisfactory |
| 10.01 | 10.09 | 0.08 | Satisfactory |

Tolerance of pH value should be less than ± 0.2 (pH unit)

(2) Temperature

| Reading of Ref. thermometer (°C) | Display Reading (°C) | Tolerance | Result |
|----------------------------------|----------------------|-----------|--------------|
| 14 | 14.8 | 0.8 | Satisfactory |
| 25 | 25.1 | 0.1 | Satisfactory |
| 36 | 36.3 | 0.3 | Satisfactory |

Tolerance of Temperature should be less than ± 2.0 (°C)

(3) Salinity


| Expected Reading (g/L) | Display Reading (g/L) | Tolerance (%) | Result |
|------------------------|-----------------------|---------------|--------------|
| 10 | 10.02 | 0.20 | Satisfactory |
| 20 | 20.63 | 3.15 | Satisfactory |
| 30 | 31.61 | 5.37 | Satisfactory |

Tolerance of Salinity should be less than ± 10.0 (%)

--- CONTINUED ON NEXT PAGE ---

AUTHORIZED
SIGNATORY:


 LEE Chun-ning
 Assistant Manager



專業化驗有限公司
QUALITY PRO TEST-CONSULT LIMITED

Unit 10, 5/F, Wah Wai Centre, 38-40 Au Pui Wan St., Fotan, Hong Kong
Email: info@qualityprotest.com; Website: www.qualityprotest.com
Tel: (852) 3956 8717; Fax: (852) 3956 3928

REPORT OF EQUIPMENT PERFORMANCE CHECK/ CALIBRATION

Test Report No. : R-BC070089
Date of Issue : 31 July 2023
Page No. : 2 of 2

(4) Dissolved oxygen

| Expected Reading (mg/L) | Display Reading (mg/L) | Tolerance | Result |
|---------------------------|--------------------------|-----------|--------------|
| 7.38 | 7.42 | 0.04 | Satisfactory |
| 6.30 | 6.38 | 0.08 | Satisfactory |
| 4.90 | 4.83 | -0.07 | Satisfactory |
| 1.00 | 1.03 | 0.03 | Satisfactory |

Tolerance of Dissolved oxygen should be less than ± 0.5 (mg/L)

(5) Turbidity

| Expected Reading (NTU) | Display Reading (NTU) | Tolerance (%) | Result |
|--------------------------|-------------------------|-----------------|--------------|
| 0 | 0.10 | -- | Satisfactory |
| 10 | 9.88 | -1.20 | Satisfactory |
| 20 | 21.25 | 6.30 | Satisfactory |
| 100 | 102.97 | 3.00 | Satisfactory |
| 800 | 787.11 | -1.60 | Satisfactory |

Tolerance of Turbidity should be less than ± 10.0 (%)

Remark(s)

- The "Date of Next Calibration" is recommended according to best practice principals as practiced by QPT or quoted from relevant international standards.
- The results relate only to the calibrated equipment as received
- The performance of the equipment stated in this report is checked with independent reference material and results compared against a calibrated secondary source.
- "Displayed Reading" denotes the figure shown on item under calibration/ checking regardless of equipment precision or significant figures.
- The "Tolerance Limit" mentioned is the acceptance criteria applicable for similar equipment used by Quality Pro Test-Consult Ltd. or quoted from relevant international standards.

--- END OF REPORT ---



YSF

Corporation Ltd.

5A, Blk1 Kin Ho Ind. Bldg., 20-24 Au Pui Wan St., Fo Tan, Shatin, N.T., HK.
Tel: (852) 8109 8368 Fax: (852) 3007 4857 E-mail: sales@ysf.com
www.sokkia.com.hk www.ysf.com.hk

Supply, Repair, Rental, Scanning and Calibration Service of Surveying Instruments and Accessories



Certificate No. : CAL220353

Page 1 of 1

CALIBRATION CERTIFICATE OF MULTI GAS DETECTOR

Client : China State Construction Engineering (Hong Kong) Ltd.

Address : 29/F., China Overseas Bldg., 139 Hennessy Road, Hong Kong

Unit-Under-Test (UUT) Information

Description : Multi gas detector
Manufacturer : GMI
Model No. : PS500
Serial No. : 25492809/21

Calibrator Information

Description : (1) 4 in 1 Std. gases (O₂,H₂S,CO,LEL(Methane)) (2) Std. CO₂ gas (0.30%)
Serial No. : (1) C-048-06 (2) C-087-02

Received date : 2 Sept., 2022

Date of calibration : 2 Sept., 2022

Next calibration date : 1 Sept., 2023

Calibration location : YSF Calibration Laboratory

Environmental conditions : 20.9-21.8°C / 52-63%RH

Method used : By direct comparison

Calibration Results :

| Parameters | Measured value |
|-------------------------------|----------------|
| (1) Methane (50% LEL) | 47% LEL |
| (2) Oxygen (18%) | 18.2% |
| (3) Hydrogen Sulphide (25ppm) | 23ppm |
| (4) Carbon monoxide (100ppm) | 96ppm |
| (5) Carbon monoxide (0.30%) | 0.28% |

Remark :

1. The equipment used in this calibration is traceable to recognized National Standards.

Tested by : Lam Man Kwong Date : 2 Sept., 2022 Certified by :  Date : 2 Sept., 2022
So Chi Kuen (Lab Manager)

** End of Certificate **

Appendix G

Water Quality Data and Landfill Gas Monitoring Data

| Location | Date | Weather | Sea Condition | Tidal | Water Level | Depth (m) | Time | DO (mg/L) | pH | Sal (ppt) | Temp (oC) | Turbidity (NTU) | Suspended Solids (mg/L) |
|----------|----------|---------|---------------|-----------|-------------|-----------|------------|-----------|-----|-----------|-----------|-----------------|-------------------------|
| CE | 20230701 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 6:48:00 PM | 8.3 | 8.3 | 32.6 | 27.7 | 3.2 | 2.5 |
| CE | 20230701 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 6:48:00 PM | 8.3 | 8.2 | 32.4 | 27.7 | 3.4 | 2.5 |
| CE | 20230701 | Cloudy | Moderate | Mid-Flood | Middle | 12 | 6:47:00 PM | 8.3 | 8.2 | 32.4 | 27.7 | 3.0 | 2.5 |
| CE | 20230701 | Cloudy | Moderate | Mid-Flood | Middle | 12 | 6:47:00 PM | 8.4 | 8.3 | 32.3 | 27.7 | 3.0 | 2.5 |
| CE | 20230701 | Cloudy | Moderate | Mid-Flood | Bottom | 23 | 6:46:00 PM | 8.3 | 8.2 | 32.4 | 27.7 | 3.0 | 2.5 |
| CE | 20230701 | Cloudy | Moderate | Mid-Flood | Bottom | 23 | 6:46:00 PM | 8.5 | 8.2 | 32.4 | 27.8 | 2.8 | 2.5 |
| CF | 20230701 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 4:00:00 PM | 8.8 | 8.2 | 32.1 | 27.7 | 3.4 | 2.5 |
| CF | 20230701 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 4:00:00 PM | 8.8 | 8.2 | 32.1 | 27.7 | 3.3 | 2.5 |
| CF | 20230701 | Cloudy | Moderate | Mid-Flood | Middle | 10 | 3:59:00 PM | 8.7 | 8.2 | 32.3 | 27.8 | 3.4 | 3.0 |
| CF | 20230701 | Cloudy | Moderate | Mid-Flood | Middle | 10 | 3:59:00 PM | 8.7 | 8.2 | 32.1 | 27.8 | 3.5 | 2.5 |
| CF | 20230701 | Cloudy | Moderate | Mid-Flood | Bottom | 18 | 3:58:00 PM | 8.8 | 8.2 | 32.2 | 27.6 | 3.6 | 3.0 |
| CF | 20230701 | Cloudy | Moderate | Mid-Flood | Bottom | 18 | 3:58:00 PM | 8.8 | 8.2 | 32.1 | 27.7 | 3.7 | 2.5 |
| WSR01 | 20230701 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 4:23:00 PM | 8.3 | 8.4 | 32.6 | 27.9 | 2.1 | 2.5 |
| WSR01 | 20230701 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 4:23:00 PM | 8.3 | 8.3 | 32.6 | 27.7 | 2.4 | 4.0 |
| WSR01 | 20230701 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 4:22:00 PM | 8.3 | 8.4 | 32.5 | 27.9 | 2.4 | 2.5 |
| WSR01 | 20230701 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 4:22:00 PM | 8.3 | 8.3 | 32.5 | 27.9 | 2.3 | 2.5 |
| WSR01 | 20230701 | Cloudy | Moderate | Mid-Flood | Bottom | 7 | 4:21:00 PM | 8.3 | 8.3 | 32.4 | 27.8 | 2.2 | 2.5 |
| WSR01 | 20230701 | Cloudy | Moderate | Mid-Flood | Bottom | 7 | 4:21:00 PM | 8.3 | 8.3 | 32.5 | 27.9 | 2.4 | 2.5 |
| WSR02 | 20230701 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 4:44:00 PM | 8.7 | 8.4 | 32.1 | 27.6 | 2.2 | 4.0 |
| WSR02 | 20230701 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 4:44:00 PM | 8.7 | 8.3 | 32.3 | 27.5 | 2.1 | 2.5 |
| WSR02 | 20230701 | Cloudy | Moderate | Mid-Flood | Middle | 5 | 4:43:00 PM | 8.5 | 8.3 | 32.2 | 27.6 | 2.1 | 2.5 |
| WSR02 | 20230701 | Cloudy | Moderate | Mid-Flood | Middle | 5 | 4:43:00 PM | 8.6 | 8.4 | 32.2 | 27.7 | 2.1 | 2.5 |
| WSR02 | 20230701 | Cloudy | Moderate | Mid-Flood | Bottom | 9 | 4:42:00 PM | 8.6 | 8.3 | 32.1 | 27.6 | 1.8 | 2.5 |
| WSR02 | 20230701 | Cloudy | Moderate | Mid-Flood | Bottom | 9 | 4:42:00 PM | 8.6 | 8.4 | 32.0 | 27.5 | 2.1 | 3.0 |
| WSR03 | 20230701 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 4:57:00 PM | 9.2 | 8.2 | 32.5 | 28.4 | 2.0 | 2.5 |
| WSR03 | 20230701 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 4:57:00 PM | 9.3 | 8.2 | 32.4 | 28.2 | 2.2 | 4.0 |
| WSR03 | 20230701 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 4:56:00 PM | 9.2 | 8.2 | 32.5 | 28.3 | 1.9 | 3.0 |
| WSR03 | 20230701 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 4:56:00 PM | 9.4 | 8.2 | 32.5 | 28.2 | 2.1 | 2.5 |
| WSR03 | 20230701 | Cloudy | Moderate | Mid-Flood | Bottom | 7 | 4:55:00 PM | 9.2 | 8.2 | 32.4 | 28.4 | 2.1 | 2.5 |
| WSR03 | 20230701 | Cloudy | Moderate | Mid-Flood | Bottom | 7 | 4:55:00 PM | 9.2 | 8.2 | 32.5 | 28.3 | 2.1 | 2.5 |

| Location | Date | Weather | Sea Condition | Tidal | Water Level | Depth (m) | Time | DO (mg/L) | pH | Sal (ppt) | Temp (oC) | Turbidity (NTU) | Suspended Solids (mg/L) |
|----------|----------|---------|---------------|-----------|-------------|-----------|------------|-----------|-----|-----------|-----------|-----------------|-------------------------|
| WSR04 | 20230701 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 5:13:00 PM | 9.0 | 8.3 | 32.6 | 28.3 | 2.2 | 2.5 |
| WSR04 | 20230701 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 5:13:00 PM | 9.0 | 8.2 | 32.5 | 28.3 | 2.3 | 2.5 |
| WSR04 | 20230701 | Cloudy | Moderate | Mid-Flood | Middle | 3 | 5:12:00 PM | 9.0 | 8.4 | 32.6 | 28.3 | 2.3 | 2.5 |
| WSR04 | 20230701 | Cloudy | Moderate | Mid-Flood | Middle | 3 | 5:12:00 PM | 9.0 | 8.3 | 32.6 | 28.3 | 2.3 | 2.5 |
| WSR04 | 20230701 | Cloudy | Moderate | Mid-Flood | Bottom | 6 | 5:11:00 PM | 9.1 | 8.3 | 32.4 | 28.3 | 2.3 | 3.0 |
| WSR04 | 20230701 | Cloudy | Moderate | Mid-Flood | Bottom | 6 | 5:11:00 PM | 9.1 | 8.3 | 32.6 | 28.3 | 2.3 | 2.5 |
| WSR16 | 20230701 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 6:24:00 PM | 8.3 | 8.3 | 32.4 | 28.1 | 2.3 | 2.5 |
| WSR16 | 20230701 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 6:24:00 PM | 8.2 | 8.3 | 32.4 | 28.0 | 2.2 | 2.5 |
| WSR16 | 20230701 | Cloudy | Moderate | Mid-Flood | Middle | 8 | 6:23:00 PM | 8.3 | 8.2 | 32.3 | 28.0 | 2.4 | 2.5 |
| WSR16 | 20230701 | Cloudy | Moderate | Mid-Flood | Middle | 8 | 6:23:00 PM | 8.2 | 8.3 | 32.2 | 28.1 | 2.2 | 2.5 |
| WSR16 | 20230701 | Cloudy | Moderate | Mid-Flood | Bottom | 14 | 6:22:00 PM | 8.3 | 8.3 | 32.2 | 28.0 | 2.0 | 2.5 |
| WSR16 | 20230701 | Cloudy | Moderate | Mid-Flood | Bottom | 14 | 6:22:00 PM | 8.3 | 8.3 | 32.2 | 28.1 | 2.4 | 2.5 |
| WSR33 | 20230701 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 5:28:00 PM | 8.8 | 8.3 | 32.2 | 27.8 | 2.4 | 2.5 |
| WSR33 | 20230701 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 5:28:00 PM | 8.9 | 8.4 | 32.2 | 27.7 | 2.1 | 2.5 |
| WSR33 | 20230701 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 5:27:00 PM | 8.9 | 8.3 | 32.2 | 27.8 | 2.3 | 2.5 |
| WSR33 | 20230701 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 5:27:00 PM | 8.9 | 8.4 | 32.2 | 27.7 | 2.4 | 2.5 |
| WSR33 | 20230701 | Cloudy | Moderate | Mid-Flood | Bottom | 6 | 5:26:00 PM | 8.8 | 8.4 | 32.3 | 27.8 | 2.1 | 2.5 |
| WSR33 | 20230701 | Cloudy | Moderate | Mid-Flood | Bottom | 6 | 5:26:00 PM | 8.9 | 8.4 | 32.2 | 27.6 | 2.3 | 2.5 |
| WSR36 | 20230701 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 5:42:00 PM | 8.9 | 8.3 | 32.3 | 27.7 | 2.4 | 2.5 |
| WSR36 | 20230701 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 5:42:00 PM | 8.9 | 8.3 | 32.2 | 27.8 | 2.3 | 2.5 |
| WSR36 | 20230701 | Cloudy | Moderate | Mid-Flood | Middle | 3 | 5:42:00 PM | 8.8 | 8.2 | 32.2 | 27.7 | 2.3 | 2.5 |
| WSR36 | 20230701 | Cloudy | Moderate | Mid-Flood | Middle | 3 | 5:42:00 PM | 8.8 | 8.2 | 32.2 | 27.7 | 2.4 | 2.5 |
| WSR36 | 20230701 | Cloudy | Moderate | Mid-Flood | Bottom | 6 | 5:41:00 PM | 8.9 | 8.3 | 32.4 | 27.8 | 1.8 | 2.5 |
| WSR36 | 20230701 | Cloudy | Moderate | Mid-Flood | Bottom | 6 | 5:41:00 PM | 8.8 | 8.3 | 32.4 | 27.7 | 2.1 | 2.5 |
| WSR37 | 20230701 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 5:59:00 PM | 9.1 | 8.3 | 32.5 | 28.4 | 2.2 | 2.5 |
| WSR37 | 20230701 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 5:59:00 PM | 9.1 | 8.3 | 32.4 | 28.3 | 2.3 | 2.5 |
| WSR37 | 20230701 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 5:58:00 PM | 9.1 | 8.4 | 32.4 | 28.3 | 1.9 | 2.5 |
| WSR37 | 20230701 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 5:58:00 PM | 9.1 | 8.3 | 32.4 | 28.3 | 2.2 | 2.5 |
| WSR37 | 20230701 | Cloudy | Moderate | Mid-Flood | Bottom | 7 | 5:57:00 PM | 9.2 | 8.4 | 32.6 | 28.3 | 1.7 | 2.5 |
| WSR37 | 20230701 | Cloudy | Moderate | Mid-Flood | Bottom | 7 | 5:57:00 PM | 9.1 | 8.3 | 32.6 | 28.3 | 1.7 | 2.5 |

| Location | Date | Weather | Sea Condition | Tidal | Water Level | Depth (m) | Time | DO (mg/L) | pH | Sal (ppt) | Temp (oC) | Turbidity (NTU) | Suspended Solids (mg/L) |
|----------|----------|---------|---------------|-----------|-------------|-----------|------------|-----------|-----|-----------|-----------|-----------------|-------------------------|
| CE | 20230704 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 7:50:00 PM | 9.0 | 8.4 | 33.4 | 28.3 | 2.8 | 7.0 |
| CE | 20230704 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 7:50:00 PM | 8.9 | 8.3 | 33.2 | 28.4 | 2.7 | 5.0 |
| CE | 20230704 | Cloudy | Moderate | Mid-Flood | Middle | 11 | 7:49:00 PM | 9.0 | 8.3 | 33.3 | 28.4 | 3.1 | 2.5 |
| CE | 20230704 | Cloudy | Moderate | Mid-Flood | Middle | 11 | 7:49:00 PM | 8.9 | 8.4 | 33.2 | 28.4 | 2.9 | 2.5 |
| CE | 20230704 | Cloudy | Moderate | Mid-Flood | Bottom | 22 | 7:48:00 PM | 8.8 | 8.4 | 33.3 | 28.4 | 2.9 | 2.5 |
| CE | 20230704 | Cloudy | Moderate | Mid-Flood | Bottom | 22 | 7:48:00 PM | 9.0 | 8.3 | 33.3 | 28.3 | 2.8 | 3.0 |
| CF | 20230704 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 4:59:00 PM | 9.1 | 8.4 | 33.4 | 28.0 | 3.4 | 3.0 |
| CF | 20230704 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 4:59:00 PM | 9.3 | 8.4 | 33.3 | 27.9 | 3.4 | 2.5 |
| CF | 20230704 | Cloudy | Moderate | Mid-Flood | Middle | 11 | 4:58:00 PM | 9.2 | 8.4 | 33.2 | 28.0 | 3.3 | 4.0 |
| CF | 20230704 | Cloudy | Moderate | Mid-Flood | Middle | 11 | 4:58:00 PM | 9.1 | 8.4 | 33.4 | 28.0 | 3.0 | 3.0 |
| CF | 20230704 | Cloudy | Moderate | Mid-Flood | Bottom | 20 | 4:57:00 PM | 9.3 | 8.4 | 33.2 | 27.9 | 3.5 | 2.5 |
| CF | 20230704 | Cloudy | Moderate | Mid-Flood | Bottom | 20 | 4:57:00 PM | 9.2 | 8.4 | 33.3 | 28.0 | 3.4 | 4.0 |
| WSR01 | 20230704 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 5:23:00 PM | 9.3 | 8.2 | 32.5 | 27.9 | 2.3 | 3.0 |
| WSR01 | 20230704 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 5:23:00 PM | 9.4 | 8.3 | 32.5 | 27.9 | 2.3 | 2.5 |
| WSR01 | 20230704 | Cloudy | Moderate | Mid-Flood | Middle | 5 | 5:22:00 PM | 9.3 | 8.3 | 32.6 | 27.9 | 1.9 | 6.0 |
| WSR01 | 20230704 | Cloudy | Moderate | Mid-Flood | Middle | 5 | 5:22:00 PM | 9.4 | 8.2 | 32.6 | 27.9 | 2.2 | 3.0 |
| WSR01 | 20230704 | Cloudy | Moderate | Mid-Flood | Bottom | 8 | 5:21:00 PM | 9.4 | 8.4 | 32.7 | 27.9 | 2.1 | 2.5 |
| WSR01 | 20230704 | Cloudy | Moderate | Mid-Flood | Bottom | 8 | 5:21:00 PM | 9.2 | 8.3 | 32.6 | 27.9 | 2.3 | 4.0 |
| WSR02 | 20230704 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 5:43:00 PM | 9.2 | 8.4 | 32.4 | 28.2 | 2.5 | 3.0 |
| WSR02 | 20230704 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 5:43:00 PM | 9.3 | 8.3 | 32.4 | 28.2 | 2.3 | 2.5 |
| WSR02 | 20230704 | Cloudy | Moderate | Mid-Flood | Middle | 5 | 5:42:00 PM | 9.3 | 8.3 | 32.4 | 28.2 | 2.2 | 4.0 |
| WSR02 | 20230704 | Cloudy | Moderate | Mid-Flood | Middle | 5 | 5:42:00 PM | 9.2 | 8.4 | 32.3 | 28.2 | 2.5 | 4.0 |
| WSR02 | 20230704 | Cloudy | Moderate | Mid-Flood | Bottom | 9 | 5:41:00 PM | 9.2 | 8.3 | 32.4 | 28.2 | 1.9 | 3.0 |
| WSR02 | 20230704 | Cloudy | Moderate | Mid-Flood | Bottom | 9 | 5:41:00 PM | 9.2 | 8.3 | 32.4 | 28.3 | 2.1 | 4.0 |
| WSR03 | 20230704 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 5:59:00 PM | 9.3 | 8.4 | 33.0 | 28.0 | 2.4 | 2.5 |
| WSR03 | 20230704 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 5:59:00 PM | 9.3 | 8.4 | 33.0 | 28.0 | 2.2 | 3.0 |
| WSR03 | 20230704 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 5:58:00 PM | 9.2 | 8.3 | 33.1 | 28.0 | 2.1 | 2.5 |
| WSR03 | 20230704 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 5:58:00 PM | 9.3 | 8.3 | 33.1 | 27.9 | 2.2 | 2.5 |
| WSR03 | 20230704 | Cloudy | Moderate | Mid-Flood | Bottom | 7 | 5:57:00 PM | 9.2 | 8.4 | 33.0 | 27.9 | 2.2 | 3.0 |
| WSR03 | 20230704 | Cloudy | Moderate | Mid-Flood | Bottom | 7 | 5:57:00 PM | 9.2 | 8.4 | 33.0 | 27.9 | 2.4 | 2.5 |

| Location | Date | Weather | Sea Condition | Tidal | Water Level | Depth (m) | Time | DO (mg/L) | pH | Sal (ppt) | Temp (oC) | Turbidity (NTU) | Suspended Solids (mg/L) |
|----------|----------|---------|---------------|-----------|-------------|-----------|------------|-----------|-----|-----------|-----------|-----------------|-------------------------|
| WSR04 | 20230704 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 6:13:00 PM | 9.2 | 8.3 | 32.4 | 27.8 | 2.4 | 2.5 |
| WSR04 | 20230704 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 6:13:00 PM | 9.3 | 8.4 | 32.2 | 27.8 | 2.4 | 2.5 |
| WSR04 | 20230704 | Cloudy | Moderate | Mid-Flood | Middle | 3 | 6:12:00 PM | 9.4 | 8.3 | 32.4 | 27.7 | 2.2 | 4.0 |
| WSR04 | 20230704 | Cloudy | Moderate | Mid-Flood | Middle | 3 | 6:12:00 PM | 9.3 | 8.3 | 32.2 | 27.8 | 2.3 | 3.0 |
| WSR04 | 20230704 | Cloudy | Moderate | Mid-Flood | Bottom | 6 | 6:11:00 PM | 9.2 | 8.4 | 32.3 | 27.9 | 2.4 | 3.0 |
| WSR04 | 20230704 | Cloudy | Moderate | Mid-Flood | Bottom | 6 | 6:11:00 PM | 9.2 | 8.3 | 32.3 | 27.8 | 2.4 | 5.0 |
| WSR16 | 20230704 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 7:26:00 PM | 8.8 | 8.3 | 33.0 | 28.3 | 2.2 | 4.0 |
| WSR16 | 20230704 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 7:26:00 PM | 8.7 | 8.3 | 33.1 | 28.3 | 2.2 | 4.0 |
| WSR16 | 20230704 | Cloudy | Moderate | Mid-Flood | Middle | 8 | 7:25:00 PM | 8.8 | 8.3 | 33.2 | 28.4 | 2.2 | 3.0 |
| WSR16 | 20230704 | Cloudy | Moderate | Mid-Flood | Middle | 8 | 7:25:00 PM | 8.8 | 8.3 | 33.1 | 28.3 | 2.3 | 2.5 |
| WSR16 | 20230704 | Cloudy | Moderate | Mid-Flood | Bottom | 14 | 7:24:00 PM | 8.7 | 8.3 | 33.2 | 28.3 | 1.8 | 2.5 |
| WSR16 | 20230704 | Cloudy | Moderate | Mid-Flood | Bottom | 14 | 7:24:00 PM | 8.7 | 8.3 | 33.2 | 28.3 | 1.9 | 2.5 |
| WSR33 | 20230704 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 6:30:00 PM | 9.4 | 8.3 | 33.1 | 28.4 | 2.4 | 3.0 |
| WSR33 | 20230704 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 6:30:00 PM | 9.3 | 8.3 | 33.0 | 28.4 | 2.1 | 5.0 |
| WSR33 | 20230704 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 6:29:00 PM | 9.4 | 8.2 | 33.2 | 28.4 | 2.1 | 2.5 |
| WSR33 | 20230704 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 6:29:00 PM | 9.3 | 8.3 | 33.2 | 28.3 | 2.4 | 3.0 |
| WSR33 | 20230704 | Cloudy | Moderate | Mid-Flood | Bottom | 6 | 6:28:00 PM | 9.3 | 8.3 | 33.2 | 28.4 | 1.9 | 2.5 |
| WSR33 | 20230704 | Cloudy | Moderate | Mid-Flood | Bottom | 6 | 6:28:00 PM | 9.4 | 8.3 | 33.0 | 28.4 | 2.1 | 2.5 |
| WSR36 | 20230704 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 6:44:00 PM | 8.4 | 8.3 | 32.4 | 28.5 | 2.2 | 4.0 |
| WSR36 | 20230704 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 6:44:00 PM | 8.5 | 8.3 | 32.4 | 28.5 | 2.4 | 3.0 |
| WSR36 | 20230704 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 6:44:00 PM | 8.5 | 8.3 | 32.3 | 28.6 | 2.5 | 2.5 |
| WSR36 | 20230704 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 6:44:00 PM | 8.4 | 8.3 | 32.2 | 28.5 | 2.3 | 4.0 |
| WSR36 | 20230704 | Cloudy | Moderate | Mid-Flood | Bottom | 6 | 6:43:00 PM | 8.5 | 8.4 | 32.4 | 28.5 | 1.9 | 2.5 |
| WSR36 | 20230704 | Cloudy | Moderate | Mid-Flood | Bottom | 6 | 6:43:00 PM | 8.4 | 8.4 | 32.4 | 28.6 | 2.1 | 4.0 |
| WSR37 | 20230704 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 7:02:00 PM | 8.9 | 8.3 | 32.2 | 27.8 | 2.4 | 3.0 |
| WSR37 | 20230704 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 7:02:00 PM | 8.9 | 8.3 | 32.2 | 27.8 | 2.3 | 3.0 |
| WSR37 | 20230704 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 7:01:00 PM | 8.9 | 8.3 | 32.2 | 27.8 | 2.1 | 2.5 |
| WSR37 | 20230704 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 7:01:00 PM | 8.9 | 8.3 | 32.4 | 27.8 | 2.5 | 2.5 |
| WSR37 | 20230704 | Cloudy | Moderate | Mid-Flood | Bottom | 8 | 7:00:00 PM | 8.9 | 8.4 | 32.2 | 27.7 | 1.9 | 2.5 |
| WSR37 | 20230704 | Cloudy | Moderate | Mid-Flood | Bottom | 8 | 7:00:00 PM | 8.9 | 8.3 | 32.3 | 27.7 | 2.1 | 2.5 |

| Location | Date | Weather | Sea Condition | Tidal | Water Level | Depth (m) | Time | DO (mg/L) | pH | Sal (ppt) | Temp (oC) | Turbidity (NTU) | Suspended Solids (mg/L) |
|----------|----------|---------|---------------|-----------|-------------|-----------|-------------|-----------|-----|-----------|-----------|-----------------|-------------------------|
| CE | 20230706 | Sunny | Moderate | Mid-Flood | Surface | 1 | 10:54:00 AM | 8.7 | 8.3 | 33.0 | 28.3 | 2.7 | 3.0 |
| CE | 20230706 | Sunny | Moderate | Mid-Flood | Surface | 1 | 10:54:00 AM | 8.9 | 8.3 | 33.1 | 28.3 | 2.8 | 3.0 |
| CE | 20230706 | Sunny | Moderate | Mid-Flood | Middle | 11 | 10:53:00 AM | 8.9 | 8.2 | 33.0 | 28.3 | 2.6 | 4.0 |
| CE | 20230706 | Sunny | Moderate | Mid-Flood | Middle | 11 | 10:53:00 AM | 8.8 | 8.3 | 33.2 | 28.3 | 2.7 | 2.5 |
| CE | 20230706 | Sunny | Moderate | Mid-Flood | Bottom | 21 | 10:52:00 AM | 8.8 | 8.3 | 33.2 | 28.4 | 2.6 | 2.5 |
| CE | 20230706 | Sunny | Moderate | Mid-Flood | Bottom | 21 | 10:52:00 AM | 8.9 | 8.3 | 33.0 | 28.4 | 2.9 | 3.0 |
| CF | 20230706 | Sunny | Moderate | Mid-Flood | Surface | 1 | 8:02:00 AM | 8.4 | 8.4 | 33.8 | 28.8 | 3.2 | 2.5 |
| CF | 20230706 | Sunny | Moderate | Mid-Flood | Surface | 1 | 8:02:00 AM | 8.3 | 8.4 | 33.7 | 28.8 | 3.4 | 2.5 |
| CF | 20230706 | Sunny | Moderate | Mid-Flood | Middle | 11 | 8:01:00 AM | 8.4 | 8.3 | 33.8 | 28.8 | 3.3 | 3.0 |
| CF | 20230706 | Sunny | Moderate | Mid-Flood | Middle | 11 | 8:01:00 AM | 8.4 | 8.4 | 33.8 | 28.9 | 3.4 | 4.0 |
| CF | 20230706 | Sunny | Moderate | Mid-Flood | Bottom | 21 | 8:00:00 AM | 8.4 | 8.3 | 33.6 | 28.7 | 3.2 | 4.0 |
| CF | 20230706 | Sunny | Moderate | Mid-Flood | Bottom | 21 | 8:00:00 AM | 8.5 | 8.3 | 33.7 | 28.8 | 3.4 | 3.0 |
| WSR01 | 20230706 | Sunny | Moderate | Mid-Flood | Surface | 1 | 8:26:00 AM | 9.2 | 8.4 | 33.6 | 28.6 | 2.4 | 4.0 |
| WSR01 | 20230706 | Sunny | Moderate | Mid-Flood | Surface | 1 | 8:26:00 AM | 9.1 | 8.3 | 33.4 | 28.6 | 2.4 | 4.0 |
| WSR01 | 20230706 | Sunny | Moderate | Mid-Flood | Middle | 5 | 8:25:00 AM | 9.2 | 8.3 | 33.5 | 28.6 | 2.2 | 2.5 |
| WSR01 | 20230706 | Sunny | Moderate | Mid-Flood | Middle | 5 | 8:25:00 AM | 9.1 | 8.3 | 33.6 | 28.6 | 2.3 | 2.5 |
| WSR01 | 20230706 | Sunny | Moderate | Mid-Flood | Bottom | 8 | 8:24:00 AM | 9.0 | 8.3 | 33.4 | 28.6 | 2.3 | 2.5 |
| WSR01 | 20230706 | Sunny | Moderate | Mid-Flood | Bottom | 8 | 8:24:00 AM | 9.2 | 8.3 | 33.4 | 28.5 | 2.3 | 3.0 |
| WSR02 | 20230706 | Sunny | Moderate | Mid-Flood | Surface | 1 | 8:46:00 AM | 8.8 | 8.2 | 33.8 | 28.2 | 2.2 | 3.0 |
| WSR02 | 20230706 | Sunny | Moderate | Mid-Flood | Surface | 1 | 8:46:00 AM | 8.8 | 8.3 | 33.6 | 28.1 | 2.5 | 3.0 |
| WSR02 | 20230706 | Sunny | Moderate | Mid-Flood | Middle | 5 | 8:45:00 AM | 8.7 | 8.2 | 33.6 | 28.1 | 2.2 | 2.5 |
| WSR02 | 20230706 | Sunny | Moderate | Mid-Flood | Middle | 5 | 8:45:00 AM | 8.8 | 8.3 | 33.6 | 28.0 | 2.3 | 2.5 |
| WSR02 | 20230706 | Sunny | Moderate | Mid-Flood | Bottom | 9 | 8:44:00 AM | 8.8 | 8.3 | 33.6 | 28.1 | 2.2 | 2.5 |
| WSR02 | 20230706 | Sunny | Moderate | Mid-Flood | Bottom | 9 | 8:44:00 AM | 8.8 | 8.2 | 33.7 | 28.1 | 2.4 | 3.0 |
| WSR03 | 20230706 | Sunny | Moderate | Mid-Flood | Surface | 1 | 9:01:00 AM | 8.9 | 8.3 | 32.7 | 28.7 | 2.2 | 3.0 |
| WSR03 | 20230706 | Sunny | Moderate | Mid-Flood | Surface | 1 | 9:01:00 AM | 8.7 | 8.3 | 32.8 | 28.7 | 2.3 | 2.5 |
| WSR03 | 20230706 | Sunny | Moderate | Mid-Flood | Middle | 4 | 9:00:00 AM | 8.8 | 8.4 | 32.6 | 28.7 | 1.8 | 2.5 |
| WSR03 | 20230706 | Sunny | Moderate | Mid-Flood | Middle | 4 | 9:00:00 AM | 8.9 | 8.4 | 32.7 | 28.9 | 2.1 | 2.5 |
| WSR03 | 20230706 | Sunny | Moderate | Mid-Flood | Bottom | 7 | 8:59:00 AM | 8.9 | 8.4 | 32.7 | 28.8 | 1.6 | 2.5 |
| WSR03 | 20230706 | Sunny | Moderate | Mid-Flood | Bottom | 7 | 8:59:00 AM | 8.7 | 8.3 | 32.8 | 28.8 | 1.7 | 2.5 |

| Location | Date | Weather | Sea Condition | Tidal | Water Level | Depth (m) | Time | DO (mg/L) | pH | Sal (ppt) | Temp (oC) | Turbidity (NTU) | Suspended Solids (mg/L) |
|----------|----------|---------|---------------|-----------|-------------|-----------|-------------|-----------|-----|-----------|-----------|-----------------|-------------------------|
| WSR04 | 20230706 | Sunny | Moderate | Mid-Flood | Surface | 1 | 9:16:00 AM | 8.4 | 8.2 | 33.5 | 28.7 | 2.2 | 2.5 |
| WSR04 | 20230706 | Sunny | Moderate | Mid-Flood | Surface | 1 | 9:16:00 AM | 8.4 | 8.3 | 33.7 | 28.7 | 2.5 | 2.5 |
| WSR04 | 20230706 | Sunny | Moderate | Mid-Flood | Middle | 4 | 9:15:00 AM | 8.4 | 8.2 | 33.6 | 28.8 | 2.1 | 3.0 |
| WSR04 | 20230706 | Sunny | Moderate | Mid-Flood | Middle | 4 | 9:15:00 AM | 8.6 | 8.2 | 33.6 | 28.7 | 2.3 | 2.5 |
| WSR04 | 20230706 | Sunny | Moderate | Mid-Flood | Bottom | 7 | 9:14:00 AM | 8.4 | 8.2 | 33.5 | 28.6 | 2.0 | 2.5 |
| WSR04 | 20230706 | Sunny | Moderate | Mid-Flood | Bottom | 7 | 9:14:00 AM | 8.5 | 8.3 | 33.7 | 28.7 | 2.0 | 2.5 |
| WSR16 | 20230706 | Sunny | Moderate | Mid-Flood | Surface | 1 | 10:28:00 AM | 9.2 | 8.2 | 33.0 | 28.8 | 2.4 | 2.5 |
| WSR16 | 20230706 | Sunny | Moderate | Mid-Flood | Surface | 1 | 10:28:00 AM | 9.2 | 8.2 | 33.1 | 28.8 | 2.5 | 2.5 |
| WSR16 | 20230706 | Sunny | Moderate | Mid-Flood | Middle | 8 | 10:27:00 AM | 9.1 | 8.2 | 33.2 | 28.8 | 2.3 | 2.5 |
| WSR16 | 20230706 | Sunny | Moderate | Mid-Flood | Middle | 8 | 10:27:00 AM | 9.0 | 8.2 | 33.1 | 28.9 | 2.1 | 2.5 |
| WSR16 | 20230706 | Sunny | Moderate | Mid-Flood | Bottom | 14 | 10:26:00 AM | 8.9 | 8.2 | 33.0 | 28.9 | 1.9 | 2.5 |
| WSR16 | 20230706 | Sunny | Moderate | Mid-Flood | Bottom | 14 | 10:26:00 AM | 9.1 | 8.2 | 33.2 | 28.8 | 2.2 | 2.5 |
| WSR33 | 20230706 | Sunny | Moderate | Mid-Flood | Surface | 1 | 9:33:00 AM | 8.5 | 8.3 | 32.7 | 28.1 | 2.3 | 2.5 |
| WSR33 | 20230706 | Sunny | Moderate | Mid-Flood | Surface | 1 | 9:33:00 AM | 8.6 | 8.3 | 32.9 | 28.2 | 2.5 | 2.5 |
| WSR33 | 20230706 | Sunny | Moderate | Mid-Flood | Middle | 4 | 9:32:00 AM | 8.5 | 8.2 | 32.7 | 28.2 | 2.1 | 2.5 |
| WSR33 | 20230706 | Sunny | Moderate | Mid-Flood | Middle | 4 | 9:32:00 AM | 8.5 | 8.2 | 32.9 | 28.2 | 2.4 | 2.5 |
| WSR33 | 20230706 | Sunny | Moderate | Mid-Flood | Bottom | 7 | 9:31:00 AM | 8.6 | 8.2 | 32.9 | 28.1 | 2.3 | 2.5 |
| WSR33 | 20230706 | Sunny | Moderate | Mid-Flood | Bottom | 7 | 9:31:00 AM | 8.5 | 8.2 | 32.9 | 28.2 | 2.4 | 2.5 |
| WSR36 | 20230706 | Sunny | Moderate | Mid-Flood | Surface | 1 | 9:47:00 AM | 8.5 | 8.3 | 33.1 | 28.0 | 2.0 | 2.5 |
| WSR36 | 20230706 | Sunny | Moderate | Mid-Flood | Surface | 1 | 9:47:00 AM | 8.6 | 8.2 | 33.0 | 28.0 | 2.2 | 2.5 |
| WSR36 | 20230706 | Sunny | Moderate | Mid-Flood | Middle | 4 | 9:47:00 AM | 8.7 | 8.2 | 33.0 | 28.1 | 2.3 | 4.0 |
| WSR36 | 20230706 | Sunny | Moderate | Mid-Flood | Middle | 4 | 9:47:00 AM | 8.5 | 8.2 | 33.1 | 28.1 | 2.3 | 2.5 |
| WSR36 | 20230706 | Sunny | Moderate | Mid-Flood | Bottom | 7 | 9:46:00 AM | 8.7 | 8.3 | 33.0 | 28.0 | 1.8 | 2.5 |
| WSR36 | 20230706 | Sunny | Moderate | Mid-Flood | Bottom | 7 | 9:46:00 AM | 8.5 | 8.3 | 33.1 | 28.0 | 1.9 | 2.5 |
| WSR37 | 20230706 | Sunny | Moderate | Mid-Flood | Surface | 1 | 10:05:00 AM | 9.5 | 8.2 | 33.7 | 28.5 | 2.4 | 4.0 |
| WSR37 | 20230706 | Sunny | Moderate | Mid-Flood | Surface | 1 | 10:05:00 AM | 9.4 | 8.2 | 33.8 | 28.4 | 2.6 | 2.5 |
| WSR37 | 20230706 | Sunny | Moderate | Mid-Flood | Middle | 4 | 10:04:00 AM | 9.2 | 8.2 | 33.7 | 28.5 | 2.2 | 2.5 |
| WSR37 | 20230706 | Sunny | Moderate | Mid-Flood | Middle | 4 | 10:04:00 AM | 9.3 | 8.2 | 33.8 | 28.5 | 2.2 | 2.5 |
| WSR37 | 20230706 | Sunny | Moderate | Mid-Flood | Bottom | 7 | 10:03:00 AM | 9.2 | 8.2 | 33.7 | 28.4 | 2.1 | 2.5 |
| WSR37 | 20230706 | Sunny | Moderate | Mid-Flood | Bottom | 7 | 10:03:00 AM | 9.3 | 8.2 | 33.7 | 28.5 | 2.4 | 2.5 |

| Location | Date | Weather | Sea Condition | Tidal | Water Level | Depth (m) | Time | DO (mg/L) | pH | Sal (ppt) | Temp (oC) | Turbidity (NTU) | Suspended Solids (mg/L) |
|----------|----------|---------|---------------|-----------|-------------|-----------|-------------|-----------|-----|-----------|-----------|-----------------|-------------------------|
| CE | 20230708 | Sunny | Moderate | Mid-Flood | Surface | 1 | 10:52:00 AM | 9.0 | 8.2 | 33.0 | 28.1 | 2.8 | 2.5 |
| CE | 20230708 | Sunny | Moderate | Mid-Flood | Surface | 1 | 10:52:00 AM | 9.0 | 8.3 | 33.1 | 28.2 | 2.7 | 2.5 |
| CE | 20230708 | Sunny | Moderate | Mid-Flood | Middle | 11 | 10:51:00 AM | 9.1 | 8.3 | 33.1 | 28.2 | 3.0 | 2.5 |
| CE | 20230708 | Sunny | Moderate | Mid-Flood | Middle | 11 | 10:51:00 AM | 9.1 | 8.3 | 33.0 | 28.2 | 2.6 | 2.5 |
| CE | 20230708 | Sunny | Moderate | Mid-Flood | Bottom | 21 | 10:50:00 AM | 9.0 | 8.3 | 33.1 | 28.2 | 2.7 | 2.5 |
| CE | 20230708 | Sunny | Moderate | Mid-Flood | Bottom | 21 | 10:50:00 AM | 9.1 | 8.3 | 33.0 | 28.2 | 2.9 | 2.5 |
| CF | 20230708 | Sunny | Moderate | Mid-Flood | Surface | 1 | 8:02:00 AM | 8.4 | 8.2 | 32.0 | 28.8 | 3.0 | 2.5 |
| CF | 20230708 | Sunny | Moderate | Mid-Flood | Surface | 1 | 8:02:00 AM | 8.4 | 8.3 | 32.0 | 28.7 | 3.2 | 2.5 |
| CF | 20230708 | Sunny | Moderate | Mid-Flood | Middle | 10 | 8:01:00 AM | 8.6 | 8.3 | 32.0 | 28.8 | 3.3 | 2.5 |
| CF | 20230708 | Sunny | Moderate | Mid-Flood | Middle | 10 | 8:01:00 AM | 8.4 | 8.2 | 32.1 | 28.7 | 3.3 | 2.5 |
| CF | 20230708 | Sunny | Moderate | Mid-Flood | Bottom | 19 | 8:00:00 AM | 8.4 | 8.2 | 32.2 | 28.7 | 3.3 | 2.5 |
| CF | 20230708 | Sunny | Moderate | Mid-Flood | Bottom | 19 | 8:00:00 AM | 8.5 | 8.2 | 32.0 | 28.8 | 3.2 | 2.5 |
| WSR01 | 20230708 | Sunny | Moderate | Mid-Flood | Surface | 1 | 8:28:00 AM | 8.3 | 8.2 | 32.4 | 28.2 | 2.1 | 2.5 |
| WSR01 | 20230708 | Sunny | Moderate | Mid-Flood | Surface | 1 | 8:28:00 AM | 8.3 | 8.3 | 32.5 | 28.1 | 2.1 | 2.5 |
| WSR01 | 20230708 | Sunny | Moderate | Mid-Flood | Middle | 5 | 8:27:00 AM | 8.5 | 8.2 | 32.5 | 28.1 | 2.2 | 2.5 |
| WSR01 | 20230708 | Sunny | Moderate | Mid-Flood | Middle | 5 | 8:27:00 AM | 8.3 | 8.2 | 32.4 | 28.2 | 2.3 | 2.5 |
| WSR01 | 20230708 | Sunny | Moderate | Mid-Flood | Bottom | 9 | 8:26:00 AM | 8.5 | 8.2 | 32.4 | 28.2 | 1.8 | 2.5 |
| WSR01 | 20230708 | Sunny | Moderate | Mid-Flood | Bottom | 9 | 8:26:00 AM | 8.3 | 8.2 | 32.5 | 28.2 | 2.0 | 2.5 |
| WSR02 | 20230708 | Sunny | Moderate | Mid-Flood | Surface | 1 | 8:47:00 AM | 8.6 | 8.2 | 32.2 | 28.2 | 2.4 | 2.5 |
| WSR02 | 20230708 | Sunny | Moderate | Mid-Flood | Surface | 1 | 8:47:00 AM | 8.6 | 8.2 | 32.0 | 28.2 | 2.2 | 2.5 |
| WSR02 | 20230708 | Sunny | Moderate | Mid-Flood | Middle | 5 | 8:46:00 AM | 8.7 | 8.2 | 32.0 | 28.2 | 2.1 | 2.5 |
| WSR02 | 20230708 | Sunny | Moderate | Mid-Flood | Middle | 5 | 8:46:00 AM | 8.6 | 8.2 | 32.1 | 28.3 | 2.4 | 2.5 |
| WSR02 | 20230708 | Sunny | Moderate | Mid-Flood | Bottom | 9 | 8:45:00 AM | 8.7 | 8.2 | 32.2 | 28.2 | 2.2 | 2.5 |
| WSR02 | 20230708 | Sunny | Moderate | Mid-Flood | Bottom | 9 | 8:45:00 AM | 8.6 | 8.2 | 32.0 | 28.3 | 2.2 | 2.5 |
| WSR03 | 20230708 | Sunny | Moderate | Mid-Flood | Surface | 1 | 9:03:00 AM | 9.4 | 8.2 | 32.1 | 28.2 | 2.2 | 2.5 |
| WSR03 | 20230708 | Sunny | Moderate | Mid-Flood | Surface | 1 | 9:03:00 AM | 9.3 | 8.2 | 32.3 | 28.3 | 2.3 | 2.5 |
| WSR03 | 20230708 | Sunny | Moderate | Mid-Flood | Middle | 4 | 9:02:00 AM | 9.2 | 8.2 | 32.2 | 28.2 | 1.8 | 2.5 |
| WSR03 | 20230708 | Sunny | Moderate | Mid-Flood | Middle | 4 | 9:02:00 AM | 9.4 | 8.2 | 32.1 | 28.2 | 2.0 | 2.5 |
| WSR03 | 20230708 | Sunny | Moderate | Mid-Flood | Bottom | 7 | 9:01:00 AM | 9.3 | 8.3 | 32.1 | 28.3 | 1.8 | 2.5 |
| WSR03 | 20230708 | Sunny | Moderate | Mid-Flood | Bottom | 7 | 9:01:00 AM | 9.3 | 8.2 | 32.2 | 28.3 | 2.0 | 2.5 |

| Location | Date | Weather | Sea Condition | Tidal | Water Level | Depth (m) | Time | DO (mg/L) | pH | Sal (ppt) | Temp (oC) | Turbidity (NTU) | Suspended Solids (mg/L) |
|----------|----------|---------|---------------|-----------|-------------|-----------|-------------|-----------|-----|-----------|-----------|-----------------|-------------------------|
| WSR04 | 20230708 | Sunny | Moderate | Mid-Flood | Surface | 1 | 9:17:00 AM | 8.3 | 8.3 | 32.7 | 28.2 | 2.2 | 2.5 |
| WSR04 | 20230708 | Sunny | Moderate | Mid-Flood | Surface | 1 | 9:17:00 AM | 8.4 | 8.3 | 32.8 | 28.2 | 2.5 | 2.5 |
| WSR04 | 20230708 | Sunny | Moderate | Mid-Flood | Middle | 4 | 9:16:00 AM | 8.4 | 8.2 | 32.7 | 28.2 | 2.0 | 2.5 |
| WSR04 | 20230708 | Sunny | Moderate | Mid-Flood | Middle | 4 | 9:16:00 AM | 8.3 | 8.2 | 32.6 | 28.2 | 2.3 | 2.5 |
| WSR04 | 20230708 | Sunny | Moderate | Mid-Flood | Bottom | 6 | 9:15:00 AM | 8.4 | 8.2 | 32.7 | 28.2 | 1.7 | 2.5 |
| WSR04 | 20230708 | Sunny | Moderate | Mid-Flood | Bottom | 6 | 9:15:00 AM | 8.3 | 8.3 | 32.8 | 28.2 | 1.8 | 3.0 |
| WSR16 | 20230708 | Sunny | Moderate | Mid-Flood | Surface | 1 | 10:28:00 AM | 9.1 | 8.3 | 32.8 | 28.9 | 2.5 | 2.5 |
| WSR16 | 20230708 | Sunny | Moderate | Mid-Flood | Surface | 1 | 10:28:00 AM | 9.0 | 8.3 | 32.6 | 28.8 | 2.4 | 2.5 |
| WSR16 | 20230708 | Sunny | Moderate | Mid-Flood | Middle | 8 | 10:27:00 AM | 9.0 | 8.4 | 32.6 | 28.8 | 1.9 | 2.5 |
| WSR16 | 20230708 | Sunny | Moderate | Mid-Flood | Middle | 8 | 10:27:00 AM | 9.0 | 8.4 | 32.6 | 28.9 | 2.3 | 2.5 |
| WSR16 | 20230708 | Sunny | Moderate | Mid-Flood | Bottom | 15 | 10:26:00 AM | 9.2 | 8.3 | 32.6 | 28.8 | 2.0 | 2.5 |
| WSR16 | 20230708 | Sunny | Moderate | Mid-Flood | Bottom | 15 | 10:26:00 AM | 9.1 | 8.4 | 32.7 | 28.9 | 2.1 | 2.5 |
| WSR33 | 20230708 | Sunny | Moderate | Mid-Flood | Surface | 1 | 9:34:00 AM | 8.5 | 8.3 | 32.3 | 28.4 | 2.5 | 2.5 |
| WSR33 | 20230708 | Sunny | Moderate | Mid-Flood | Surface | 1 | 9:34:00 AM | 8.4 | 8.3 | 32.4 | 28.3 | 2.4 | 2.5 |
| WSR33 | 20230708 | Sunny | Moderate | Mid-Flood | Middle | 4 | 9:33:00 AM | 8.5 | 8.4 | 32.3 | 28.4 | 2.4 | 2.5 |
| WSR33 | 20230708 | Sunny | Moderate | Mid-Flood | Middle | 4 | 9:33:00 AM | 8.6 | 8.4 | 32.4 | 28.4 | 2.3 | 2.5 |
| WSR33 | 20230708 | Sunny | Moderate | Mid-Flood | Bottom | 6 | 9:32:00 AM | 8.4 | 8.3 | 32.3 | 28.4 | 2.3 | 2.5 |
| WSR33 | 20230708 | Sunny | Moderate | Mid-Flood | Bottom | 6 | 9:32:00 AM | 8.5 | 8.3 | 32.3 | 28.4 | 2.4 | 2.5 |
| WSR36 | 20230708 | Sunny | Moderate | Mid-Flood | Surface | 1 | 9:47:00 AM | 8.7 | 8.3 | 31.9 | 28.6 | 2.5 | 2.5 |
| WSR36 | 20230708 | Sunny | Moderate | Mid-Flood | Surface | 1 | 9:47:00 AM | 8.6 | 8.3 | 31.9 | 28.5 | 2.5 | 3.0 |
| WSR36 | 20230708 | Sunny | Moderate | Mid-Flood | Middle | 3 | 9:47:00 AM | 8.6 | 8.3 | 31.8 | 28.6 | 2.4 | 2.5 |
| WSR36 | 20230708 | Sunny | Moderate | Mid-Flood | Middle | 3 | 9:47:00 AM | 8.5 | 8.3 | 31.9 | 28.6 | 2.4 | 3.0 |
| WSR36 | 20230708 | Sunny | Moderate | Mid-Flood | Bottom | 6 | 9:46:00 AM | 8.5 | 8.3 | 31.8 | 28.6 | 2.2 | 3.0 |
| WSR36 | 20230708 | Sunny | Moderate | Mid-Flood | Bottom | 6 | 9:46:00 AM | 8.6 | 8.3 | 32.0 | 28.5 | 2.4 | 3.0 |
| WSR37 | 20230708 | Sunny | Moderate | Mid-Flood | Surface | 1 | 10:05:00 AM | 9.1 | 8.2 | 32.5 | 28.6 | 2.4 | 2.5 |
| WSR37 | 20230708 | Sunny | Moderate | Mid-Flood | Surface | 1 | 10:05:00 AM | 9.1 | 8.2 | 32.4 | 28.6 | 2.2 | 2.5 |
| WSR37 | 20230708 | Sunny | Moderate | Mid-Flood | Middle | 4 | 10:04:00 AM | 9.1 | 8.2 | 32.5 | 28.6 | 2.3 | 3.0 |
| WSR37 | 20230708 | Sunny | Moderate | Mid-Flood | Middle | 4 | 10:04:00 AM | 9.0 | 8.2 | 32.5 | 28.6 | 2.4 | 2.5 |
| WSR37 | 20230708 | Sunny | Moderate | Mid-Flood | Bottom | 8 | 10:03:00 AM | 9.1 | 8.2 | 32.6 | 28.5 | 2.3 | 3.0 |
| WSR37 | 20230708 | Sunny | Moderate | Mid-Flood | Bottom | 8 | 10:03:00 AM | 9.1 | 8.2 | 32.4 | 28.5 | 2.2 | 2.5 |

| Location | Date | Weather | Sea Condition | Tidal | Water Level | Depth (m) | Time | DO (mg/L) | pH | Sal (ppt) | Temp (oC) | Turbidity (NTU) | Suspended Solids (mg/L) |
|----------|----------|---------|---------------|-----------|-------------|-----------|-------------|-----------|-----|-----------|-----------|-----------------|-------------------------|
| CE | 20230710 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 12:41:00 PM | 9.2 | 8.3 | 31.8 | 28.6 | 2.7 | 6.0 |
| CE | 20230710 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 12:41:00 PM | 9.4 | 8.3 | 31.9 | 28.7 | 2.5 | 4.0 |
| CE | 20230710 | Cloudy | Moderate | Mid-Flood | Middle | 12 | 12:40:00 PM | 9.4 | 8.3 | 31.9 | 28.6 | 2.8 | 6.0 |
| CE | 20230710 | Cloudy | Moderate | Mid-Flood | Middle | 12 | 12:40:00 PM | 9.3 | 8.3 | 31.8 | 28.7 | 2.9 | 5.0 |
| CE | 20230710 | Cloudy | Moderate | Mid-Flood | Bottom | 24 | 12:39:00 PM | 9.3 | 8.3 | 31.7 | 28.6 | 2.7 | 2.5 |
| CE | 20230710 | Cloudy | Moderate | Mid-Flood | Bottom | 24 | 12:39:00 PM | 9.3 | 8.3 | 31.8 | 28.6 | 2.7 | 4.0 |
| CF | 20230710 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 9:52:00 AM | 9.1 | 8.3 | 31.6 | 28.4 | 3.2 | 3.0 |
| CF | 20230710 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 9:52:00 AM | 9.2 | 8.3 | 31.6 | 28.3 | 3.2 | 4.0 |
| CF | 20230710 | Cloudy | Moderate | Mid-Flood | Middle | 10 | 9:51:00 AM | 9.3 | 8.2 | 31.6 | 28.3 | 3.0 | 4.0 |
| CF | 20230710 | Cloudy | Moderate | Mid-Flood | Middle | 10 | 9:51:00 AM | 9.2 | 8.2 | 31.6 | 28.4 | 3.0 | 5.0 |
| CF | 20230710 | Cloudy | Moderate | Mid-Flood | Bottom | 19 | 9:50:00 AM | 9.2 | 8.2 | 31.7 | 28.4 | 3.3 | 4.0 |
| CF | 20230710 | Cloudy | Moderate | Mid-Flood | Bottom | 19 | 9:50:00 AM | 9.0 | 8.3 | 31.7 | 28.3 | 3.0 | 2.5 |
| WSR01 | 20230710 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 10:16:00 AM | 9.1 | 8.4 | 32.0 | 28.1 | 2.4 | 2.5 |
| WSR01 | 20230710 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 10:16:00 AM | 9.2 | 8.4 | 32.0 | 28.1 | 2.1 | 2.5 |
| WSR01 | 20230710 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 10:15:00 AM | 9.2 | 8.3 | 31.9 | 28.1 | 2.3 | 2.5 |
| WSR01 | 20230710 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 10:15:00 AM | 9.0 | 8.3 | 32.1 | 28.2 | 2.3 | 2.5 |
| WSR01 | 20230710 | Cloudy | Moderate | Mid-Flood | Bottom | 7 | 10:14:00 AM | 9.1 | 8.3 | 32.1 | 28.1 | 1.8 | 2.5 |
| WSR01 | 20230710 | Cloudy | Moderate | Mid-Flood | Bottom | 7 | 10:14:00 AM | 9.0 | 8.3 | 32.0 | 28.1 | 2.0 | 2.5 |
| WSR02 | 20230710 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 10:37:00 AM | 9.3 | 8.2 | 31.1 | 28.4 | 2.0 | 2.5 |
| WSR02 | 20230710 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 10:37:00 AM | 9.3 | 8.2 | 31.1 | 28.4 | 2.1 | 2.5 |
| WSR02 | 20230710 | Cloudy | Moderate | Mid-Flood | Middle | 5 | 10:36:00 AM | 9.2 | 8.3 | 31.0 | 28.4 | 2.1 | 2.5 |
| WSR02 | 20230710 | Cloudy | Moderate | Mid-Flood | Middle | 5 | 10:36:00 AM | 9.5 | 8.3 | 31.1 | 28.4 | 2.3 | 2.5 |
| WSR02 | 20230710 | Cloudy | Moderate | Mid-Flood | Bottom | 8 | 10:35:00 AM | 9.4 | 8.3 | 31.2 | 28.3 | 1.9 | 2.5 |
| WSR02 | 20230710 | Cloudy | Moderate | Mid-Flood | Bottom | 8 | 10:35:00 AM | 9.5 | 8.3 | 31.1 | 28.3 | 2.2 | 5.0 |
| WSR03 | 20230710 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 10:53:00 AM | 9.1 | 8.4 | 31.3 | 28.0 | 2.4 | 2.5 |
| WSR03 | 20230710 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 10:53:00 AM | 8.9 | 8.4 | 31.3 | 28.0 | 2.4 | 3.0 |
| WSR03 | 20230710 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 10:52:00 AM | 8.9 | 8.3 | 31.2 | 28.1 | 2.4 | 2.5 |
| WSR03 | 20230710 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 10:52:00 AM | 9.1 | 8.4 | 31.3 | 28.0 | 2.4 | 2.5 |
| WSR03 | 20230710 | Cloudy | Moderate | Mid-Flood | Bottom | 7 | 10:51:00 AM | 9.0 | 8.4 | 31.3 | 28.1 | 1.9 | 2.5 |
| WSR03 | 20230710 | Cloudy | Moderate | Mid-Flood | Bottom | 7 | 10:51:00 AM | 9.0 | 8.4 | 31.2 | 28.1 | 2.1 | 2.5 |

| Location | Date | Weather | Sea Condition | Tidal | Water Level | Depth (m) | Time | DO (mg/L) | pH | Sal (ppt) | Temp (oC) | Turbidity (NTU) | Suspended Solids (mg/L) |
|----------|----------|---------|---------------|-----------|-------------|-----------|-------------|-----------|-----|-----------|-----------|-----------------|-------------------------|
| WSR04 | 20230710 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 11:07:00 AM | 8.8 | 8.2 | 31.2 | 28.6 | 2.3 | 3.0 |
| WSR04 | 20230710 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 11:07:00 AM | 8.7 | 8.3 | 31.2 | 28.6 | 2.6 | 3.0 |
| WSR04 | 20230710 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 11:06:00 AM | 8.8 | 8.2 | 31.2 | 28.7 | 2.4 | 3.0 |
| WSR04 | 20230710 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 11:06:00 AM | 8.8 | 8.2 | 31.3 | 28.6 | 2.5 | 2.5 |
| WSR04 | 20230710 | Cloudy | Moderate | Mid-Flood | Bottom | 7 | 11:05:00 AM | 8.7 | 8.2 | 31.2 | 28.6 | 2.0 | 4.0 |
| WSR04 | 20230710 | Cloudy | Moderate | Mid-Flood | Bottom | 7 | 11:05:00 AM | 8.8 | 8.2 | 31.2 | 28.6 | 2.1 | 2.5 |
| WSR16 | 20230710 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 12:17:00 PM | 8.2 | 8.3 | 31.7 | 28.6 | 2.1 | 2.5 |
| WSR16 | 20230710 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 12:17:00 PM | 8.3 | 8.3 | 31.7 | 28.5 | 2.4 | 2.5 |
| WSR16 | 20230710 | Cloudy | Moderate | Mid-Flood | Middle | 8 | 12:16:00 PM | 8.4 | 8.3 | 31.8 | 28.6 | 2.0 | 4.0 |
| WSR16 | 20230710 | Cloudy | Moderate | Mid-Flood | Middle | 8 | 12:16:00 PM | 8.5 | 8.4 | 31.7 | 28.6 | 2.3 | 2.5 |
| WSR16 | 20230710 | Cloudy | Moderate | Mid-Flood | Bottom | 15 | 12:15:00 PM | 8.3 | 8.3 | 31.8 | 28.6 | 2.0 | 2.5 |
| WSR16 | 20230710 | Cloudy | Moderate | Mid-Flood | Bottom | 15 | 12:15:00 PM | 8.3 | 8.3 | 31.8 | 28.6 | 2.4 | 2.5 |
| WSR33 | 20230710 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 11:24:00 AM | 8.5 | 8.4 | 31.9 | 28.0 | 2.5 | 2.5 |
| WSR33 | 20230710 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 11:24:00 AM | 8.6 | 8.4 | 32.0 | 28.0 | 2.2 | 2.5 |
| WSR33 | 20230710 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 11:23:00 AM | 8.7 | 8.3 | 31.9 | 27.9 | 2.0 | 2.5 |
| WSR33 | 20230710 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 11:23:00 AM | 8.7 | 8.4 | 31.8 | 27.9 | 2.0 | 2.5 |
| WSR33 | 20230710 | Cloudy | Moderate | Mid-Flood | Bottom | 7 | 11:22:00 AM | 8.6 | 8.3 | 32.0 | 28.0 | 2.2 | 2.5 |
| WSR33 | 20230710 | Cloudy | Moderate | Mid-Flood | Bottom | 7 | 11:22:00 AM | 8.8 | 8.3 | 31.8 | 28.0 | 2.2 | 2.5 |
| WSR36 | 20230710 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 11:37:00 AM | 9.4 | 8.4 | 32.1 | 28.3 | 2.2 | 2.5 |
| WSR36 | 20230710 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 11:37:00 AM | 9.4 | 8.3 | 32.2 | 28.3 | 2.5 | 2.5 |
| WSR36 | 20230710 | Cloudy | Moderate | Mid-Flood | Middle | 3 | 11:37:00 AM | 9.4 | 8.4 | 32.1 | 28.3 | 2.3 | 2.5 |
| WSR36 | 20230710 | Cloudy | Moderate | Mid-Flood | Middle | 3 | 11:37:00 AM | 9.2 | 8.3 | 32.2 | 28.3 | 2.4 | 3.0 |
| WSR36 | 20230710 | Cloudy | Moderate | Mid-Flood | Bottom | 5 | 11:36:00 AM | 9.2 | 8.4 | 32.2 | 28.3 | 1.9 | 2.5 |
| WSR36 | 20230710 | Cloudy | Moderate | Mid-Flood | Bottom | 5 | 11:36:00 AM | 9.2 | 8.4 | 32.2 | 28.3 | 2.2 | 2.5 |
| WSR37 | 20230710 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 11:55:00 AM | 8.4 | 8.2 | 31.6 | 28.3 | 2.5 | 2.5 |
| WSR37 | 20230710 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 11:55:00 AM | 8.4 | 8.2 | 31.8 | 28.4 | 2.4 | 3.0 |
| WSR37 | 20230710 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 11:54:00 AM | 8.5 | 8.2 | 31.7 | 28.3 | 2.1 | 2.5 |
| WSR37 | 20230710 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 11:54:00 AM | 8.4 | 8.2 | 31.8 | 28.4 | 2.3 | 2.5 |
| WSR37 | 20230710 | Cloudy | Moderate | Mid-Flood | Bottom | 7 | 11:53:00 AM | 8.4 | 8.2 | 31.7 | 28.3 | 2.0 | 2.5 |
| WSR37 | 20230710 | Cloudy | Moderate | Mid-Flood | Bottom | 7 | 11:53:00 AM | 8.4 | 8.2 | 31.8 | 28.4 | 2.3 | 2.5 |

| Location | Date | Weather | Sea Condition | Tidal | Water Level | Depth (m) | Time | DO (mg/L) | pH | Sal (ppt) | Temp (oC) | Turbidity (NTU) | Suspended Solids (mg/L) |
|----------|----------|---------|---------------|-----------|-------------|-----------|-------------|-----------|-----|-----------|-----------|-----------------|-------------------------|
| CE | 20230712 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 3:41:00 PM | 9.3 | 8.2 | 33.6 | 27.8 | 2.7 | 2.5 |
| CE | 20230712 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 3:41:00 PM | 9.4 | 8.3 | 33.7 | 27.8 | 2.7 | 2.5 |
| CE | 20230712 | Cloudy | Moderate | Mid-Flood | Middle | 11 | 3:40:00 PM | 9.4 | 8.2 | 33.6 | 27.9 | 2.8 | 5.0 |
| CE | 20230712 | Cloudy | Moderate | Mid-Flood | Middle | 11 | 3:40:00 PM | 9.3 | 8.3 | 33.5 | 27.8 | 2.7 | 7.0 |
| CE | 20230712 | Cloudy | Moderate | Mid-Flood | Bottom | 20 | 3:39:00 PM | 9.3 | 8.3 | 33.7 | 27.7 | 2.6 | 5.0 |
| CE | 20230712 | Cloudy | Moderate | Mid-Flood | Bottom | 20 | 3:39:00 PM | 9.4 | 8.2 | 33.5 | 27.9 | 2.7 | 8.0 |
| CF | 20230712 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 12:58:00 PM | 9.2 | 8.3 | 32.6 | 27.8 | 2.8 | 2.5 |
| CF | 20230712 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 12:58:00 PM | 9.2 | 8.4 | 32.8 | 27.8 | 2.9 | 2.5 |
| CF | 20230712 | Cloudy | Moderate | Mid-Flood | Middle | 10 | 12:57:00 PM | 9.3 | 8.4 | 32.7 | 27.7 | 3.1 | 5.0 |
| CF | 20230712 | Cloudy | Moderate | Mid-Flood | Middle | 10 | 12:57:00 PM | 9.2 | 8.4 | 32.9 | 27.8 | 3.0 | 6.0 |
| CF | 20230712 | Cloudy | Moderate | Mid-Flood | Bottom | 19 | 12:56:00 PM | 9.2 | 8.4 | 32.8 | 27.8 | 3.2 | 2.5 |
| CF | 20230712 | Cloudy | Moderate | Mid-Flood | Bottom | 19 | 12:56:00 PM | 9.3 | 8.4 | 32.7 | 27.7 | 3.2 | 2.5 |
| WSR01 | 20230712 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 1:21:00 PM | 8.6 | 8.4 | 32.5 | 27.8 | 2.1 | 3.0 |
| WSR01 | 20230712 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 1:21:00 PM | 8.7 | 8.4 | 32.5 | 27.8 | 2.3 | 4.0 |
| WSR01 | 20230712 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 1:20:00 PM | 8.6 | 8.3 | 32.6 | 27.9 | 2.2 | 4.0 |
| WSR01 | 20230712 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 1:20:00 PM | 8.7 | 8.4 | 32.6 | 27.8 | 2.5 | 5.0 |
| WSR01 | 20230712 | Cloudy | Moderate | Mid-Flood | Bottom | 8 | 1:19:00 PM | 8.7 | 8.4 | 32.7 | 27.8 | 2.0 | 4.0 |
| WSR01 | 20230712 | Cloudy | Moderate | Mid-Flood | Bottom | 8 | 1:19:00 PM | 8.7 | 8.4 | 32.6 | 27.7 | 2.3 | 3.0 |
| WSR02 | 20230712 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 1:40:00 PM | 8.9 | 8.4 | 33.0 | 27.8 | 2.4 | 5.0 |
| WSR02 | 20230712 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 1:40:00 PM | 8.8 | 8.4 | 32.9 | 27.8 | 2.5 | 3.0 |
| WSR02 | 20230712 | Cloudy | Moderate | Mid-Flood | Middle | 5 | 1:39:00 PM | 8.9 | 8.3 | 32.9 | 27.8 | 2.0 | 2.5 |
| WSR02 | 20230712 | Cloudy | Moderate | Mid-Flood | Middle | 5 | 1:39:00 PM | 8.8 | 8.3 | 33.0 | 27.9 | 2.3 | 2.5 |
| WSR02 | 20230712 | Cloudy | Moderate | Mid-Flood | Bottom | 8 | 1:38:00 PM | 8.9 | 8.4 | 32.9 | 27.8 | 1.6 | 3.0 |
| WSR02 | 20230712 | Cloudy | Moderate | Mid-Flood | Bottom | 8 | 1:38:00 PM | 8.8 | 8.4 | 33.0 | 27.9 | 1.9 | 3.0 |
| WSR03 | 20230712 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 1:53:00 PM | 9.4 | 8.3 | 32.9 | 27.8 | 2.0 | 5.0 |
| WSR03 | 20230712 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 1:53:00 PM | 9.4 | 8.3 | 32.6 | 27.9 | 2.3 | 2.5 |
| WSR03 | 20230712 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 1:52:00 PM | 9.4 | 8.4 | 32.6 | 27.8 | 2.1 | 2.5 |
| WSR03 | 20230712 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 1:52:00 PM | 9.4 | 8.4 | 32.7 | 27.7 | 2.2 | 2.5 |
| WSR03 | 20230712 | Cloudy | Moderate | Mid-Flood | Bottom | 7 | 1:51:00 PM | 9.3 | 8.4 | 32.8 | 27.8 | 1.4 | 5.0 |
| WSR03 | 20230712 | Cloudy | Moderate | Mid-Flood | Bottom | 7 | 1:51:00 PM | 9.4 | 8.4 | 32.8 | 27.8 | 1.7 | 4.0 |

| Location | Date | Weather | Sea Condition | Tidal | Water Level | Depth (m) | Time | DO (mg/L) | pH | Sal (ppt) | Temp (oC) | Turbidity (NTU) | Suspended Solids (mg/L) |
|----------|----------|---------|---------------|-----------|-------------|-----------|------------|-----------|-----|-----------|-----------|-----------------|-------------------------|
| WSR04 | 20230712 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 2:09:00 PM | 9.1 | 8.3 | 33.4 | 27.9 | 2.2 | 3.0 |
| WSR04 | 20230712 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 2:09:00 PM | 9.1 | 8.3 | 33.4 | 27.8 | 2.3 | 5.0 |
| WSR04 | 20230712 | Cloudy | Moderate | Mid-Flood | Middle | 3 | 2:08:00 PM | 9.1 | 8.3 | 33.3 | 27.8 | 2.4 | 5.0 |
| WSR04 | 20230712 | Cloudy | Moderate | Mid-Flood | Middle | 3 | 2:08:00 PM | 9.2 | 8.3 | 33.5 | 27.9 | 2.4 | 4.0 |
| WSR04 | 20230712 | Cloudy | Moderate | Mid-Flood | Bottom | 6 | 2:07:00 PM | 9.1 | 8.3 | 33.5 | 27.8 | 1.9 | 3.0 |
| WSR04 | 20230712 | Cloudy | Moderate | Mid-Flood | Bottom | 6 | 2:07:00 PM | 9.1 | 8.3 | 33.6 | 27.7 | 2.3 | 3.0 |
| WSR16 | 20230712 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 3:17:00 PM | 8.4 | 8.3 | 33.4 | 27.7 | 2.1 | 4.0 |
| WSR16 | 20230712 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 3:17:00 PM | 8.4 | 8.4 | 33.7 | 27.9 | 2.5 | 2.5 |
| WSR16 | 20230712 | Cloudy | Moderate | Mid-Flood | Middle | 8 | 3:16:00 PM | 8.5 | 8.3 | 33.7 | 27.9 | 2.1 | 4.0 |
| WSR16 | 20230712 | Cloudy | Moderate | Mid-Flood | Middle | 8 | 3:16:00 PM | 8.4 | 8.3 | 33.4 | 27.9 | 2.4 | 6.0 |
| WSR16 | 20230712 | Cloudy | Moderate | Mid-Flood | Bottom | 14 | 3:15:00 PM | 8.3 | 8.4 | 33.5 | 27.8 | 2.0 | 2.5 |
| WSR16 | 20230712 | Cloudy | Moderate | Mid-Flood | Bottom | 14 | 3:15:00 PM | 8.5 | 8.4 | 33.7 | 27.8 | 2.4 | 4.0 |
| WSR33 | 20230712 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 2:23:00 PM | 9.0 | 8.2 | 32.9 | 27.8 | 2.2 | 4.0 |
| WSR33 | 20230712 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 2:23:00 PM | 9.2 | 8.3 | 33.1 | 27.9 | 2.0 | 4.0 |
| WSR33 | 20230712 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 2:22:00 PM | 9.2 | 8.3 | 33.1 | 27.8 | 2.1 | 3.0 |
| WSR33 | 20230712 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 2:22:00 PM | 9.2 | 8.2 | 33.1 | 27.8 | 2.4 | 3.0 |
| WSR33 | 20230712 | Cloudy | Moderate | Mid-Flood | Bottom | 7 | 2:21:00 PM | 9.1 | 8.3 | 32.9 | 27.9 | 1.9 | 2.5 |
| WSR33 | 20230712 | Cloudy | Moderate | Mid-Flood | Bottom | 7 | 2:21:00 PM | 9.1 | 8.3 | 33.1 | 27.8 | 2.2 | 2.5 |
| WSR36 | 20230712 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 2:39:00 PM | 8.6 | 8.3 | 32.7 | 27.8 | 2.0 | 2.5 |
| WSR36 | 20230712 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 2:39:00 PM | 8.6 | 8.2 | 32.6 | 27.8 | 2.2 | 2.5 |
| WSR36 | 20230712 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 2:39:00 PM | 8.7 | 8.3 | 32.7 | 27.9 | 2.0 | 4.0 |
| WSR36 | 20230712 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 2:39:00 PM | 8.6 | 8.2 | 32.8 | 27.9 | 2.1 | 2.5 |
| WSR36 | 20230712 | Cloudy | Moderate | Mid-Flood | Bottom | 6 | 2:38:00 PM | 8.5 | 8.2 | 32.7 | 27.8 | 2.2 | 3.0 |
| WSR36 | 20230712 | Cloudy | Moderate | Mid-Flood | Bottom | 6 | 2:38:00 PM | 8.7 | 8.2 | 32.8 | 27.8 | 2.3 | 3.0 |
| WSR37 | 20230712 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 2:54:00 PM | 9.4 | 8.3 | 33.6 | 27.9 | 2.3 | 2.5 |
| WSR37 | 20230712 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 2:54:00 PM | 9.3 | 8.2 | 33.8 | 27.9 | 2.0 | 2.5 |
| WSR37 | 20230712 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 2:53:00 PM | 9.4 | 8.2 | 33.7 | 27.8 | 2.3 | 2.5 |
| WSR37 | 20230712 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 2:53:00 PM | 9.4 | 8.3 | 33.7 | 27.8 | 2.1 | 3.0 |
| WSR37 | 20230712 | Cloudy | Moderate | Mid-Flood | Bottom | 8 | 2:52:00 PM | 9.5 | 8.3 | 33.7 | 27.9 | 2.0 | 2.5 |
| WSR37 | 20230712 | Cloudy | Moderate | Mid-Flood | Bottom | 8 | 2:52:00 PM | 9.4 | 8.2 | 33.7 | 27.8 | 2.4 | 3.0 |

| Location | Date | Weather | Sea Condition | Tidal | Water Level | Depth (m) | Time | DO (mg/L) | pH | Sal (ppt) | Temp (oC) | Turbidity (NTU) | Suspended Solids (mg/L) |
|----------|----------|---------|---------------|-----------|-------------|-----------|------------|-----------|-----|-----------|-----------|-----------------|-------------------------|
| CE | 20230714 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 5:09:00 PM | 9.2 | 8.3 | 32.5 | 27.8 | 2.9 | 2.5 |
| CE | 20230714 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 5:09:00 PM | 9.3 | 8.3 | 32.4 | 27.7 | 2.9 | 2.5 |
| CE | 20230714 | Cloudy | Moderate | Mid-Flood | Middle | 12 | 5:08:00 PM | 9.4 | 8.3 | 32.5 | 27.8 | 2.7 | 2.5 |
| CE | 20230714 | Cloudy | Moderate | Mid-Flood | Middle | 12 | 5:08:00 PM | 9.3 | 8.3 | 32.5 | 27.7 | 2.8 | 2.5 |
| CE | 20230714 | Cloudy | Moderate | Mid-Flood | Bottom | 23 | 5:07:00 PM | 9.3 | 8.3 | 32.5 | 27.7 | 2.7 | 2.5 |
| CE | 20230714 | Cloudy | Moderate | Mid-Flood | Bottom | 23 | 5:07:00 PM | 9.4 | 8.3 | 32.4 | 27.7 | 2.8 | 2.5 |
| CF | 20230714 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 2:20:00 PM | 8.2 | 8.2 | 32.9 | 28.1 | 3.1 | 2.5 |
| CF | 20230714 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 2:20:00 PM | 8.2 | 8.2 | 32.8 | 28.1 | 3.3 | 2.5 |
| CF | 20230714 | Cloudy | Moderate | Mid-Flood | Middle | 10 | 2:19:00 PM | 8.3 | 8.2 | 32.7 | 28.1 | 3.0 | 2.5 |
| CF | 20230714 | Cloudy | Moderate | Mid-Flood | Middle | 10 | 2:19:00 PM | 8.2 | 8.2 | 32.8 | 28.0 | 3.1 | 2.5 |
| CF | 20230714 | Cloudy | Moderate | Mid-Flood | Bottom | 19 | 2:18:00 PM | 8.3 | 8.2 | 32.9 | 28.1 | 3.3 | 2.5 |
| CF | 20230714 | Cloudy | Moderate | Mid-Flood | Bottom | 19 | 2:18:00 PM | 8.3 | 8.2 | 32.7 | 28.0 | 3.2 | 2.5 |
| WSR01 | 20230714 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 2:44:00 PM | 8.9 | 8.2 | 33.5 | 27.7 | 2.3 | 2.5 |
| WSR01 | 20230714 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 2:44:00 PM | 8.9 | 8.2 | 33.3 | 27.7 | 2.4 | 2.5 |
| WSR01 | 20230714 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 2:43:00 PM | 8.8 | 8.2 | 33.4 | 27.7 | 1.9 | 2.5 |
| WSR01 | 20230714 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 2:43:00 PM | 8.9 | 8.2 | 33.6 | 27.8 | 2.1 | 2.5 |
| WSR01 | 20230714 | Cloudy | Moderate | Mid-Flood | Bottom | 8 | 2:42:00 PM | 8.8 | 8.2 | 33.6 | 27.7 | 2.0 | 2.5 |
| WSR01 | 20230714 | Cloudy | Moderate | Mid-Flood | Bottom | 8 | 2:42:00 PM | 8.9 | 8.2 | 33.6 | 27.7 | 2.1 | 2.5 |
| WSR02 | 20230714 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 3:05:00 PM | 9.1 | 8.3 | 32.6 | 28.1 | 1.9 | 2.5 |
| WSR02 | 20230714 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 3:05:00 PM | 9.0 | 8.2 | 32.4 | 28.1 | 2.2 | 2.5 |
| WSR02 | 20230714 | Cloudy | Moderate | Mid-Flood | Middle | 5 | 3:04:00 PM | 9.0 | 8.3 | 32.6 | 28.0 | 1.9 | 2.5 |
| WSR02 | 20230714 | Cloudy | Moderate | Mid-Flood | Middle | 5 | 3:04:00 PM | 9.0 | 8.3 | 32.5 | 28.1 | 1.9 | 2.5 |
| WSR02 | 20230714 | Cloudy | Moderate | Mid-Flood | Bottom | 9 | 3:03:00 PM | 9.0 | 8.2 | 32.6 | 28.1 | 1.7 | 2.5 |
| WSR02 | 20230714 | Cloudy | Moderate | Mid-Flood | Bottom | 9 | 3:03:00 PM | 9.1 | 8.3 | 32.6 | 28.1 | 1.8 | 2.5 |
| WSR03 | 20230714 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 3:19:00 PM | 9.3 | 8.2 | 33.3 | 28.0 | 1.9 | 2.5 |
| WSR03 | 20230714 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 3:19:00 PM | 9.3 | 8.2 | 33.2 | 28.1 | 2.0 | 2.5 |
| WSR03 | 20230714 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 3:18:00 PM | 9.3 | 8.2 | 33.4 | 28.0 | 1.8 | 2.5 |
| WSR03 | 20230714 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 3:18:00 PM | 9.3 | 8.3 | 33.2 | 28.1 | 2.0 | 2.5 |
| WSR03 | 20230714 | Cloudy | Moderate | Mid-Flood | Bottom | 7 | 3:17:00 PM | 9.3 | 8.2 | 33.3 | 28.0 | 2.0 | 2.5 |
| WSR03 | 20230714 | Cloudy | Moderate | Mid-Flood | Bottom | 7 | 3:17:00 PM | 9.3 | 8.2 | 33.2 | 28.0 | 2.1 | 2.5 |

| Location | Date | Weather | Sea Condition | Tidal | Water Level | Depth (m) | Time | DO (mg/L) | pH | Sal (ppt) | Temp (oC) | Turbidity (NTU) | Suspended Solids (mg/L) |
|----------|----------|---------|---------------|-----------|-------------|-----------|------------|-----------|-----|-----------|-----------|-----------------|-------------------------|
| WSR04 | 20230714 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 3:33:00 PM | 9.0 | 8.3 | 33.1 | 28.2 | 2.2 | 2.5 |
| WSR04 | 20230714 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 3:33:00 PM | 8.9 | 8.3 | 33.2 | 28.3 | 2.3 | 2.5 |
| WSR04 | 20230714 | Cloudy | Moderate | Mid-Flood | Middle | 3 | 3:32:00 PM | 9.0 | 8.3 | 33.1 | 28.1 | 1.9 | 2.5 |
| WSR04 | 20230714 | Cloudy | Moderate | Mid-Flood | Middle | 3 | 3:32:00 PM | 9.0 | 8.3 | 33.0 | 28.1 | 2.1 | 2.5 |
| WSR04 | 20230714 | Cloudy | Moderate | Mid-Flood | Bottom | 6 | 3:31:00 PM | 8.9 | 8.3 | 33.0 | 28.2 | 1.9 | 2.5 |
| WSR04 | 20230714 | Cloudy | Moderate | Mid-Flood | Bottom | 6 | 3:31:00 PM | 8.9 | 8.3 | 33.0 | 28.2 | 2.1 | 2.5 |
| WSR16 | 20230714 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 4:45:00 PM | 8.4 | 8.2 | 33.3 | 28.4 | 2.4 | 2.5 |
| WSR16 | 20230714 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 4:45:00 PM | 8.4 | 8.2 | 33.1 | 28.5 | 2.5 | 2.5 |
| WSR16 | 20230714 | Cloudy | Moderate | Mid-Flood | Middle | 8 | 4:44:00 PM | 8.4 | 8.2 | 33.3 | 28.4 | 2.2 | 2.5 |
| WSR16 | 20230714 | Cloudy | Moderate | Mid-Flood | Middle | 8 | 4:44:00 PM | 8.3 | 8.2 | 33.1 | 28.4 | 2.3 | 2.5 |
| WSR16 | 20230714 | Cloudy | Moderate | Mid-Flood | Bottom | 15 | 4:43:00 PM | 8.3 | 8.2 | 33.3 | 28.5 | 2.2 | 2.5 |
| WSR16 | 20230714 | Cloudy | Moderate | Mid-Flood | Bottom | 15 | 4:43:00 PM | 8.4 | 8.2 | 33.3 | 28.5 | 2.2 | 2.5 |
| WSR33 | 20230714 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 3:48:00 PM | 8.5 | 8.3 | 33.0 | 28.1 | 2.2 | 2.5 |
| WSR33 | 20230714 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 3:48:00 PM | 8.7 | 8.3 | 33.0 | 28.0 | 2.3 | 2.5 |
| WSR33 | 20230714 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 3:47:00 PM | 8.5 | 8.3 | 33.2 | 28.0 | 2.0 | 2.5 |
| WSR33 | 20230714 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 3:47:00 PM | 8.6 | 8.3 | 33.0 | 28.1 | 2.3 | 2.5 |
| WSR33 | 20230714 | Cloudy | Moderate | Mid-Flood | Bottom | 6 | 3:46:00 PM | 8.5 | 8.3 | 33.1 | 28.1 | 1.8 | 2.5 |
| WSR33 | 20230714 | Cloudy | Moderate | Mid-Flood | Bottom | 6 | 3:46:00 PM | 8.6 | 8.3 | 32.8 | 28.0 | 2.1 | 2.5 |
| WSR36 | 20230714 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 4:04:00 PM | 8.5 | 8.2 | 33.0 | 27.9 | 1.9 | 2.5 |
| WSR36 | 20230714 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 4:04:00 PM | 8.4 | 8.3 | 33.0 | 28.0 | 2.2 | 2.5 |
| WSR36 | 20230714 | Cloudy | Moderate | Mid-Flood | Middle | 3 | 4:04:00 PM | 8.4 | 8.3 | 32.9 | 27.9 | 2.1 | 2.5 |
| WSR36 | 20230714 | Cloudy | Moderate | Mid-Flood | Middle | 3 | 4:04:00 PM | 8.4 | 8.3 | 33.1 | 27.9 | 2.3 | 2.5 |
| WSR36 | 20230714 | Cloudy | Moderate | Mid-Flood | Bottom | 6 | 4:03:00 PM | 8.5 | 8.3 | 32.9 | 28.0 | 1.7 | 2.5 |
| WSR36 | 20230714 | Cloudy | Moderate | Mid-Flood | Bottom | 6 | 4:03:00 PM | 8.5 | 8.3 | 32.9 | 28.0 | 1.9 | 2.5 |
| WSR37 | 20230714 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 4:20:00 PM | 8.6 | 8.2 | 33.5 | 27.7 | 2.2 | 2.5 |
| WSR37 | 20230714 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 4:20:00 PM | 8.6 | 8.2 | 33.6 | 27.7 | 2.3 | 2.5 |
| WSR37 | 20230714 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 4:19:00 PM | 8.6 | 8.2 | 33.4 | 27.8 | 2.2 | 2.5 |
| WSR37 | 20230714 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 4:19:00 PM | 8.7 | 8.2 | 33.4 | 27.7 | 2.4 | 2.5 |
| WSR37 | 20230714 | Cloudy | Moderate | Mid-Flood | Bottom | 8 | 4:18:00 PM | 8.7 | 8.2 | 33.4 | 27.7 | 2.1 | 2.5 |
| WSR37 | 20230714 | Cloudy | Moderate | Mid-Flood | Bottom | 8 | 4:18:00 PM | 8.6 | 8.2 | 33.4 | 27.8 | 2.4 | 2.5 |

| Location | Date | Weather | Sea Condition | Tidal | Water Level | Depth (m) | Time | DO (mg/L) | pH | Sal (ppt) | Temp (oC) | Turbidity (NTU) | Suspended Solids (mg/L) |
|----------|----------|---------|---------------|-----------|-------------|-----------|------------|-----------|-----|-----------|-----------|-----------------|-------------------------|
| CE | 20230718 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 7:47:00 PM | 9.0 | 8.4 | 33.0 | 28.1 | 2.8 | 4.0 |
| CE | 20230718 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 7:47:00 PM | 8.9 | 8.4 | 33.1 | 28.0 | 2.8 | 5.0 |
| CE | 20230718 | Cloudy | Moderate | Mid-Flood | Middle | 11 | 7:46:00 PM | 8.9 | 8.4 | 32.9 | 28.0 | 2.8 | 5.0 |
| CE | 20230718 | Cloudy | Moderate | Mid-Flood | Middle | 11 | 7:46:00 PM | 9.1 | 8.4 | 33.1 | 28.0 | 2.8 | 5.0 |
| CE | 20230718 | Cloudy | Moderate | Mid-Flood | Bottom | 21 | 7:45:00 PM | 8.9 | 8.4 | 33.0 | 28.0 | 2.7 | 5.0 |
| CE | 20230718 | Cloudy | Moderate | Mid-Flood | Bottom | 21 | 7:45:00 PM | 9.0 | 8.4 | 33.0 | 28.0 | 2.7 | 6.0 |
| CF | 20230718 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 4:58:00 PM | 9.1 | 8.4 | 33.7 | 28.3 | 3.2 | 4.0 |
| CF | 20230718 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 4:58:00 PM | 9.1 | 8.4 | 33.8 | 28.4 | 3.2 | 6.0 |
| CF | 20230718 | Cloudy | Moderate | Mid-Flood | Middle | 11 | 4:57:00 PM | 9.0 | 8.4 | 33.7 | 28.3 | 3.2 | 7.0 |
| CF | 20230718 | Cloudy | Moderate | Mid-Flood | Middle | 11 | 4:57:00 PM | 9.1 | 8.4 | 33.7 | 28.4 | 3.3 | 4.0 |
| CF | 20230718 | Cloudy | Moderate | Mid-Flood | Bottom | 21 | 4:56:00 PM | 9.1 | 8.3 | 33.7 | 28.4 | 3.0 | 5.0 |
| CF | 20230718 | Cloudy | Moderate | Mid-Flood | Bottom | 21 | 4:56:00 PM | 9.2 | 8.4 | 33.7 | 28.4 | 3.1 | 7.0 |
| WSR01 | 20230718 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 5:22:00 PM | 8.5 | 8.3 | 33.6 | 28.6 | 2.1 | 5.0 |
| WSR01 | 20230718 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 5:22:00 PM | 8.6 | 8.3 | 33.5 | 28.5 | 2.4 | 4.0 |
| WSR01 | 20230718 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 5:21:00 PM | 8.7 | 8.4 | 33.6 | 28.5 | 2.2 | 5.0 |
| WSR01 | 20230718 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 5:21:00 PM | 8.6 | 8.4 | 33.6 | 28.5 | 2.4 | 4.0 |
| WSR01 | 20230718 | Cloudy | Moderate | Mid-Flood | Bottom | 8 | 5:20:00 PM | 8.7 | 8.3 | 33.5 | 28.5 | 1.9 | 5.0 |
| WSR01 | 20230718 | Cloudy | Moderate | Mid-Flood | Bottom | 8 | 5:20:00 PM | 8.6 | 8.4 | 33.6 | 28.5 | 2.0 | 6.0 |
| WSR02 | 20230718 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 5:41:00 PM | 9.6 | 8.2 | 33.5 | 27.8 | 2.4 | 6.0 |
| WSR02 | 20230718 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 5:41:00 PM | 9.6 | 8.2 | 33.4 | 27.9 | 2.4 | 7.0 |
| WSR02 | 20230718 | Cloudy | Moderate | Mid-Flood | Middle | 5 | 5:40:00 PM | 9.5 | 8.2 | 33.6 | 27.8 | 2.2 | 5.0 |
| WSR02 | 20230718 | Cloudy | Moderate | Mid-Flood | Middle | 5 | 5:40:00 PM | 9.6 | 8.2 | 33.5 | 27.8 | 2.3 | 3.0 |
| WSR02 | 20230718 | Cloudy | Moderate | Mid-Flood | Bottom | 8 | 5:39:00 PM | 9.4 | 8.2 | 33.5 | 27.8 | 2.1 | 2.5 |
| WSR02 | 20230718 | Cloudy | Moderate | Mid-Flood | Bottom | 8 | 5:39:00 PM | 9.6 | 8.2 | 33.5 | 27.9 | 2.3 | 2.5 |
| WSR03 | 20230718 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 5:57:00 PM | 9.0 | 8.4 | 32.6 | 27.9 | 2.1 | 3.0 |
| WSR03 | 20230718 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 5:57:00 PM | 8.9 | 8.4 | 32.7 | 27.8 | 2.4 | 4.0 |
| WSR03 | 20230718 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 5:56:00 PM | 9.1 | 8.3 | 32.8 | 27.9 | 2.1 | 4.0 |
| WSR03 | 20230718 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 5:56:00 PM | 8.9 | 8.4 | 32.7 | 27.8 | 2.1 | 5.0 |
| WSR03 | 20230718 | Cloudy | Moderate | Mid-Flood | Bottom | 7 | 5:55:00 PM | 8.9 | 8.4 | 32.7 | 27.9 | 1.8 | 4.0 |
| WSR03 | 20230718 | Cloudy | Moderate | Mid-Flood | Bottom | 7 | 5:55:00 PM | 8.9 | 8.4 | 32.7 | 27.9 | 2.1 | 5.0 |

| Location | Date | Weather | Sea Condition | Tidal | Water Level | Depth (m) | Time | DO (mg/L) | pH | Sal (ppt) | Temp (oC) | Turbidity (NTU) | Suspended Solids (mg/L) |
|----------|----------|---------|---------------|-----------|-------------|-----------|------------|-----------|-----|-----------|-----------|-----------------|-------------------------|
| WSR04 | 20230718 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 6:11:00 PM | 9.3 | 8.2 | 33.2 | 27.8 | 2.1 | 4.0 |
| WSR04 | 20230718 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 6:11:00 PM | 9.4 | 8.3 | 33.3 | 27.8 | 2.3 | 3.0 |
| WSR04 | 20230718 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 6:10:00 PM | 9.3 | 8.2 | 33.2 | 27.9 | 2.0 | 5.0 |
| WSR04 | 20230718 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 6:10:00 PM | 9.4 | 8.2 | 33.2 | 27.8 | 2.1 | 6.0 |
| WSR04 | 20230718 | Cloudy | Moderate | Mid-Flood | Bottom | 7 | 6:09:00 PM | 9.3 | 8.3 | 33.2 | 27.8 | 2.1 | 7.0 |
| WSR04 | 20230718 | Cloudy | Moderate | Mid-Flood | Bottom | 7 | 6:09:00 PM | 9.5 | 8.2 | 33.3 | 27.8 | 2.3 | 4.0 |
| WSR16 | 20230718 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 7:22:00 PM | 8.5 | 8.2 | 33.6 | 27.8 | 2.2 | 8.0 |
| WSR16 | 20230718 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 7:22:00 PM | 8.5 | 8.2 | 33.5 | 27.8 | 2.1 | 5.0 |
| WSR16 | 20230718 | Cloudy | Moderate | Mid-Flood | Middle | 8 | 7:21:00 PM | 8.5 | 8.2 | 33.5 | 27.8 | 2.3 | 5.0 |
| WSR16 | 20230718 | Cloudy | Moderate | Mid-Flood | Middle | 8 | 7:21:00 PM | 8.5 | 8.2 | 33.6 | 27.8 | 2.2 | 3.0 |
| WSR16 | 20230718 | Cloudy | Moderate | Mid-Flood | Bottom | 15 | 7:20:00 PM | 8.6 | 8.2 | 33.6 | 28.0 | 2.1 | 6.0 |
| WSR16 | 20230718 | Cloudy | Moderate | Mid-Flood | Bottom | 15 | 7:20:00 PM | 8.5 | 8.2 | 33.5 | 27.9 | 2.2 | 7.0 |
| WSR33 | 20230718 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 6:28:00 PM | 8.5 | 8.2 | 33.8 | 28.4 | 1.9 | 4.0 |
| WSR33 | 20230718 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 6:28:00 PM | 8.6 | 8.2 | 33.8 | 28.5 | 2.1 | 5.0 |
| WSR33 | 20230718 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 6:27:00 PM | 8.6 | 8.2 | 33.8 | 28.5 | 1.9 | 4.0 |
| WSR33 | 20230718 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 6:27:00 PM | 8.6 | 8.3 | 33.8 | 28.4 | 2.3 | 4.0 |
| WSR33 | 20230718 | Cloudy | Moderate | Mid-Flood | Bottom | 6 | 6:26:00 PM | 8.5 | 8.3 | 33.7 | 28.4 | 2.1 | 6.0 |
| WSR33 | 20230718 | Cloudy | Moderate | Mid-Flood | Bottom | 6 | 6:26:00 PM | 8.5 | 8.2 | 33.9 | 28.4 | 2.1 | 5.0 |
| WSR36 | 20230718 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 6:42:00 PM | 9.2 | 8.3 | 33.3 | 28.2 | 2.4 | 5.0 |
| WSR36 | 20230718 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 6:42:00 PM | 9.1 | 8.3 | 33.4 | 28.2 | 2.3 | 5.0 |
| WSR36 | 20230718 | Cloudy | Moderate | Mid-Flood | Middle | 3 | 6:42:00 PM | 9.2 | 8.3 | 33.4 | 28.2 | 2.3 | 7.0 |
| WSR36 | 20230718 | Cloudy | Moderate | Mid-Flood | Middle | 3 | 6:42:00 PM | 9.1 | 8.3 | 33.3 | 28.2 | 2.2 | 5.0 |
| WSR36 | 20230718 | Cloudy | Moderate | Mid-Flood | Bottom | 5 | 6:41:00 PM | 9.2 | 8.3 | 33.3 | 28.2 | 2.2 | 7.0 |
| WSR36 | 20230718 | Cloudy | Moderate | Mid-Flood | Bottom | 5 | 6:41:00 PM | 9.2 | 8.3 | 33.4 | 28.2 | 2.2 | 6.0 |
| WSR37 | 20230718 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 7:00:00 PM | 8.9 | 8.4 | 32.9 | 28.2 | 2.2 | 7.0 |
| WSR37 | 20230718 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 7:00:00 PM | 8.9 | 8.4 | 33.0 | 28.3 | 2.2 | 7.0 |
| WSR37 | 20230718 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 6:59:00 PM | 8.9 | 8.4 | 33.0 | 28.3 | 2.2 | 8.0 |
| WSR37 | 20230718 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 6:59:00 PM | 9.1 | 8.4 | 32.9 | 28.2 | 2.3 | 6.0 |
| WSR37 | 20230718 | Cloudy | Moderate | Mid-Flood | Bottom | 8 | 6:58:00 PM | 8.9 | 8.4 | 33.0 | 28.3 | 2.0 | 7.0 |
| WSR37 | 20230718 | Cloudy | Moderate | Mid-Flood | Bottom | 8 | 6:58:00 PM | 9.0 | 8.4 | 33.1 | 28.3 | 2.0 | 6.0 |

| Location | Date | Weather | Sea Condition | Tidal | Water Level | Depth (m) | Time | DO (mg/L) | pH | Sal (ppt) | Temp (oC) | Turbidity (NTU) | Suspended Solids (mg/L) |
|----------|----------|---------|---------------|-----------|-------------|-----------|-------------|-----------|-----|-----------|-----------|-----------------|-------------------------|
| CE | 20230720 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 10:50:00 AM | 9.2 | 8.2 | 33.8 | 28.0 | 2.4 | 2.5 |
| CE | 20230720 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 10:50:00 AM | 9.3 | 8.2 | 33.7 | 28.0 | 2.4 | 2.5 |
| CE | 20230720 | Cloudy | Moderate | Mid-Flood | Middle | 12 | 10:49:00 AM | 9.5 | 8.2 | 33.7 | 28.0 | 2.5 | 2.5 |
| CE | 20230720 | Cloudy | Moderate | Mid-Flood | Middle | 12 | 10:49:00 AM | 9.4 | 8.2 | 33.7 | 28.1 | 2.5 | 2.5 |
| CE | 20230720 | Cloudy | Moderate | Mid-Flood | Bottom | 22 | 10:48:00 AM | 9.2 | 8.2 | 33.8 | 27.9 | 2.7 | 2.5 |
| CE | 20230720 | Cloudy | Moderate | Mid-Flood | Bottom | 22 | 10:48:00 AM | 9.3 | 8.2 | 33.6 | 28.0 | 2.4 | 2.5 |
| CF | 20230720 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 8:02:00 AM | 9.5 | 8.2 | 33.6 | 28.1 | 3.1 | 2.5 |
| CF | 20230720 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 8:02:00 AM | 9.4 | 8.2 | 33.6 | 28.2 | 3.0 | 2.5 |
| CF | 20230720 | Cloudy | Moderate | Mid-Flood | Middle | 10 | 8:01:00 AM | 9.5 | 8.2 | 33.6 | 28.2 | 2.9 | 2.5 |
| CF | 20230720 | Cloudy | Moderate | Mid-Flood | Middle | 10 | 8:01:00 AM | 9.5 | 8.2 | 33.5 | 28.2 | 3.1 | 2.5 |
| CF | 20230720 | Cloudy | Moderate | Mid-Flood | Bottom | 19 | 8:00:00 AM | 9.3 | 8.2 | 33.5 | 28.1 | 2.9 | 2.5 |
| CF | 20230720 | Cloudy | Moderate | Mid-Flood | Bottom | 19 | 8:00:00 AM | 9.4 | 8.1 | 33.6 | 28.2 | 3.1 | 2.5 |
| WSR01 | 20230720 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 8:26:00 AM | 8.8 | 8.4 | 33.8 | 28.0 | 2.2 | 2.5 |
| WSR01 | 20230720 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 8:26:00 AM | 8.7 | 8.4 | 33.8 | 28.0 | 2.3 | 2.5 |
| WSR01 | 20230720 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 8:25:00 AM | 8.8 | 8.3 | 33.8 | 27.9 | 2.4 | 2.5 |
| WSR01 | 20230720 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 8:25:00 AM | 8.8 | 8.3 | 33.7 | 27.9 | 2.3 | 2.5 |
| WSR01 | 20230720 | Cloudy | Moderate | Mid-Flood | Bottom | 7 | 8:24:00 AM | 8.6 | 8.3 | 33.7 | 27.9 | 2.2 | 2.5 |
| WSR01 | 20230720 | Cloudy | Moderate | Mid-Flood | Bottom | 7 | 8:24:00 AM | 8.7 | 8.4 | 33.7 | 27.9 | 2.1 | 2.5 |
| WSR02 | 20230720 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 8:47:00 AM | 9.0 | 8.4 | 32.8 | 27.4 | 2.3 | 2.5 |
| WSR02 | 20230720 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 8:47:00 AM | 8.9 | 8.4 | 32.9 | 27.4 | 2.1 | 2.5 |
| WSR02 | 20230720 | Cloudy | Moderate | Mid-Flood | Middle | 5 | 8:46:00 AM | 8.7 | 8.4 | 32.9 | 27.3 | 1.8 | 2.5 |
| WSR02 | 20230720 | Cloudy | Moderate | Mid-Flood | Middle | 5 | 8:46:00 AM | 8.8 | 8.3 | 33.0 | 27.5 | 1.9 | 2.5 |
| WSR02 | 20230720 | Cloudy | Moderate | Mid-Flood | Bottom | 9 | 8:45:00 AM | 8.8 | 8.4 | 32.9 | 27.5 | 1.8 | 3.0 |
| WSR02 | 20230720 | Cloudy | Moderate | Mid-Flood | Bottom | 9 | 8:45:00 AM | 8.7 | 8.4 | 32.9 | 27.5 | 2.1 | 2.5 |
| WSR03 | 20230720 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 9:02:00 AM | 8.8 | 8.2 | 33.2 | 27.4 | 2.3 | 2.5 |
| WSR03 | 20230720 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 9:02:00 AM | 8.9 | 8.2 | 33.2 | 27.4 | 2.2 | 2.5 |
| WSR03 | 20230720 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 9:01:00 AM | 8.9 | 8.2 | 33.2 | 27.4 | 1.9 | 2.5 |
| WSR03 | 20230720 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 9:01:00 AM | 8.9 | 8.1 | 33.2 | 27.4 | 1.8 | 2.5 |
| WSR03 | 20230720 | Cloudy | Moderate | Mid-Flood | Bottom | 7 | 9:00:00 AM | 8.6 | 8.1 | 33.2 | 27.5 | 2.0 | 2.5 |
| WSR03 | 20230720 | Cloudy | Moderate | Mid-Flood | Bottom | 7 | 9:00:00 AM | 8.7 | 8.2 | 33.1 | 27.3 | 2.2 | 2.5 |

| Location | Date | Weather | Sea Condition | Tidal | Water Level | Depth (m) | Time | DO (mg/L) | pH | Sal (ppt) | Temp (oC) | Turbidity (NTU) | Suspended Solids (mg/L) |
|----------|----------|---------|---------------|-----------|-------------|-----------|-------------|-----------|-----|-----------|-----------|-----------------|-------------------------|
| WSR04 | 20230720 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 9:18:00 AM | 9.0 | 8.2 | 33.4 | 28.0 | 2.2 | 2.5 |
| WSR04 | 20230720 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 9:18:00 AM | 9.0 | 8.3 | 33.4 | 28.0 | 2.3 | 2.5 |
| WSR04 | 20230720 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 9:17:00 AM | 9.1 | 8.3 | 33.4 | 28.0 | 2.3 | 2.5 |
| WSR04 | 20230720 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 9:17:00 AM | 9.0 | 8.2 | 33.4 | 28.1 | 2.3 | 2.5 |
| WSR04 | 20230720 | Cloudy | Moderate | Mid-Flood | Bottom | 6 | 9:16:00 AM | 9.1 | 8.2 | 33.4 | 28.0 | 2.0 | 2.5 |
| WSR04 | 20230720 | Cloudy | Moderate | Mid-Flood | Bottom | 6 | 9:16:00 AM | 9.0 | 8.3 | 33.4 | 28.1 | 2.0 | 2.5 |
| WSR16 | 20230720 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 10:26:00 AM | 9.0 | 8.3 | 33.1 | 27.8 | 2.1 | 3.0 |
| WSR16 | 20230720 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 10:26:00 AM | 8.9 | 8.3 | 33.1 | 27.9 | 2.4 | 2.5 |
| WSR16 | 20230720 | Cloudy | Moderate | Mid-Flood | Middle | 8 | 10:25:00 AM | 8.9 | 8.3 | 33.1 | 27.9 | 2.3 | 2.5 |
| WSR16 | 20230720 | Cloudy | Moderate | Mid-Flood | Middle | 8 | 10:25:00 AM | 8.9 | 8.3 | 33.0 | 27.9 | 2.4 | 2.5 |
| WSR16 | 20230720 | Cloudy | Moderate | Mid-Flood | Bottom | 16 | 10:24:00 AM | 9.0 | 8.3 | 33.0 | 28.0 | 1.7 | 2.5 |
| WSR16 | 20230720 | Cloudy | Moderate | Mid-Flood | Bottom | 16 | 10:24:00 AM | 9.0 | 8.3 | 33.1 | 27.8 | 2.0 | 2.5 |
| WSR33 | 20230720 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 9:32:00 AM | 8.5 | 8.2 | 33.0 | 27.4 | 1.9 | 2.5 |
| WSR33 | 20230720 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 9:32:00 AM | 8.6 | 8.2 | 33.0 | 27.5 | 2.2 | 2.5 |
| WSR33 | 20230720 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 9:31:00 AM | 8.7 | 8.2 | 32.9 | 27.3 | 1.9 | 2.5 |
| WSR33 | 20230720 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 9:31:00 AM | 8.6 | 8.2 | 32.9 | 27.3 | 1.9 | 2.5 |
| WSR33 | 20230720 | Cloudy | Moderate | Mid-Flood | Bottom | 6 | 9:30:00 AM | 8.7 | 8.2 | 32.9 | 27.5 | 1.7 | 2.5 |
| WSR33 | 20230720 | Cloudy | Moderate | Mid-Flood | Bottom | 6 | 9:30:00 AM | 8.6 | 8.2 | 32.8 | 27.5 | 1.9 | 3.0 |
| WSR36 | 20230720 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 9:48:00 AM | 8.7 | 8.2 | 32.7 | 27.5 | 2.0 | 2.5 |
| WSR36 | 20230720 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 9:48:00 AM | 8.9 | 8.2 | 32.7 | 27.4 | 2.3 | 2.5 |
| WSR36 | 20230720 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 9:48:00 AM | 8.7 | 8.2 | 32.7 | 27.5 | 1.9 | 2.5 |
| WSR36 | 20230720 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 9:48:00 AM | 8.7 | 8.2 | 32.6 | 27.5 | 2.0 | 2.5 |
| WSR36 | 20230720 | Cloudy | Moderate | Mid-Flood | Bottom | 7 | 9:47:00 AM | 8.8 | 8.2 | 32.7 | 27.3 | 1.8 | 2.5 |
| WSR36 | 20230720 | Cloudy | Moderate | Mid-Flood | Bottom | 7 | 9:47:00 AM | 8.6 | 8.2 | 32.8 | 27.5 | 2.2 | 2.5 |
| WSR37 | 20230720 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 10:03:00 AM | 8.8 | 8.2 | 33.2 | 27.8 | 2.2 | 2.5 |
| WSR37 | 20230720 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 10:03:00 AM | 8.8 | 8.1 | 33.1 | 27.7 | 2.3 | 2.5 |
| WSR37 | 20230720 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 10:02:00 AM | 8.9 | 8.2 | 33.3 | 27.8 | 2.1 | 3.0 |
| WSR37 | 20230720 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 10:02:00 AM | 8.8 | 8.2 | 33.1 | 27.7 | 2.1 | 2.5 |
| WSR37 | 20230720 | Cloudy | Moderate | Mid-Flood | Bottom | 8 | 10:01:00 AM | 8.8 | 8.2 | 33.2 | 27.8 | 2.2 | 2.5 |
| WSR37 | 20230720 | Cloudy | Moderate | Mid-Flood | Bottom | 8 | 10:01:00 AM | 8.7 | 8.2 | 33.1 | 27.8 | 2.2 | 2.5 |

| Location | Date | Weather | Sea Condition | Tidal | Water Level | Depth (m) | Time | DO (mg/L) | pH | Sal (ppt) | Temp (oC) | Turbidity (NTU) | Suspended Solids (mg/L) |
|----------|----------|---------|---------------|-----------|-------------|-----------|-------------|-----------|-----|-----------|-----------|-----------------|-------------------------|
| CE | 20230722 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 10:52:00 AM | 9.5 | 8.2 | 33.0 | 28.5 | 2.9 | 2.5 |
| CE | 20230722 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 10:52:00 AM | 9.4 | 8.2 | 33.1 | 28.5 | 2.4 | 2.5 |
| CE | 20230722 | Cloudy | Moderate | Mid-Flood | Middle | 11 | 10:51:00 AM | 9.4 | 8.2 | 33.3 | 28.5 | 2.8 | 2.5 |
| CE | 20230722 | Cloudy | Moderate | Mid-Flood | Middle | 11 | 10:51:00 AM | 9.3 | 8.2 | 33.1 | 28.5 | 3.0 | 2.5 |
| CE | 20230722 | Cloudy | Moderate | Mid-Flood | Bottom | 20 | 10:50:00 AM | 9.4 | 8.2 | 33.1 | 28.5 | 2.6 | 2.5 |
| CE | 20230722 | Cloudy | Moderate | Mid-Flood | Bottom | 20 | 10:50:00 AM | 9.4 | 8.2 | 33.1 | 28.5 | 3.1 | 2.5 |
| CF | 20230722 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 8:02:00 AM | 8.9 | 8.2 | 32.6 | 28.0 | 3.1 | 2.5 |
| CF | 20230722 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 8:02:00 AM | 8.9 | 8.2 | 32.6 | 28.1 | 3.3 | 2.5 |
| CF | 20230722 | Cloudy | Moderate | Mid-Flood | Middle | 10 | 8:01:00 AM | 8.9 | 8.2 | 32.7 | 28.1 | 2.9 | 2.5 |
| CF | 20230722 | Cloudy | Moderate | Mid-Flood | Middle | 10 | 8:01:00 AM | 8.8 | 8.2 | 32.7 | 28.0 | 3.4 | 2.5 |
| CF | 20230722 | Cloudy | Moderate | Mid-Flood | Bottom | 19 | 8:00:00 AM | 9.0 | 8.2 | 32.8 | 28.0 | 3.2 | 2.5 |
| CF | 20230722 | Cloudy | Moderate | Mid-Flood | Bottom | 19 | 8:00:00 AM | 8.9 | 8.2 | 32.8 | 28.0 | 3.1 | 2.5 |
| WSR01 | 20230722 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 8:26:00 AM | 8.8 | 8.4 | 33.1 | 28.0 | 2.3 | 2.5 |
| WSR01 | 20230722 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 8:26:00 AM | 8.8 | 8.3 | 33.0 | 28.1 | 2.3 | 2.5 |
| WSR01 | 20230722 | Cloudy | Moderate | Mid-Flood | Middle | 5 | 8:25:00 AM | 8.8 | 8.4 | 33.3 | 28.0 | 1.9 | 2.5 |
| WSR01 | 20230722 | Cloudy | Moderate | Mid-Flood | Middle | 5 | 8:25:00 AM | 8.8 | 8.4 | 33.0 | 28.0 | 2.0 | 2.5 |
| WSR01 | 20230722 | Cloudy | Moderate | Mid-Flood | Bottom | 8 | 8:24:00 AM | 8.8 | 8.4 | 32.9 | 28.1 | 1.9 | 2.5 |
| WSR01 | 20230722 | Cloudy | Moderate | Mid-Flood | Bottom | 8 | 8:24:00 AM | 8.8 | 8.4 | 33.1 | 28.0 | 2.1 | 2.5 |
| WSR02 | 20230722 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 8:47:00 AM | 8.6 | 8.3 | 32.5 | 28.5 | 2.2 | 2.5 |
| WSR02 | 20230722 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 8:47:00 AM | 8.7 | 8.3 | 32.6 | 28.6 | 2.3 | 2.5 |
| WSR02 | 20230722 | Cloudy | Moderate | Mid-Flood | Middle | 5 | 8:46:00 AM | 8.6 | 8.3 | 32.3 | 28.5 | 2.3 | 2.5 |
| WSR02 | 20230722 | Cloudy | Moderate | Mid-Flood | Middle | 5 | 8:46:00 AM | 8.8 | 8.2 | 32.3 | 28.5 | 2.1 | 2.5 |
| WSR02 | 20230722 | Cloudy | Moderate | Mid-Flood | Bottom | 9 | 8:45:00 AM | 8.7 | 8.3 | 32.3 | 28.5 | 2.2 | 2.5 |
| WSR02 | 20230722 | Cloudy | Moderate | Mid-Flood | Bottom | 9 | 8:45:00 AM | 8.8 | 8.3 | 32.3 | 28.5 | 2.4 | 2.5 |
| WSR03 | 20230722 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 9:03:00 AM | 8.5 | 8.2 | 32.9 | 28.5 | 2.4 | 2.5 |
| WSR03 | 20230722 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 9:03:00 AM | 8.6 | 8.3 | 32.9 | 28.5 | 2.3 | 2.5 |
| WSR03 | 20230722 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 9:02:00 AM | 8.7 | 8.3 | 32.7 | 28.5 | 2.1 | 2.5 |
| WSR03 | 20230722 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 9:02:00 AM | 8.6 | 8.2 | 32.8 | 28.4 | 2.3 | 2.5 |
| WSR03 | 20230722 | Cloudy | Moderate | Mid-Flood | Bottom | 7 | 9:01:00 AM | 8.6 | 8.3 | 32.7 | 28.5 | 1.9 | 2.5 |
| WSR03 | 20230722 | Cloudy | Moderate | Mid-Flood | Bottom | 7 | 9:01:00 AM | 8.6 | 8.3 | 33.1 | 28.5 | 2.0 | 2.5 |

| Location | Date | Weather | Sea Condition | Tidal | Water Level | Depth (m) | Time | DO (mg/L) | pH | Sal (ppt) | Temp (oC) | Turbidity (NTU) | Suspended Solids (mg/L) |
|----------|----------|---------|---------------|-----------|-------------|-----------|-------------|-----------|-----|-----------|-----------|-----------------|-------------------------|
| WSR04 | 20230722 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 9:17:00 AM | 9.3 | 8.2 | 33.3 | 28.2 | 2.3 | 2.5 |
| WSR04 | 20230722 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 9:17:00 AM | 9.4 | 8.2 | 33.0 | 28.3 | 2.0 | 2.5 |
| WSR04 | 20230722 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 9:16:00 AM | 9.4 | 8.3 | 33.3 | 28.3 | 2.3 | 2.5 |
| WSR04 | 20230722 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 9:16:00 AM | 9.4 | 8.2 | 33.3 | 28.3 | 2.3 | 2.5 |
| WSR04 | 20230722 | Cloudy | Moderate | Mid-Flood | Bottom | 7 | 9:15:00 AM | 9.3 | 8.2 | 32.9 | 28.2 | 2.0 | 2.5 |
| WSR04 | 20230722 | Cloudy | Moderate | Mid-Flood | Bottom | 7 | 9:15:00 AM | 9.4 | 8.3 | 33.0 | 28.3 | 2.3 | 2.5 |
| WSR16 | 20230722 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 10:28:00 AM | 8.9 | 8.2 | 33.1 | 27.7 | 2.2 | 2.5 |
| WSR16 | 20230722 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 10:28:00 AM | 8.9 | 8.3 | 33.1 | 27.7 | 2.2 | 2.5 |
| WSR16 | 20230722 | Cloudy | Moderate | Mid-Flood | Middle | 9 | 10:27:00 AM | 8.8 | 8.3 | 33.0 | 27.8 | 2.2 | 2.5 |
| WSR16 | 20230722 | Cloudy | Moderate | Mid-Flood | Middle | 9 | 10:27:00 AM | 8.8 | 8.3 | 32.9 | 27.8 | 2.2 | 2.5 |
| WSR16 | 20230722 | Cloudy | Moderate | Mid-Flood | Bottom | 16 | 10:26:00 AM | 8.7 | 8.2 | 33.0 | 27.7 | 2.0 | 2.5 |
| WSR16 | 20230722 | Cloudy | Moderate | Mid-Flood | Bottom | 16 | 10:26:00 AM | 8.9 | 8.2 | 32.9 | 27.7 | 2.2 | 2.5 |
| WSR33 | 20230722 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 9:34:00 AM | 8.9 | 8.2 | 32.7 | 28.1 | 2.1 | 2.5 |
| WSR33 | 20230722 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 9:34:00 AM | 9.0 | 8.2 | 32.5 | 28.1 | 2.3 | 2.5 |
| WSR33 | 20230722 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 9:33:00 AM | 9.0 | 8.3 | 32.7 | 28.0 | 1.7 | 2.5 |
| WSR33 | 20230722 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 9:33:00 AM | 9.0 | 8.2 | 32.5 | 28.0 | 2.0 | 2.5 |
| WSR33 | 20230722 | Cloudy | Moderate | Mid-Flood | Bottom | 7 | 9:32:00 AM | 8.9 | 8.2 | 32.4 | 28.0 | 1.7 | 2.5 |
| WSR33 | 20230722 | Cloudy | Moderate | Mid-Flood | Bottom | 7 | 9:32:00 AM | 8.9 | 8.2 | 32.7 | 28.1 | 1.7 | 2.5 |
| WSR36 | 20230722 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 9:47:00 AM | 9.4 | 8.2 | 33.3 | 28.1 | 2.4 | 2.5 |
| WSR36 | 20230722 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 9:47:00 AM | 9.3 | 8.2 | 32.9 | 28.1 | 2.3 | 2.5 |
| WSR36 | 20230722 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 9:47:00 AM | 9.4 | 8.2 | 33.3 | 28.1 | 2.2 | 2.5 |
| WSR36 | 20230722 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 9:47:00 AM | 9.4 | 8.2 | 33.0 | 28.0 | 2.2 | 3.0 |
| WSR36 | 20230722 | Cloudy | Moderate | Mid-Flood | Bottom | 6 | 9:46:00 AM | 9.3 | 8.2 | 33.1 | 28.1 | 2.0 | 2.5 |
| WSR36 | 20230722 | Cloudy | Moderate | Mid-Flood | Bottom | 6 | 9:46:00 AM | 9.3 | 8.2 | 33.3 | 28.0 | 2.1 | 3.0 |
| WSR37 | 20230722 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 10:05:00 AM | 8.5 | 8.2 | 32.0 | 28.2 | 2.1 | 3.0 |
| WSR37 | 20230722 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 10:05:00 AM | 8.4 | 8.2 | 32.3 | 28.3 | 2.2 | 2.5 |
| WSR37 | 20230722 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 10:04:00 AM | 8.5 | 8.2 | 32.3 | 28.3 | 2.2 | 2.5 |
| WSR37 | 20230722 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 10:04:00 AM | 8.4 | 8.2 | 32.0 | 28.3 | 2.4 | 2.5 |
| WSR37 | 20230722 | Cloudy | Moderate | Mid-Flood | Bottom | 7 | 10:03:00 AM | 8.6 | 8.2 | 32.0 | 28.2 | 1.5 | 2.5 |
| WSR37 | 20230722 | Cloudy | Moderate | Mid-Flood | Bottom | 7 | 10:03:00 AM | 8.5 | 8.2 | 32.0 | 28.3 | 1.6 | 2.5 |

| Location | Date | Weather | Sea Condition | Tidal | Water Level | Depth (m) | Time | DO (mg/L) | pH | Sal (ppt) | Temp (oC) | Turbidity (NTU) | Suspended Solids (mg/L) |
|----------|----------|---------|---------------|-----------|-------------|-----------|-------------|-----------|-----|-----------|-----------|-----------------|-------------------------|
| CE | 20230725 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 11:08:00 AM | 9.4 | 8.3 | 33.0 | 28.7 | 2.6 | 4.0 |
| CE | 20230725 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 11:08:00 AM | 9.7 | 8.3 | 33.1 | 28.7 | 2.5 | 5.0 |
| CE | 20230725 | Cloudy | Moderate | Mid-Flood | Middle | 11 | 11:07:00 AM | 9.5 | 8.3 | 33.0 | 28.7 | 2.7 | 7.0 |
| CE | 20230725 | Cloudy | Moderate | Mid-Flood | Middle | 11 | 11:07:00 AM | 9.5 | 8.3 | 33.0 | 28.7 | 2.6 | 4.0 |
| CE | 20230725 | Cloudy | Moderate | Mid-Flood | Bottom | 21 | 11:06:00 AM | 9.6 | 8.3 | 32.9 | 28.6 | 2.7 | 5.0 |
| CE | 20230725 | Cloudy | Moderate | Mid-Flood | Bottom | 21 | 11:06:00 AM | 9.7 | 8.3 | 33.0 | 28.7 | 2.8 | 4.0 |
| CF | 20230725 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 8:18:00 AM | 8.9 | 8.2 | 32.6 | 27.9 | 3.3 | 5.0 |
| CF | 20230725 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 8:18:00 AM | 8.8 | 8.3 | 32.6 | 27.9 | 3.4 | 4.0 |
| CF | 20230725 | Cloudy | Moderate | Mid-Flood | Middle | 11 | 8:17:00 AM | 8.9 | 8.3 | 32.6 | 27.9 | 3.1 | 5.0 |
| CF | 20230725 | Cloudy | Moderate | Mid-Flood | Middle | 11 | 8:17:00 AM | 9.0 | 8.3 | 32.5 | 27.9 | 3.2 | 5.0 |
| CF | 20230725 | Cloudy | Moderate | Mid-Flood | Bottom | 20 | 8:16:00 AM | 8.9 | 8.3 | 32.7 | 28.0 | 2.9 | 5.0 |
| CF | 20230725 | Cloudy | Moderate | Mid-Flood | Bottom | 20 | 8:16:00 AM | 8.8 | 8.3 | 32.7 | 27.9 | 3.0 | 6.0 |
| WSR01 | 20230725 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 8:42:00 AM | 8.9 | 8.1 | 32.3 | 28.1 | 2.1 | 3.0 |
| WSR01 | 20230725 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 8:42:00 AM | 9.0 | 8.1 | 32.4 | 28.1 | 2.1 | 4.0 |
| WSR01 | 20230725 | Cloudy | Moderate | Mid-Flood | Middle | 5 | 8:41:00 AM | 8.9 | 8.1 | 32.4 | 28.1 | 1.6 | 5.0 |
| WSR01 | 20230725 | Cloudy | Moderate | Mid-Flood | Middle | 5 | 8:41:00 AM | 8.9 | 8.1 | 32.5 | 28.1 | 1.8 | 6.0 |
| WSR01 | 20230725 | Cloudy | Moderate | Mid-Flood | Bottom | 8 | 8:40:00 AM | 8.8 | 8.1 | 32.5 | 28.2 | 1.9 | 5.0 |
| WSR01 | 20230725 | Cloudy | Moderate | Mid-Flood | Bottom | 8 | 8:40:00 AM | 9.0 | 8.1 | 32.3 | 28.2 | 2.1 | 6.0 |
| WSR02 | 20230725 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 9:03:00 AM | 9.3 | 8.3 | 32.5 | 28.0 | 2.1 | 5.0 |
| WSR02 | 20230725 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 9:03:00 AM | 9.1 | 8.3 | 32.4 | 28.0 | 2.4 | 4.0 |
| WSR02 | 20230725 | Cloudy | Moderate | Mid-Flood | Middle | 5 | 9:02:00 AM | 9.3 | 8.3 | 32.4 | 28.1 | 1.9 | 3.0 |
| WSR02 | 20230725 | Cloudy | Moderate | Mid-Flood | Middle | 5 | 9:02:00 AM | 9.1 | 8.2 | 32.6 | 28.0 | 1.9 | 6.0 |
| WSR02 | 20230725 | Cloudy | Moderate | Mid-Flood | Bottom | 8 | 9:01:00 AM | 9.2 | 8.3 | 32.4 | 28.0 | 2.0 | 5.0 |
| WSR02 | 20230725 | Cloudy | Moderate | Mid-Flood | Bottom | 8 | 9:01:00 AM | 9.1 | 8.3 | 32.6 | 28.0 | 2.3 | 4.0 |
| WSR03 | 20230725 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 9:17:00 AM | 9.0 | 8.4 | 32.8 | 28.2 | 2.3 | 5.0 |
| WSR03 | 20230725 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 9:17:00 AM | 9.0 | 8.4 | 32.7 | 28.2 | 2.4 | 5.0 |
| WSR03 | 20230725 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 9:16:00 AM | 9.0 | 8.4 | 32.8 | 28.2 | 2.0 | 6.0 |
| WSR03 | 20230725 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 9:16:00 AM | 8.9 | 8.3 | 32.7 | 28.2 | 2.3 | 7.0 |
| WSR03 | 20230725 | Cloudy | Moderate | Mid-Flood | Bottom | 8 | 9:15:00 AM | 8.8 | 8.4 | 32.7 | 28.3 | 2.3 | 3.0 |
| WSR03 | 20230725 | Cloudy | Moderate | Mid-Flood | Bottom | 8 | 9:15:00 AM | 8.9 | 8.3 | 32.8 | 28.2 | 2.3 | 3.0 |

| Location | Date | Weather | Sea Condition | Tidal | Water Level | Depth (m) | Time | DO (mg/L) | pH | Sal (ppt) | Temp (oC) | Turbidity (NTU) | Suspended Solids (mg/L) |
|----------|----------|---------|---------------|-----------|-------------|-----------|-------------|-----------|-----|-----------|-----------|-----------------|-------------------------|
| WSR04 | 20230725 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 9:33:00 AM | 8.9 | 8.1 | 32.9 | 28.4 | 2.1 | 5.0 |
| WSR04 | 20230725 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 9:33:00 AM | 9.1 | 8.1 | 32.9 | 28.3 | 2.1 | 5.0 |
| WSR04 | 20230725 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 9:32:00 AM | 9.1 | 8.1 | 32.8 | 28.4 | 2.0 | 5.0 |
| WSR04 | 20230725 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 9:32:00 AM | 8.9 | 8.1 | 32.9 | 28.4 | 2.1 | 6.0 |
| WSR04 | 20230725 | Cloudy | Moderate | Mid-Flood | Bottom | 6 | 9:31:00 AM | 9.0 | 8.1 | 32.7 | 28.3 | 1.6 | 3.0 |
| WSR04 | 20230725 | Cloudy | Moderate | Mid-Flood | Bottom | 6 | 9:31:00 AM | 8.9 | 8.1 | 32.8 | 28.3 | 1.7 | 5.0 |
| WSR16 | 20230725 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 10:44:00 AM | 9.0 | 8.2 | 33.0 | 28.6 | 2.2 | 5.0 |
| WSR16 | 20230725 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 10:44:00 AM | 9.0 | 8.2 | 32.8 | 28.7 | 2.2 | 3.0 |
| WSR16 | 20230725 | Cloudy | Moderate | Mid-Flood | Middle | 8 | 10:43:00 AM | 9.0 | 8.1 | 33.0 | 28.7 | 2.2 | 5.0 |
| WSR16 | 20230725 | Cloudy | Moderate | Mid-Flood | Middle | 8 | 10:43:00 AM | 9.1 | 8.2 | 33.0 | 28.7 | 2.1 | 5.0 |
| WSR16 | 20230725 | Cloudy | Moderate | Mid-Flood | Bottom | 15 | 10:42:00 AM | 9.2 | 8.2 | 32.8 | 28.7 | 2.1 | 5.0 |
| WSR16 | 20230725 | Cloudy | Moderate | Mid-Flood | Bottom | 15 | 10:42:00 AM | 9.0 | 8.2 | 33.0 | 28.6 | 2.4 | 7.0 |
| WSR33 | 20230725 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 9:47:00 AM | 9.1 | 8.1 | 33.0 | 28.3 | 2.2 | 3.0 |
| WSR33 | 20230725 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 9:47:00 AM | 8.9 | 8.2 | 33.0 | 28.2 | 2.2 | 4.0 |
| WSR33 | 20230725 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 9:46:00 AM | 9.1 | 8.1 | 33.0 | 28.3 | 2.3 | 4.0 |
| WSR33 | 20230725 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 9:46:00 AM | 8.9 | 8.1 | 32.9 | 28.3 | 2.1 | 3.0 |
| WSR33 | 20230725 | Cloudy | Moderate | Mid-Flood | Bottom | 6 | 9:45:00 AM | 9.0 | 8.1 | 33.1 | 28.3 | 2.1 | 5.0 |
| WSR33 | 20230725 | Cloudy | Moderate | Mid-Flood | Bottom | 6 | 9:45:00 AM | 9.0 | 8.1 | 32.9 | 28.2 | 2.4 | 3.0 |
| WSR36 | 20230725 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 10:03:00 AM | 9.0 | 8.2 | 33.4 | 28.2 | 2.1 | 5.0 |
| WSR36 | 20230725 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 10:03:00 AM | 8.9 | 8.2 | 33.3 | 28.2 | 2.4 | 3.0 |
| WSR36 | 20230725 | Cloudy | Moderate | Mid-Flood | Middle | 3 | 10:03:00 AM | 8.9 | 8.1 | 33.2 | 28.2 | 2.1 | 6.0 |
| WSR36 | 20230725 | Cloudy | Moderate | Mid-Flood | Middle | 3 | 10:03:00 AM | 8.9 | 8.1 | 33.3 | 28.1 | 2.3 | 4.0 |
| WSR36 | 20230725 | Cloudy | Moderate | Mid-Flood | Bottom | 6 | 10:02:00 AM | 9.1 | 8.1 | 33.2 | 28.1 | 2.0 | 2.5 |
| WSR36 | 20230725 | Cloudy | Moderate | Mid-Flood | Bottom | 6 | 10:02:00 AM | 8.9 | 8.2 | 33.4 | 28.1 | 2.1 | 2.5 |
| WSR37 | 20230725 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 10:19:00 AM | 8.9 | 8.2 | 32.6 | 28.7 | 2.3 | 3.0 |
| WSR37 | 20230725 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 10:19:00 AM | 9.1 | 8.2 | 32.6 | 28.7 | 2.4 | 4.0 |
| WSR37 | 20230725 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 10:18:00 AM | 8.9 | 8.2 | 32.5 | 28.6 | 1.9 | 3.0 |
| WSR37 | 20230725 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 10:18:00 AM | 9.0 | 8.2 | 32.7 | 28.7 | 2.2 | 3.0 |
| WSR37 | 20230725 | Cloudy | Moderate | Mid-Flood | Bottom | 7 | 10:17:00 AM | 9.0 | 8.2 | 32.5 | 28.7 | 1.8 | 4.0 |
| WSR37 | 20230725 | Cloudy | Moderate | Mid-Flood | Bottom | 7 | 10:17:00 AM | 9.0 | 8.2 | 32.5 | 28.7 | 2.1 | 2.5 |

| Location | Date | Weather | Sea Condition | Tidal | Water Level | Depth (m) | Time | DO (mg/L) | pH | Sal (ppt) | Temp (oC) | Turbidity (NTU) | Suspended Solids (mg/L) |
|----------|----------|---------|---------------|-----------|-------------|-----------|-------------|-----------|-----|-----------|-----------|-----------------|-------------------------|
| CE | 20230727 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 2:55:00 PM | 9.6 | 8.3 | 33.9 | 27.4 | 2.6 | 3.0 |
| CE | 20230727 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 2:55:00 PM | 9.5 | 8.3 | 33.7 | 27.5 | 2.7 | 4.0 |
| CE | 20230727 | Cloudy | Moderate | Mid-Flood | Middle | 12 | 2:54:00 PM | 9.4 | 8.3 | 33.7 | 27.4 | 2.7 | 2.5 |
| CE | 20230727 | Cloudy | Moderate | Mid-Flood | Middle | 12 | 2:54:00 PM | 9.4 | 8.3 | 34.0 | 27.4 | 2.9 | 2.5 |
| CE | 20230727 | Cloudy | Moderate | Mid-Flood | Bottom | 23 | 2:53:00 PM | 9.4 | 8.3 | 33.6 | 27.4 | 2.9 | 2.5 |
| CE | 20230727 | Cloudy | Moderate | Mid-Flood | Bottom | 23 | 2:53:00 PM | 9.5 | 8.2 | 33.8 | 27.4 | 2.9 | 2.5 |
| CF | 20230727 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 12:04:00 PM | 9.5 | 8.4 | 33.6 | 26.7 | 3.2 | 2.5 |
| CF | 20230727 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 12:04:00 PM | 9.6 | 8.3 | 33.7 | 26.8 | 3.5 | 4.0 |
| CF | 20230727 | Cloudy | Moderate | Mid-Flood | Middle | 10 | 12:03:00 PM | 9.7 | 8.3 | 33.6 | 26.7 | 3.3 | 2.5 |
| CF | 20230727 | Cloudy | Moderate | Mid-Flood | Middle | 10 | 12:03:00 PM | 9.5 | 8.4 | 33.7 | 26.8 | 3.5 | 2.5 |
| CF | 20230727 | Cloudy | Moderate | Mid-Flood | Bottom | 18 | 12:02:00 PM | 9.5 | 8.4 | 33.7 | 26.7 | 3.2 | 2.5 |
| CF | 20230727 | Cloudy | Moderate | Mid-Flood | Bottom | 18 | 12:02:00 PM | 9.6 | 8.3 | 33.6 | 26.7 | 3.2 | 2.5 |
| WSR01 | 20230727 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 12:28:00 PM | 9.3 | 8.3 | 34.0 | 26.8 | 1.8 | 2.5 |
| WSR01 | 20230727 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 12:28:00 PM | 9.3 | 8.2 | 34.0 | 26.9 | 1.9 | 2.5 |
| WSR01 | 20230727 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 12:27:00 PM | 9.2 | 8.3 | 33.9 | 26.8 | 1.8 | 3.0 |
| WSR01 | 20230727 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 12:27:00 PM | 9.2 | 8.2 | 33.9 | 26.8 | 1.9 | 4.0 |
| WSR01 | 20230727 | Cloudy | Moderate | Mid-Flood | Bottom | 7 | 12:26:00 PM | 9.3 | 8.3 | 33.7 | 26.8 | 1.7 | 4.0 |
| WSR01 | 20230727 | Cloudy | Moderate | Mid-Flood | Bottom | 7 | 12:26:00 PM | 9.2 | 8.2 | 33.9 | 26.8 | 1.6 | 2.5 |
| WSR02 | 20230727 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 12:49:00 PM | 9.2 | 8.5 | 32.8 | 26.9 | 2.4 | 2.5 |
| WSR02 | 20230727 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 12:49:00 PM | 9.2 | 8.4 | 32.7 | 26.9 | 2.3 | 2.5 |
| WSR02 | 20230727 | Cloudy | Moderate | Mid-Flood | Middle | 5 | 12:48:00 PM | 9.3 | 8.4 | 33.0 | 27.0 | 2.1 | 4.0 |
| WSR02 | 20230727 | Cloudy | Moderate | Mid-Flood | Middle | 5 | 12:48:00 PM | 9.2 | 8.5 | 32.9 | 26.9 | 2.2 | 3.0 |
| WSR02 | 20230727 | Cloudy | Moderate | Mid-Flood | Bottom | 9 | 12:47:00 PM | 9.2 | 8.5 | 32.9 | 26.9 | 2.1 | 4.0 |
| WSR02 | 20230727 | Cloudy | Moderate | Mid-Flood | Bottom | 9 | 12:47:00 PM | 9.2 | 8.5 | 32.7 | 27.0 | 2.2 | 3.0 |
| WSR03 | 20230727 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 1:03:00 PM | 9.0 | 8.4 | 33.5 | 27.1 | 2.3 | 2.5 |
| WSR03 | 20230727 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 1:03:00 PM | 8.8 | 8.4 | 33.7 | 27.2 | 2.2 | 2.5 |
| WSR03 | 20230727 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 1:02:00 PM | 9.0 | 8.4 | 33.7 | 27.1 | 2.3 | 3.0 |
| WSR03 | 20230727 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 1:02:00 PM | 8.8 | 8.4 | 33.4 | 27.1 | 2.2 | 4.0 |
| WSR03 | 20230727 | Cloudy | Moderate | Mid-Flood | Bottom | 6 | 1:01:00 PM | 8.9 | 8.4 | 33.4 | 27.1 | 2.2 | 3.0 |
| WSR03 | 20230727 | Cloudy | Moderate | Mid-Flood | Bottom | 6 | 1:01:00 PM | 8.9 | 8.3 | 33.6 | 27.1 | 2.3 | 4.0 |

| Location | Date | Weather | Sea Condition | Tidal | Water Level | Depth (m) | Time | DO (mg/L) | pH | Sal (ppt) | Temp (oC) | Turbidity (NTU) | Suspended Solids (mg/L) |
|----------|----------|---------|---------------|-----------|-------------|-----------|------------|-----------|-----|-----------|-----------|-----------------|-------------------------|
| WSR04 | 20230727 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 1:19:00 PM | 9.1 | 8.3 | 34.0 | 27.3 | 2.3 | 3.0 |
| WSR04 | 20230727 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 1:19:00 PM | 8.9 | 8.3 | 34.2 | 27.3 | 2.3 | 2.5 |
| WSR04 | 20230727 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 1:18:00 PM | 8.9 | 8.2 | 34.0 | 27.3 | 2.2 | 2.5 |
| WSR04 | 20230727 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 1:18:00 PM | 9.1 | 8.3 | 34.1 | 27.3 | 2.5 | 2.5 |
| WSR04 | 20230727 | Cloudy | Moderate | Mid-Flood | Bottom | 7 | 1:17:00 PM | 9.0 | 8.2 | 33.9 | 27.3 | 1.9 | 2.5 |
| WSR04 | 20230727 | Cloudy | Moderate | Mid-Flood | Bottom | 7 | 1:17:00 PM | 9.0 | 8.2 | 33.9 | 27.4 | 2.1 | 2.5 |
| WSR16 | 20230727 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 2:31:00 PM | 8.8 | 8.2 | 33.4 | 26.7 | 2.5 | 2.5 |
| WSR16 | 20230727 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 2:31:00 PM | 8.8 | 8.2 | 33.3 | 26.6 | 2.3 | 2.5 |
| WSR16 | 20230727 | Cloudy | Moderate | Mid-Flood | Middle | 9 | 2:30:00 PM | 8.8 | 8.3 | 33.1 | 26.7 | 2.2 | 3.0 |
| WSR16 | 20230727 | Cloudy | Moderate | Mid-Flood | Middle | 9 | 2:30:00 PM | 9.0 | 8.2 | 33.2 | 26.7 | 2.3 | 2.5 |
| WSR16 | 20230727 | Cloudy | Moderate | Mid-Flood | Bottom | 16 | 2:29:00 PM | 9.0 | 8.3 | 33.3 | 26.7 | 2.0 | 3.0 |
| WSR16 | 20230727 | Cloudy | Moderate | Mid-Flood | Bottom | 16 | 2:29:00 PM | 9.0 | 8.3 | 33.0 | 26.7 | 2.1 | 2.5 |
| WSR33 | 20230727 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 1:34:00 PM | 9.7 | 8.4 | 33.3 | 27.3 | 2.1 | 2.5 |
| WSR33 | 20230727 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 1:34:00 PM | 9.5 | 8.4 | 33.2 | 27.3 | 2.2 | 2.5 |
| WSR33 | 20230727 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 1:33:00 PM | 9.7 | 8.3 | 33.0 | 27.3 | 1.9 | 2.5 |
| WSR33 | 20230727 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 1:33:00 PM | 9.5 | 8.3 | 33.4 | 27.3 | 2.1 | 2.5 |
| WSR33 | 20230727 | Cloudy | Moderate | Mid-Flood | Bottom | 6 | 1:32:00 PM | 9.5 | 8.3 | 33.4 | 27.3 | 2.2 | 2.5 |
| WSR33 | 20230727 | Cloudy | Moderate | Mid-Flood | Bottom | 6 | 1:32:00 PM | 9.7 | 8.3 | 33.1 | 27.3 | 2.2 | 3.0 |
| WSR36 | 20230727 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 1:50:00 PM | 9.2 | 8.3 | 33.3 | 27.4 | 2.3 | 3.0 |
| WSR36 | 20230727 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 1:50:00 PM | 9.2 | 8.2 | 33.2 | 27.4 | 2.4 | 2.5 |
| WSR36 | 20230727 | Cloudy | Moderate | Mid-Flood | Middle | 3 | 1:50:00 PM | 9.3 | 8.3 | 33.2 | 27.4 | 1.7 | 2.5 |
| WSR36 | 20230727 | Cloudy | Moderate | Mid-Flood | Middle | 3 | 1:50:00 PM | 9.3 | 8.3 | 33.0 | 27.3 | 2.1 | 2.5 |
| WSR36 | 20230727 | Cloudy | Moderate | Mid-Flood | Bottom | 6 | 1:49:00 PM | 9.3 | 8.3 | 33.0 | 27.4 | 1.6 | 3.0 |
| WSR36 | 20230727 | Cloudy | Moderate | Mid-Flood | Bottom | 6 | 1:49:00 PM | 9.1 | 8.3 | 33.1 | 27.3 | 1.7 | 2.5 |
| WSR37 | 20230727 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 2:06:00 PM | 9.7 | 8.3 | 33.8 | 27.0 | 2.0 | 2.5 |
| WSR37 | 20230727 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 2:06:00 PM | 9.8 | 8.3 | 33.5 | 27.1 | 2.1 | 2.5 |
| WSR37 | 20230727 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 2:05:00 PM | 9.7 | 8.2 | 33.5 | 27.0 | 2.2 | 2.5 |
| WSR37 | 20230727 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 2:05:00 PM | 9.8 | 8.3 | 33.7 | 27.0 | 2.4 | 3.0 |
| WSR37 | 20230727 | Cloudy | Moderate | Mid-Flood | Bottom | 7 | 2:04:00 PM | 9.6 | 8.3 | 33.8 | 27.0 | 1.8 | 2.5 |
| WSR37 | 20230727 | Cloudy | Moderate | Mid-Flood | Bottom | 7 | 2:04:00 PM | 9.7 | 8.3 | 33.7 | 27.1 | 1.9 | 3.0 |

| Location | Date | Weather | Sea Condition | Tidal | Water Level | Depth (m) | Time | DO (mg/L) | pH | Sal (ppt) | Temp (oC) | Turbidity (NTU) | Suspended Solids (mg/L) |
|----------|----------|---------|---------------|-----------|-------------|-----------|------------|-----------|-----|-----------|-----------|-----------------|-------------------------|
| CE | 20230729 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 4:53:00 PM | 8.7 | 8.3 | 32.8 | 27.4 | 2.6 | 2.5 |
| CE | 20230729 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 4:53:00 PM | 8.6 | 8.2 | 32.9 | 27.4 | 2.8 | 2.5 |
| CE | 20230729 | Cloudy | Moderate | Mid-Flood | Middle | 11 | 4:52:00 PM | 8.5 | 8.3 | 32.8 | 27.3 | 2.4 | 2.5 |
| CE | 20230729 | Cloudy | Moderate | Mid-Flood | Middle | 11 | 4:52:00 PM | 8.7 | 8.3 | 32.8 | 27.2 | 2.7 | 2.5 |
| CE | 20230729 | Cloudy | Moderate | Mid-Flood | Bottom | 20 | 4:51:00 PM | 8.6 | 8.3 | 32.8 | 27.3 | 2.9 | 2.5 |
| CE | 20230729 | Cloudy | Moderate | Mid-Flood | Bottom | 20 | 4:51:00 PM | 8.7 | 8.3 | 32.8 | 27.4 | 3.0 | 2.5 |
| CF | 20230729 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 2:01:00 PM | 8.8 | 8.2 | 33.6 | 27.0 | 3.0 | 2.5 |
| CF | 20230729 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 2:01:00 PM | 8.7 | 8.1 | 33.7 | 27.1 | 3.1 | 2.5 |
| CF | 20230729 | Cloudy | Moderate | Mid-Flood | Middle | 10 | 2:00:00 PM | 8.7 | 8.2 | 33.5 | 27.1 | 3.0 | 8.0 |
| CF | 20230729 | Cloudy | Moderate | Mid-Flood | Middle | 10 | 2:00:00 PM | 8.7 | 8.2 | 33.6 | 27.1 | 3.4 | 6.0 |
| CF | 20230729 | Cloudy | Moderate | Mid-Flood | Bottom | 19 | 1:59:00 PM | 8.7 | 8.1 | 33.4 | 27.0 | 2.9 | 2.5 |
| CF | 20230729 | Cloudy | Moderate | Mid-Flood | Bottom | 19 | 1:59:00 PM | 8.8 | 8.1 | 33.6 | 27.0 | 3.0 | 2.5 |
| WSR01 | 20230729 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 2:27:00 PM | 9.4 | 8.3 | 32.9 | 27.1 | 2.2 | 2.5 |
| WSR01 | 20230729 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 2:27:00 PM | 9.3 | 8.3 | 32.8 | 27.1 | 2.4 | 2.5 |
| WSR01 | 20230729 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 2:26:00 PM | 9.3 | 8.3 | 32.8 | 27.2 | 2.4 | 4.0 |
| WSR01 | 20230729 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 2:26:00 PM | 9.3 | 8.2 | 32.9 | 27.0 | 2.2 | 2.5 |
| WSR01 | 20230729 | Cloudy | Moderate | Mid-Flood | Bottom | 8 | 2:25:00 PM | 9.4 | 8.3 | 32.7 | 27.1 | 2.2 | 3.0 |
| WSR01 | 20230729 | Cloudy | Moderate | Mid-Flood | Bottom | 8 | 2:25:00 PM | 9.3 | 8.3 | 32.7 | 27.2 | 2.4 | 2.5 |
| WSR02 | 20230729 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 2:46:00 PM | 8.6 | 8.4 | 33.2 | 27.2 | 2.1 | 3.0 |
| WSR02 | 20230729 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 2:46:00 PM | 8.6 | 8.4 | 33.0 | 27.3 | 2.1 | 2.5 |
| WSR02 | 20230729 | Cloudy | Moderate | Mid-Flood | Middle | 5 | 2:45:00 PM | 8.7 | 8.4 | 33.1 | 27.3 | 1.9 | 3.0 |
| WSR02 | 20230729 | Cloudy | Moderate | Mid-Flood | Middle | 5 | 2:45:00 PM | 8.6 | 8.4 | 33.1 | 27.3 | 2.1 | 2.5 |
| WSR02 | 20230729 | Cloudy | Moderate | Mid-Flood | Bottom | 9 | 2:44:00 PM | 8.7 | 8.4 | 33.2 | 27.2 | 2.0 | 2.5 |
| WSR02 | 20230729 | Cloudy | Moderate | Mid-Flood | Bottom | 9 | 2:44:00 PM | 8.6 | 8.3 | 33.0 | 27.3 | 2.0 | 2.5 |
| WSR03 | 20230729 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 3:02:00 PM | 8.6 | 8.3 | 33.6 | 27.1 | 2.1 | 2.5 |
| WSR03 | 20230729 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 3:02:00 PM | 8.7 | 8.2 | 33.6 | 27.0 | 2.0 | 2.5 |
| WSR03 | 20230729 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 3:01:00 PM | 8.6 | 8.2 | 33.5 | 27.0 | 2.0 | 2.5 |
| WSR03 | 20230729 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 3:01:00 PM | 8.6 | 8.2 | 33.5 | 27.0 | 2.2 | 2.5 |
| WSR03 | 20230729 | Cloudy | Moderate | Mid-Flood | Bottom | 7 | 3:00:00 PM | 8.6 | 8.2 | 33.6 | 27.0 | 2.1 | 2.5 |
| WSR03 | 20230729 | Cloudy | Moderate | Mid-Flood | Bottom | 7 | 3:00:00 PM | 8.7 | 8.2 | 33.6 | 27.0 | 2.5 | 2.5 |

| Location | Date | Weather | Sea Condition | Tidal | Water Level | Depth (m) | Time | DO (mg/L) | pH | Sal (ppt) | Temp (oC) | Turbidity (NTU) | Suspended Solids (mg/L) |
|----------|----------|---------|---------------|-----------|-------------|-----------|------------|-----------|-----|-----------|-----------|-----------------|-------------------------|
| WSR04 | 20230729 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 3:16:00 PM | 9.1 | 8.2 | 33.1 | 27.1 | 2.1 | 2.5 |
| WSR04 | 20230729 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 3:16:00 PM | 9.2 | 8.2 | 33.2 | 27.0 | 1.9 | 2.5 |
| WSR04 | 20230729 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 3:15:00 PM | 9.1 | 8.2 | 33.0 | 27.1 | 2.1 | 4.0 |
| WSR04 | 20230729 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 3:15:00 PM | 9.2 | 8.2 | 33.1 | 27.1 | 2.3 | 2.5 |
| WSR04 | 20230729 | Cloudy | Moderate | Mid-Flood | Bottom | 7 | 3:14:00 PM | 9.1 | 8.2 | 33.1 | 27.1 | 2.0 | 3.0 |
| WSR04 | 20230729 | Cloudy | Moderate | Mid-Flood | Bottom | 7 | 3:14:00 PM | 9.1 | 8.2 | 33.2 | 27.0 | 1.8 | 2.5 |
| WSR16 | 20230729 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 4:30:00 PM | 9.0 | 8.4 | 33.2 | 26.9 | 2.3 | 4.0 |
| WSR16 | 20230729 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 4:30:00 PM | 8.9 | 8.3 | 33.1 | 27.0 | 2.1 | 2.5 |
| WSR16 | 20230729 | Cloudy | Moderate | Mid-Flood | Middle | 9 | 4:29:00 PM | 8.8 | 8.4 | 33.2 | 26.9 | 1.8 | 4.0 |
| WSR16 | 20230729 | Cloudy | Moderate | Mid-Flood | Middle | 9 | 4:29:00 PM | 8.9 | 8.4 | 33.1 | 27.0 | 2.2 | 2.5 |
| WSR16 | 20230729 | Cloudy | Moderate | Mid-Flood | Bottom | 16 | 4:28:00 PM | 8.9 | 8.3 | 33.2 | 27.0 | 1.9 | 3.0 |
| WSR16 | 20230729 | Cloudy | Moderate | Mid-Flood | Bottom | 16 | 4:28:00 PM | 8.9 | 8.3 | 33.2 | 27.0 | 1.9 | 2.5 |
| WSR33 | 20230729 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 3:33:00 PM | 9.4 | 8.4 | 33.0 | 27.4 | 2.0 | 2.5 |
| WSR33 | 20230729 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 3:33:00 PM | 9.2 | 8.4 | 32.9 | 27.3 | 1.9 | 3.0 |
| WSR33 | 20230729 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 3:32:00 PM | 9.3 | 8.4 | 33.1 | 27.4 | 2.3 | 2.5 |
| WSR33 | 20230729 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 3:32:00 PM | 9.4 | 8.4 | 33.0 | 27.4 | 2.3 | 2.5 |
| WSR33 | 20230729 | Cloudy | Moderate | Mid-Flood | Bottom | 6 | 3:31:00 PM | 9.3 | 8.4 | 33.1 | 27.3 | 2.2 | 2.5 |
| WSR33 | 20230729 | Cloudy | Moderate | Mid-Flood | Bottom | 6 | 3:31:00 PM | 9.3 | 8.5 | 33.1 | 27.5 | 2.0 | 3.0 |
| WSR36 | 20230729 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 3:49:00 PM | 8.9 | 8.4 | 33.2 | 27.4 | 2.5 | 5.0 |
| WSR36 | 20230729 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 3:49:00 PM | 8.8 | 8.4 | 33.2 | 27.3 | 2.1 | 3.0 |
| WSR36 | 20230729 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 3:49:00 PM | 8.7 | 8.3 | 33.3 | 27.4 | 2.4 | 2.5 |
| WSR36 | 20230729 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 3:49:00 PM | 8.7 | 8.3 | 33.2 | 27.4 | 2.0 | 3.0 |
| WSR36 | 20230729 | Cloudy | Moderate | Mid-Flood | Bottom | 6 | 3:48:00 PM | 8.7 | 8.3 | 33.2 | 27.4 | 2.1 | 2.5 |
| WSR36 | 20230729 | Cloudy | Moderate | Mid-Flood | Bottom | 6 | 3:48:00 PM | 8.8 | 8.3 | 33.5 | 27.3 | 2.2 | 3.0 |
| WSR37 | 20230729 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 4:05:00 PM | 8.7 | 8.4 | 32.6 | 27.1 | 2.2 | 5.0 |
| WSR37 | 20230729 | Cloudy | Moderate | Mid-Flood | Surface | 1 | 4:05:00 PM | 8.7 | 8.4 | 32.8 | 27.0 | 2.5 | 3.0 |
| WSR37 | 20230729 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 4:04:00 PM | 8.6 | 8.4 | 32.8 | 27.1 | 2.2 | 4.0 |
| WSR37 | 20230729 | Cloudy | Moderate | Mid-Flood | Middle | 4 | 4:04:00 PM | 8.8 | 8.4 | 32.7 | 27.1 | 2.0 | 3.0 |
| WSR37 | 20230729 | Cloudy | Moderate | Mid-Flood | Bottom | 8 | 4:03:00 PM | 8.7 | 8.4 | 32.6 | 27.1 | 2.2 | 2.5 |
| WSR37 | 20230729 | Cloudy | Moderate | Mid-Flood | Bottom | 8 | 4:03:00 PM | 8.7 | 8.3 | 32.6 | 27.1 | 2.3 | 2.5 |

| Location | Date | Weather | Sea Condition | Tidal | Water Level | Depth (m) | Time | DO (mg/L) | pH | Sal (ppt) | Temp (oC) | Turbidity (NTU) | Suspended Solids (mg/L) |
|----------|----------|---------|---------------|---------|-------------|-----------|-------------|-----------|-----|-----------|-----------|-----------------|-------------------------|
| CE | 20230701 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 8:38:00 AM | 8.9 | 8.3 | 32.8 | 27.5 | 3.0 | 2.5 |
| CE | 20230701 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 8:38:00 AM | 8.9 | 8.2 | 33.0 | 27.6 | 3.2 | 2.5 |
| CE | 20230701 | Cloudy | Moderate | Mid-Ebb | Middle | 11 | 8:37:00 AM | 8.9 | 8.3 | 32.9 | 27.6 | 3.0 | 2.5 |
| CE | 20230701 | Cloudy | Moderate | Mid-Ebb | Middle | 11 | 8:37:00 AM | 8.8 | 8.2 | 32.7 | 27.6 | 3.2 | 2.5 |
| CE | 20230701 | Cloudy | Moderate | Mid-Ebb | Bottom | 21 | 8:36:00 AM | 8.9 | 8.3 | 32.9 | 27.5 | 3.0 | 2.5 |
| CE | 20230701 | Cloudy | Moderate | Mid-Ebb | Bottom | 21 | 8:36:00 AM | 8.8 | 8.2 | 32.7 | 27.6 | 3.1 | 2.5 |
| CF | 20230701 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 12:02:00 AM | 8.9 | 8.3 | 32.7 | 27.4 | 2.9 | 2.5 |
| CF | 20230701 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 12:02:00 AM | 8.9 | 8.3 | 32.6 | 27.4 | 2.9 | 2.5 |
| CF | 20230701 | Cloudy | Moderate | Mid-Ebb | Middle | 11 | 12:01:00 AM | 8.8 | 8.3 | 32.7 | 27.4 | 2.7 | 2.5 |
| CF | 20230701 | Cloudy | Moderate | Mid-Ebb | Middle | 11 | 12:01:00 AM | 8.9 | 8.3 | 32.5 | 27.4 | 2.8 | 2.5 |
| CF | 20230701 | Cloudy | Moderate | Mid-Ebb | Bottom | 20 | 12:00:00 AM | 8.8 | 8.3 | 32.7 | 27.5 | 2.5 | 2.5 |
| CF | 20230701 | Cloudy | Moderate | Mid-Ebb | Bottom | 20 | 12:00:00 AM | 8.9 | 8.3 | 32.8 | 27.4 | 2.6 | 2.5 |
| WSR01 | 20230701 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 10:57:00 AM | 8.4 | 8.3 | 32.0 | 27.7 | 1.9 | 2.5 |
| WSR01 | 20230701 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 10:57:00 AM | 8.3 | 8.4 | 32.0 | 27.7 | 2.1 | 2.5 |
| WSR01 | 20230701 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 10:56:00 AM | 8.4 | 8.3 | 32.1 | 27.7 | 1.9 | 2.5 |
| WSR01 | 20230701 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 10:56:00 AM | 8.4 | 8.4 | 32.0 | 27.7 | 2.1 | 2.5 |
| WSR01 | 20230701 | Cloudy | Moderate | Mid-Ebb | Bottom | 8 | 10:55:00 AM | 8.4 | 8.3 | 32.1 | 27.6 | 1.5 | 2.5 |
| WSR01 | 20230701 | Cloudy | Moderate | Mid-Ebb | Bottom | 8 | 10:55:00 AM | 8.5 | 8.3 | 31.9 | 27.6 | 1.4 | 2.5 |
| WSR02 | 20230701 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 10:36:00 AM | 8.7 | 8.3 | 31.9 | 28.2 | 2.0 | 2.5 |
| WSR02 | 20230701 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 10:36:00 AM | 8.8 | 8.3 | 32.0 | 28.2 | 2.3 | 2.5 |
| WSR02 | 20230701 | Cloudy | Moderate | Mid-Ebb | Middle | 5 | 10:35:00 AM | 8.8 | 8.3 | 32.0 | 28.1 | 2.3 | 2.5 |
| WSR02 | 20230701 | Cloudy | Moderate | Mid-Ebb | Middle | 5 | 10:35:00 AM | 8.8 | 8.4 | 31.9 | 28.2 | 2.3 | 2.5 |
| WSR02 | 20230701 | Cloudy | Moderate | Mid-Ebb | Bottom | 9 | 10:34:00 AM | 8.7 | 8.4 | 31.8 | 28.1 | 2.2 | 2.5 |
| WSR02 | 20230701 | Cloudy | Moderate | Mid-Ebb | Bottom | 9 | 10:34:00 AM | 8.8 | 8.3 | 31.7 | 28.1 | 2.3 | 2.5 |
| WSR03 | 20230701 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 10:20:00 AM | 8.3 | 8.2 | 31.9 | 27.9 | 2.1 | 2.5 |
| WSR03 | 20230701 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 10:20:00 AM | 8.4 | 8.2 | 31.9 | 28.1 | 2.2 | 2.5 |
| WSR03 | 20230701 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 10:19:00 AM | 8.4 | 8.2 | 31.8 | 28.0 | 2.2 | 2.5 |
| WSR03 | 20230701 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 10:19:00 AM | 8.5 | 8.2 | 32.0 | 28.0 | 1.9 | 3.0 |
| WSR03 | 20230701 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 10:18:00 AM | 8.4 | 8.1 | 32.0 | 28.0 | 1.7 | 2.5 |
| WSR03 | 20230701 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 10:18:00 AM | 8.4 | 8.2 | 31.9 | 28.0 | 2.0 | 2.5 |

| Location | Date | Weather | Sea Condition | Tidal | Water Level | Depth (m) | Time | DO (mg/L) | pH | Sal (ppt) | Temp (oC) | Turbidity (NTU) | Suspended Solids (mg/L) |
|----------|----------|---------|---------------|---------|-------------|-----------|-------------|-----------|-----|-----------|-----------|-----------------|-------------------------|
| WSR04 | 20230701 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 10:07:00 AM | 8.8 | 8.3 | 32.0 | 27.5 | 2.4 | 2.5 |
| WSR04 | 20230701 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 10:07:00 AM | 8.6 | 8.3 | 32.1 | 27.4 | 2.1 | 3.0 |
| WSR04 | 20230701 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 10:06:00 AM | 8.7 | 8.3 | 31.8 | 27.5 | 1.9 | 2.5 |
| WSR04 | 20230701 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 10:06:00 AM | 8.6 | 8.3 | 32.1 | 27.5 | 2.1 | 2.5 |
| WSR04 | 20230701 | Cloudy | Moderate | Mid-Ebb | Bottom | 6 | 10:05:00 AM | 8.7 | 8.3 | 31.9 | 27.4 | 1.9 | 2.5 |
| WSR04 | 20230701 | Cloudy | Moderate | Mid-Ebb | Bottom | 6 | 10:05:00 AM | 8.6 | 8.3 | 32.1 | 27.4 | 2.1 | 3.0 |
| WSR16 | 20230701 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 9:00:00 AM | 8.8 | 8.3 | 32.3 | 28.0 | 1.9 | 2.5 |
| WSR16 | 20230701 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 9:00:00 AM | 8.9 | 8.3 | 32.1 | 28.0 | 2.0 | 3.0 |
| WSR16 | 20230701 | Cloudy | Moderate | Mid-Ebb | Middle | 8 | 8:59:00 AM | 8.9 | 8.3 | 32.2 | 27.9 | 2.1 | 4.0 |
| WSR16 | 20230701 | Cloudy | Moderate | Mid-Ebb | Middle | 8 | 8:59:00 AM | 8.9 | 8.3 | 32.3 | 28.0 | 2.3 | 2.5 |
| WSR16 | 20230701 | Cloudy | Moderate | Mid-Ebb | Bottom | 15 | 8:58:00 AM | 8.7 | 8.3 | 32.1 | 28.0 | 2.2 | 3.0 |
| WSR16 | 20230701 | Cloudy | Moderate | Mid-Ebb | Bottom | 15 | 8:58:00 AM | 8.8 | 8.3 | 32.4 | 28.0 | 2.0 | 2.5 |
| WSR33 | 20230701 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 9:52:00 AM | 9.3 | 8.2 | 31.8 | 27.5 | 1.8 | 3.0 |
| WSR33 | 20230701 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 9:52:00 AM | 9.1 | 8.2 | 31.6 | 27.4 | 1.9 | 2.5 |
| WSR33 | 20230701 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 9:51:00 AM | 9.2 | 8.2 | 31.6 | 27.4 | 1.8 | 2.5 |
| WSR33 | 20230701 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 9:51:00 AM | 9.1 | 8.2 | 31.8 | 27.4 | 2.0 | 2.5 |
| WSR33 | 20230701 | Cloudy | Moderate | Mid-Ebb | Bottom | 6 | 9:50:00 AM | 9.1 | 8.2 | 31.6 | 27.4 | 1.5 | 2.5 |
| WSR33 | 20230701 | Cloudy | Moderate | Mid-Ebb | Bottom | 6 | 9:50:00 AM | 9.2 | 8.1 | 31.8 | 27.5 | 1.7 | 2.5 |
| WSR36 | 20230701 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 9:37:00 AM | 8.3 | 8.2 | 32.8 | 27.9 | 2.1 | 4.0 |
| WSR36 | 20230701 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 9:37:00 AM | 8.3 | 8.2 | 32.9 | 28.0 | 2.3 | 3.0 |
| WSR36 | 20230701 | Cloudy | Moderate | Mid-Ebb | Middle | 3 | 9:37:00 AM | 8.3 | 8.2 | 32.6 | 27.8 | 2.0 | 2.5 |
| WSR36 | 20230701 | Cloudy | Moderate | Mid-Ebb | Middle | 3 | 9:37:00 AM | 8.5 | 8.2 | 32.8 | 27.9 | 2.2 | 2.5 |
| WSR36 | 20230701 | Cloudy | Moderate | Mid-Ebb | Bottom | 6 | 9:36:00 AM | 8.3 | 8.2 | 32.7 | 27.9 | 1.6 | 2.5 |
| WSR36 | 20230701 | Cloudy | Moderate | Mid-Ebb | Bottom | 6 | 9:36:00 AM | 8.4 | 8.2 | 33.0 | 27.8 | 1.8 | 2.5 |
| WSR37 | 20230701 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 9:23:00 AM | 8.9 | 8.2 | 33.0 | 27.9 | 2.2 | 3.0 |
| WSR37 | 20230701 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 9:23:00 AM | 8.9 | 8.2 | 32.9 | 28.0 | 2.2 | 3.0 |
| WSR37 | 20230701 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 9:22:00 AM | 9.0 | 8.2 | 32.6 | 28.0 | 2.2 | 2.5 |
| WSR37 | 20230701 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 9:22:00 AM | 9.0 | 8.3 | 32.7 | 27.9 | 2.2 | 4.0 |
| WSR37 | 20230701 | Cloudy | Moderate | Mid-Ebb | Bottom | 8 | 9:21:00 AM | 9.0 | 8.2 | 32.8 | 27.8 | 2.1 | 2.5 |
| WSR37 | 20230701 | Cloudy | Moderate | Mid-Ebb | Bottom | 8 | 9:21:00 AM | 9.1 | 8.2 | 32.6 | 27.9 | 2.2 | 2.5 |

| Location | Date | Weather | Sea Condition | Tidal | Water Level | Depth (m) | Time | DO (mg/L) | pH | Sal (ppt) | Temp (oC) | Turbidity (NTU) | Suspended Solids (mg/L) |
|----------|----------|---------|---------------|---------|-------------|-----------|-------------|-----------|-----|-----------|-----------|-----------------|-------------------------|
| CE | 20230704 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 10:59:00 AM | 8.8 | 8.2 | 32.3 | 28.3 | 3.3 | 2.5 |
| CE | 20230704 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 10:59:00 AM | 8.8 | 8.2 | 32.3 | 28.4 | 3.4 | 2.5 |
| CE | 20230704 | Cloudy | Moderate | Mid-Ebb | Middle | 12 | 10:58:00 AM | 8.9 | 8.2 | 32.3 | 28.5 | 3.0 | 2.5 |
| CE | 20230704 | Cloudy | Moderate | Mid-Ebb | Middle | 12 | 10:58:00 AM | 8.8 | 8.2 | 32.1 | 28.3 | 3.1 | 2.5 |
| CE | 20230704 | Cloudy | Moderate | Mid-Ebb | Bottom | 22 | 10:57:00 AM | 9.0 | 8.2 | 32.2 | 28.4 | 3.3 | 2.5 |
| CE | 20230704 | Cloudy | Moderate | Mid-Ebb | Bottom | 22 | 10:57:00 AM | 8.9 | 8.3 | 32.2 | 28.4 | 3.4 | 2.5 |
| CF | 20230704 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 1:47:00 PM | 8.9 | 8.3 | 32.8 | 28.5 | 2.7 | 2.5 |
| CF | 20230704 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 1:47:00 PM | 8.9 | 8.3 | 33.0 | 28.4 | 3.0 | 3.0 |
| CF | 20230704 | Cloudy | Moderate | Mid-Ebb | Middle | 10 | 1:46:00 PM | 8.8 | 8.3 | 32.9 | 28.4 | 2.7 | 2.5 |
| CF | 20230704 | Cloudy | Moderate | Mid-Ebb | Middle | 10 | 1:46:00 PM | 8.8 | 8.3 | 32.9 | 28.5 | 2.8 | 2.5 |
| CF | 20230704 | Cloudy | Moderate | Mid-Ebb | Bottom | 20 | 1:45:00 PM | 8.9 | 8.2 | 32.8 | 28.5 | 2.6 | 2.5 |
| CF | 20230704 | Cloudy | Moderate | Mid-Ebb | Bottom | 20 | 1:45:00 PM | 9.0 | 8.3 | 33.0 | 28.5 | 2.8 | 2.5 |
| WSR01 | 20230704 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 1:23:00 PM | 9.1 | 8.2 | 32.1 | 28.3 | 2.1 | 2.5 |
| WSR01 | 20230704 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 1:23:00 PM | 9.1 | 8.3 | 32.2 | 28.2 | 2.3 | 2.5 |
| WSR01 | 20230704 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 1:22:00 PM | 9.1 | 8.3 | 32.2 | 28.1 | 2.3 | 2.5 |
| WSR01 | 20230704 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 1:22:00 PM | 9.0 | 8.2 | 32.2 | 28.3 | 2.3 | 2.5 |
| WSR01 | 20230704 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 1:21:00 PM | 9.1 | 8.2 | 32.2 | 28.2 | 1.8 | 2.5 |
| WSR01 | 20230704 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 1:21:00 PM | 9.0 | 8.2 | 32.3 | 28.2 | 2.0 | 2.5 |
| WSR02 | 20230704 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 1:02:00 PM | 8.6 | 8.3 | 33.0 | 28.6 | 2.3 | 2.5 |
| WSR02 | 20230704 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 1:02:00 PM | 8.6 | 8.3 | 32.9 | 28.5 | 2.4 | 2.5 |
| WSR02 | 20230704 | Cloudy | Moderate | Mid-Ebb | Middle | 5 | 1:01:00 PM | 8.6 | 8.2 | 33.0 | 28.6 | 2.3 | 2.5 |
| WSR02 | 20230704 | Cloudy | Moderate | Mid-Ebb | Middle | 5 | 1:01:00 PM | 8.7 | 8.2 | 32.9 | 28.5 | 2.4 | 2.5 |
| WSR02 | 20230704 | Cloudy | Moderate | Mid-Ebb | Bottom | 8 | 1:00:00 PM | 8.5 | 8.2 | 33.1 | 28.6 | 2.3 | 2.5 |
| WSR02 | 20230704 | Cloudy | Moderate | Mid-Ebb | Bottom | 8 | 1:00:00 PM | 8.6 | 8.2 | 33.1 | 28.5 | 2.3 | 2.5 |
| WSR03 | 20230704 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 12:45:00 PM | 9.4 | 8.4 | 32.9 | 28.1 | 2.3 | 2.5 |
| WSR03 | 20230704 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 12:45:00 PM | 9.3 | 8.4 | 32.7 | 28.2 | 2.4 | 3.0 |
| WSR03 | 20230704 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 12:44:00 PM | 9.5 | 8.5 | 32.8 | 28.2 | 2.2 | 2.5 |
| WSR03 | 20230704 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 12:44:00 PM | 9.4 | 8.5 | 32.9 | 28.3 | 2.6 | 2.5 |
| WSR03 | 20230704 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 12:43:00 PM | 9.5 | 8.4 | 33.0 | 28.3 | 2.4 | 2.5 |
| WSR03 | 20230704 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 12:43:00 PM | 9.5 | 8.4 | 32.8 | 28.1 | 2.4 | 2.5 |

| Location | Date | Weather | Sea Condition | Tidal | Water Level | Depth (m) | Time | DO (mg/L) | pH | Sal (ppt) | Temp (oC) | Turbidity (NTU) | Suspended Solids (mg/L) |
|----------|----------|---------|---------------|---------|-------------|-----------|-------------|-----------|-----|-----------|-----------|-----------------|-------------------------|
| WSR04 | 20230704 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 12:30:00 PM | 8.8 | 8.2 | 32.6 | 27.9 | 2.3 | 2.5 |
| WSR04 | 20230704 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 12:30:00 PM | 8.8 | 8.2 | 32.6 | 27.8 | 2.5 | 2.5 |
| WSR04 | 20230704 | Cloudy | Moderate | Mid-Ebb | Middle | 3 | 12:29:00 PM | 8.8 | 8.2 | 32.4 | 27.8 | 1.9 | 3.0 |
| WSR04 | 20230704 | Cloudy | Moderate | Mid-Ebb | Middle | 3 | 12:29:00 PM | 8.8 | 8.2 | 32.6 | 27.9 | 1.9 | 2.5 |
| WSR04 | 20230704 | Cloudy | Moderate | Mid-Ebb | Bottom | 6 | 12:28:00 PM | 8.8 | 8.2 | 32.6 | 27.8 | 2.2 | 2.5 |
| WSR04 | 20230704 | Cloudy | Moderate | Mid-Ebb | Bottom | 6 | 12:28:00 PM | 8.7 | 8.2 | 32.5 | 27.8 | 2.2 | 2.5 |
| WSR16 | 20230704 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 11:22:00 AM | 9.3 | 8.4 | 32.2 | 28.6 | 2.4 | 2.5 |
| WSR16 | 20230704 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 11:22:00 AM | 9.2 | 8.4 | 32.3 | 28.5 | 2.5 | 2.5 |
| WSR16 | 20230704 | Cloudy | Moderate | Mid-Ebb | Middle | 8 | 11:21:00 AM | 9.2 | 8.4 | 32.3 | 28.6 | 2.0 | 2.5 |
| WSR16 | 20230704 | Cloudy | Moderate | Mid-Ebb | Middle | 8 | 11:21:00 AM | 9.3 | 8.4 | 32.4 | 28.4 | 2.4 | 2.5 |
| WSR16 | 20230704 | Cloudy | Moderate | Mid-Ebb | Bottom | 15 | 11:20:00 AM | 9.3 | 8.5 | 32.2 | 28.5 | 2.0 | 3.0 |
| WSR16 | 20230704 | Cloudy | Moderate | Mid-Ebb | Bottom | 15 | 11:20:00 AM | 9.3 | 8.5 | 32.3 | 28.5 | 2.4 | 3.0 |
| WSR33 | 20230704 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 12:14:00 PM | 8.6 | 8.2 | 32.8 | 27.9 | 2.4 | 3.0 |
| WSR33 | 20230704 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 12:14:00 PM | 8.6 | 8.2 | 32.8 | 27.9 | 2.3 | 2.5 |
| WSR33 | 20230704 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 12:13:00 PM | 8.5 | 8.3 | 33.0 | 27.9 | 2.2 | 3.0 |
| WSR33 | 20230704 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 12:13:00 PM | 8.4 | 8.2 | 32.9 | 27.9 | 2.3 | 2.5 |
| WSR33 | 20230704 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 12:12:00 PM | 8.6 | 8.2 | 32.7 | 27.8 | 2.1 | 2.5 |
| WSR33 | 20230704 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 12:12:00 PM | 8.5 | 8.2 | 33.0 | 27.8 | 2.3 | 2.5 |
| WSR36 | 20230704 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 11:58:00 AM | 8.4 | 8.4 | 32.4 | 28.1 | 2.1 | 2.5 |
| WSR36 | 20230704 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 11:58:00 AM | 8.5 | 8.4 | 32.2 | 28.1 | 2.4 | 3.0 |
| WSR36 | 20230704 | Cloudy | Moderate | Mid-Ebb | Middle | 3 | 11:58:00 AM | 8.4 | 8.3 | 32.4 | 28.1 | 1.9 | 2.5 |
| WSR36 | 20230704 | Cloudy | Moderate | Mid-Ebb | Middle | 3 | 11:58:00 AM | 8.5 | 8.3 | 32.4 | 28.0 | 2.2 | 2.5 |
| WSR36 | 20230704 | Cloudy | Moderate | Mid-Ebb | Bottom | 5 | 11:57:00 AM | 8.4 | 8.3 | 32.3 | 28.0 | 1.8 | 2.5 |
| WSR36 | 20230704 | Cloudy | Moderate | Mid-Ebb | Bottom | 5 | 11:57:00 AM | 8.5 | 8.3 | 32.4 | 28.1 | 2.0 | 3.0 |
| WSR37 | 20230704 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 11:43:00 AM | 8.5 | 8.3 | 32.2 | 28.4 | 2.0 | 2.5 |
| WSR37 | 20230704 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 11:43:00 AM | 8.5 | 8.4 | 32.3 | 28.5 | 2.3 | 2.5 |
| WSR37 | 20230704 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 11:42:00 AM | 8.5 | 8.3 | 32.4 | 28.5 | 1.7 | 2.5 |
| WSR37 | 20230704 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 11:42:00 AM | 8.5 | 8.3 | 32.2 | 28.6 | 1.9 | 2.5 |
| WSR37 | 20230704 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 11:41:00 AM | 8.5 | 8.3 | 32.3 | 28.6 | 1.5 | 2.5 |
| WSR37 | 20230704 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 11:41:00 AM | 8.5 | 8.3 | 32.1 | 28.5 | 1.6 | 2.5 |

| Location | Date | Weather | Sea Condition | Tidal | Water Level | Depth (m) | Time | DO (mg/L) | pH | Sal (ppt) | Temp (oC) | Turbidity (NTU) | Suspended Solids (mg/L) |
|----------|----------|---------|---------------|---------|-------------|-----------|-------------|-----------|-----|-----------|-----------|-----------------|-------------------------|
| CE | 20230706 | Sunny | Moderate | Mid-Ebb | Surface | 1 | 12:48:00 PM | 9.3 | 8.2 | 33.4 | 28.6 | 3.0 | 2.5 |
| CE | 20230706 | Sunny | Moderate | Mid-Ebb | Surface | 1 | 12:48:00 PM | 9.2 | 8.2 | 33.3 | 28.7 | 2.9 | 2.5 |
| CE | 20230706 | Sunny | Moderate | Mid-Ebb | Middle | 11 | 12:47:00 PM | 9.2 | 8.2 | 33.2 | 28.6 | 3.1 | 2.5 |
| CE | 20230706 | Sunny | Moderate | Mid-Ebb | Middle | 11 | 12:47:00 PM | 9.1 | 8.2 | 33.3 | 28.6 | 3.2 | 2.5 |
| CE | 20230706 | Sunny | Moderate | Mid-Ebb | Bottom | 20 | 12:46:00 PM | 9.1 | 8.2 | 33.2 | 28.6 | 2.9 | 2.5 |
| CE | 20230706 | Sunny | Moderate | Mid-Ebb | Bottom | 20 | 12:46:00 PM | 9.2 | 8.2 | 33.4 | 28.7 | 3.2 | 2.5 |
| CF | 20230706 | Sunny | Moderate | Mid-Ebb | Surface | 1 | 3:28:00 PM | 9.3 | 8.3 | 33.0 | 28.6 | 2.2 | 2.5 |
| CF | 20230706 | Sunny | Moderate | Mid-Ebb | Surface | 1 | 3:28:00 PM | 9.3 | 8.4 | 32.9 | 28.6 | 2.2 | 2.5 |
| CF | 20230706 | Sunny | Moderate | Mid-Ebb | Middle | 11 | 3:27:00 PM | 9.5 | 8.3 | 32.9 | 28.6 | 2.3 | 2.5 |
| CF | 20230706 | Sunny | Moderate | Mid-Ebb | Middle | 11 | 3:27:00 PM | 9.5 | 8.3 | 32.9 | 28.6 | 2.3 | 2.5 |
| CF | 20230706 | Sunny | Moderate | Mid-Ebb | Bottom | 20 | 3:26:00 PM | 9.5 | 8.4 | 32.8 | 28.5 | 2.6 | 2.5 |
| CF | 20230706 | Sunny | Moderate | Mid-Ebb | Bottom | 20 | 3:26:00 PM | 9.3 | 8.4 | 32.9 | 28.6 | 2.6 | 2.5 |
| WSR01 | 20230706 | Sunny | Moderate | Mid-Ebb | Surface | 1 | 3:05:00 PM | 9.4 | 8.4 | 32.6 | 28.3 | 2.4 | 2.5 |
| WSR01 | 20230706 | Sunny | Moderate | Mid-Ebb | Surface | 1 | 3:05:00 PM | 9.3 | 8.4 | 32.5 | 28.3 | 2.3 | 2.5 |
| WSR01 | 20230706 | Sunny | Moderate | Mid-Ebb | Middle | 4 | 3:04:00 PM | 9.3 | 8.4 | 32.6 | 28.3 | 2.0 | 2.5 |
| WSR01 | 20230706 | Sunny | Moderate | Mid-Ebb | Middle | 4 | 3:04:00 PM | 9.2 | 8.3 | 32.6 | 28.2 | 2.2 | 2.5 |
| WSR01 | 20230706 | Sunny | Moderate | Mid-Ebb | Bottom | 8 | 3:03:00 PM | 9.2 | 8.3 | 32.5 | 28.2 | 2.0 | 3.0 |
| WSR01 | 20230706 | Sunny | Moderate | Mid-Ebb | Bottom | 8 | 3:03:00 PM | 9.2 | 8.3 | 32.6 | 28.2 | 2.4 | 2.5 |
| WSR02 | 20230706 | Sunny | Moderate | Mid-Ebb | Surface | 1 | 2:46:00 PM | 8.5 | 8.2 | 33.3 | 28.5 | 2.0 | 2.5 |
| WSR02 | 20230706 | Sunny | Moderate | Mid-Ebb | Surface | 1 | 2:46:00 PM | 8.5 | 8.2 | 33.3 | 28.4 | 2.3 | 3.0 |
| WSR02 | 20230706 | Sunny | Moderate | Mid-Ebb | Middle | 5 | 2:45:00 PM | 8.5 | 8.2 | 33.3 | 28.4 | 1.8 | 2.5 |
| WSR02 | 20230706 | Sunny | Moderate | Mid-Ebb | Middle | 5 | 2:45:00 PM | 8.5 | 8.2 | 33.4 | 28.4 | 2.0 | 2.5 |
| WSR02 | 20230706 | Sunny | Moderate | Mid-Ebb | Bottom | 9 | 2:44:00 PM | 8.6 | 8.2 | 33.3 | 28.4 | 1.8 | 2.5 |
| WSR02 | 20230706 | Sunny | Moderate | Mid-Ebb | Bottom | 9 | 2:44:00 PM | 8.5 | 8.2 | 33.3 | 28.4 | 1.9 | 2.5 |
| WSR03 | 20230706 | Sunny | Moderate | Mid-Ebb | Surface | 1 | 2:30:00 PM | 9.0 | 8.2 | 32.6 | 28.7 | 2.1 | 3.0 |
| WSR03 | 20230706 | Sunny | Moderate | Mid-Ebb | Surface | 1 | 2:30:00 PM | 8.9 | 8.1 | 32.5 | 28.8 | 2.3 | 2.5 |
| WSR03 | 20230706 | Sunny | Moderate | Mid-Ebb | Middle | 4 | 2:29:00 PM | 9.0 | 8.1 | 32.6 | 28.8 | 2.4 | 2.5 |
| WSR03 | 20230706 | Sunny | Moderate | Mid-Ebb | Middle | 4 | 2:29:00 PM | 9.1 | 8.2 | 32.6 | 28.7 | 2.4 | 2.5 |
| WSR03 | 20230706 | Sunny | Moderate | Mid-Ebb | Bottom | 7 | 2:28:00 PM | 9.0 | 8.2 | 32.6 | 28.7 | 2.4 | 2.5 |
| WSR03 | 20230706 | Sunny | Moderate | Mid-Ebb | Bottom | 7 | 2:28:00 PM | 8.9 | 8.1 | 32.5 | 28.8 | 2.1 | 2.5 |

| Location | Date | Weather | Sea Condition | Tidal | Water Level | Depth (m) | Time | DO (mg/L) | pH | Sal (ppt) | Temp (oC) | Turbidity (NTU) | Suspended Solids (mg/L) |
|----------|----------|---------|---------------|---------|-------------|-----------|------------|-----------|-----|-----------|-----------|-----------------|-------------------------|
| WSR04 | 20230706 | Sunny | Moderate | Mid-Ebb | Surface | 1 | 2:17:00 PM | 8.8 | 8.2 | 32.6 | 28.4 | 2.3 | 2.5 |
| WSR04 | 20230706 | Sunny | Moderate | Mid-Ebb | Surface | 1 | 2:17:00 PM | 8.9 | 8.2 | 32.6 | 28.4 | 2.1 | 2.5 |
| WSR04 | 20230706 | Sunny | Moderate | Mid-Ebb | Middle | 4 | 2:16:00 PM | 8.9 | 8.2 | 32.7 | 28.5 | 1.9 | 2.5 |
| WSR04 | 20230706 | Sunny | Moderate | Mid-Ebb | Middle | 4 | 2:16:00 PM | 9.0 | 8.2 | 32.7 | 28.5 | 2.2 | 2.5 |
| WSR04 | 20230706 | Sunny | Moderate | Mid-Ebb | Bottom | 7 | 2:15:00 PM | 8.9 | 8.2 | 32.7 | 28.4 | 1.9 | 2.5 |
| WSR04 | 20230706 | Sunny | Moderate | Mid-Ebb | Bottom | 7 | 2:15:00 PM | 8.9 | 8.2 | 32.7 | 28.5 | 2.0 | 2.5 |
| WSR16 | 20230706 | Sunny | Moderate | Mid-Ebb | Surface | 1 | 1:11:00 PM | 8.5 | 8.2 | 33.5 | 28.8 | 2.3 | 2.5 |
| WSR16 | 20230706 | Sunny | Moderate | Mid-Ebb | Surface | 1 | 1:11:00 PM | 8.5 | 8.2 | 33.3 | 28.8 | 2.4 | 2.5 |
| WSR16 | 20230706 | Sunny | Moderate | Mid-Ebb | Middle | 8 | 1:10:00 PM | 8.5 | 8.2 | 33.5 | 28.8 | 2.2 | 2.5 |
| WSR16 | 20230706 | Sunny | Moderate | Mid-Ebb | Middle | 8 | 1:10:00 PM | 8.6 | 8.2 | 33.5 | 28.8 | 2.4 | 2.5 |
| WSR16 | 20230706 | Sunny | Moderate | Mid-Ebb | Bottom | 15 | 1:09:00 PM | 8.4 | 8.2 | 33.3 | 28.9 | 2.1 | 2.5 |
| WSR16 | 20230706 | Sunny | Moderate | Mid-Ebb | Bottom | 15 | 1:09:00 PM | 8.5 | 8.2 | 33.4 | 28.9 | 2.4 | 2.5 |
| WSR33 | 20230706 | Sunny | Moderate | Mid-Ebb | Surface | 1 | 2:02:00 PM | 9.0 | 8.2 | 32.9 | 28.5 | 2.4 | 2.5 |
| WSR33 | 20230706 | Sunny | Moderate | Mid-Ebb | Surface | 1 | 2:02:00 PM | 9.1 | 8.2 | 33.1 | 28.5 | 2.2 | 2.5 |
| WSR33 | 20230706 | Sunny | Moderate | Mid-Ebb | Middle | 4 | 2:01:00 PM | 9.1 | 8.2 | 33.0 | 28.6 | 2.2 | 2.5 |
| WSR33 | 20230706 | Sunny | Moderate | Mid-Ebb | Middle | 4 | 2:01:00 PM | 9.0 | 8.2 | 33.0 | 28.5 | 2.3 | 2.5 |
| WSR33 | 20230706 | Sunny | Moderate | Mid-Ebb | Bottom | 6 | 2:00:00 PM | 9.1 | 8.3 | 32.9 | 28.5 | 2.0 | 2.5 |
| WSR33 | 20230706 | Sunny | Moderate | Mid-Ebb | Bottom | 6 | 2:00:00 PM | 9.1 | 8.3 | 33.0 | 28.6 | 2.3 | 2.5 |
| WSR36 | 20230706 | Sunny | Moderate | Mid-Ebb | Surface | 1 | 1:47:00 PM | 8.6 | 8.3 | 33.4 | 28.3 | 2.1 | 2.5 |
| WSR36 | 20230706 | Sunny | Moderate | Mid-Ebb | Surface | 1 | 1:47:00 PM | 8.6 | 8.3 | 33.5 | 28.3 | 2.3 | 2.5 |
| WSR36 | 20230706 | Sunny | Moderate | Mid-Ebb | Middle | 3 | 1:47:00 PM | 8.6 | 8.3 | 33.4 | 28.2 | 2.2 | 2.5 |
| WSR36 | 20230706 | Sunny | Moderate | Mid-Ebb | Middle | 3 | 1:47:00 PM | 8.6 | 8.3 | 33.4 | 28.2 | 2.4 | 2.5 |
| WSR36 | 20230706 | Sunny | Moderate | Mid-Ebb | Bottom | 6 | 1:46:00 PM | 8.6 | 8.3 | 33.5 | 28.2 | 1.9 | 2.5 |
| WSR36 | 20230706 | Sunny | Moderate | Mid-Ebb | Bottom | 6 | 1:46:00 PM | 8.6 | 8.3 | 33.5 | 28.2 | 1.9 | 2.5 |
| WSR37 | 20230706 | Sunny | Moderate | Mid-Ebb | Surface | 1 | 1:33:00 PM | 9.3 | 8.2 | 33.0 | 28.5 | 2.0 | 2.5 |
| WSR37 | 20230706 | Sunny | Moderate | Mid-Ebb | Surface | 1 | 1:33:00 PM | 9.3 | 8.2 | 32.8 | 28.5 | 2.2 | 2.5 |
| WSR37 | 20230706 | Sunny | Moderate | Mid-Ebb | Middle | 4 | 1:32:00 PM | 9.3 | 8.1 | 32.8 | 28.6 | 2.0 | 2.5 |
| WSR37 | 20230706 | Sunny | Moderate | Mid-Ebb | Middle | 4 | 1:32:00 PM | 9.2 | 8.2 | 33.0 | 28.5 | 2.2 | 2.5 |
| WSR37 | 20230706 | Sunny | Moderate | Mid-Ebb | Bottom | 8 | 1:31:00 PM | 9.2 | 8.2 | 32.9 | 28.5 | 1.9 | 2.5 |
| WSR37 | 20230706 | Sunny | Moderate | Mid-Ebb | Bottom | 8 | 1:31:00 PM | 9.3 | 8.2 | 32.8 | 28.6 | 2.2 | 2.5 |

| Location | Date | Weather | Sea Condition | Tidal | Water Level | Depth (m) | Time | DO (mg/L) | pH | Sal (ppt) | Temp (oC) | Turbidity (NTU) | Suspended Solids (mg/L) |
|----------|----------|---------|---------------|---------|-------------|-----------|------------|-----------|-----|-----------|-----------|-----------------|-------------------------|
| CE | 20230708 | Sunny | Moderate | Mid-Ebb | Surface | 1 | 2:29:00 PM | 8.8 | 8.3 | 32.5 | 28.7 | 3.1 | 4.0 |
| CE | 20230708 | Sunny | Moderate | Mid-Ebb | Surface | 1 | 2:29:00 PM | 9.0 | 8.3 | 32.7 | 28.7 | 2.9 | 7.0 |
| CE | 20230708 | Sunny | Moderate | Mid-Ebb | Middle | 11 | 2:28:00 PM | 8.9 | 8.3 | 32.7 | 28.6 | 3.2 | 3.0 |
| CE | 20230708 | Sunny | Moderate | Mid-Ebb | Middle | 11 | 2:28:00 PM | 8.8 | 8.4 | 32.6 | 28.7 | 3.4 | 3.0 |
| CE | 20230708 | Sunny | Moderate | Mid-Ebb | Bottom | 22 | 2:27:00 PM | 8.8 | 8.3 | 32.7 | 28.7 | 3.3 | 3.0 |
| CE | 20230708 | Sunny | Moderate | Mid-Ebb | Bottom | 22 | 2:27:00 PM | 8.8 | 8.4 | 32.8 | 28.6 | 3.3 | 3.0 |
| CF | 20230708 | Sunny | Moderate | Mid-Ebb | Surface | 1 | 5:18:00 PM | 9.1 | 8.2 | 32.2 | 28.7 | 2.9 | 4.0 |
| CF | 20230708 | Sunny | Moderate | Mid-Ebb | Surface | 1 | 5:18:00 PM | 9.0 | 8.2 | 32.5 | 28.6 | 2.8 | 4.0 |
| CF | 20230708 | Sunny | Moderate | Mid-Ebb | Middle | 10 | 5:17:00 PM | 9.0 | 8.2 | 32.4 | 28.7 | 2.9 | 4.0 |
| CF | 20230708 | Sunny | Moderate | Mid-Ebb | Middle | 10 | 5:17:00 PM | 9.1 | 8.2 | 32.3 | 28.7 | 2.8 | 5.0 |
| CF | 20230708 | Sunny | Moderate | Mid-Ebb | Bottom | 20 | 5:16:00 PM | 9.0 | 8.2 | 32.2 | 28.6 | 2.6 | 4.0 |
| CF | 20230708 | Sunny | Moderate | Mid-Ebb | Bottom | 20 | 5:16:00 PM | 9.0 | 8.2 | 32.5 | 28.7 | 2.7 | 4.0 |
| WSR01 | 20230708 | Sunny | Moderate | Mid-Ebb | Surface | 1 | 4:54:00 PM | 9.4 | 8.3 | 32.1 | 28.6 | 2.2 | 3.0 |
| WSR01 | 20230708 | Sunny | Moderate | Mid-Ebb | Surface | 1 | 4:54:00 PM | 9.3 | 8.4 | 32.1 | 28.6 | 2.5 | 3.0 |
| WSR01 | 20230708 | Sunny | Moderate | Mid-Ebb | Middle | 4 | 4:53:00 PM | 9.5 | 8.3 | 32.0 | 28.6 | 2.2 | 3.0 |
| WSR01 | 20230708 | Sunny | Moderate | Mid-Ebb | Middle | 4 | 4:53:00 PM | 9.5 | 8.3 | 32.2 | 28.6 | 2.4 | 4.0 |
| WSR01 | 20230708 | Sunny | Moderate | Mid-Ebb | Bottom | 8 | 4:52:00 PM | 9.5 | 8.3 | 32.0 | 28.5 | 2.0 | 4.0 |
| WSR01 | 20230708 | Sunny | Moderate | Mid-Ebb | Bottom | 8 | 4:52:00 PM | 9.4 | 8.4 | 32.1 | 28.6 | 2.4 | 4.0 |
| WSR02 | 20230708 | Sunny | Moderate | Mid-Ebb | Surface | 1 | 4:33:00 PM | 8.4 | 8.3 | 32.4 | 29.0 | 2.1 | 4.0 |
| WSR02 | 20230708 | Sunny | Moderate | Mid-Ebb | Surface | 1 | 4:33:00 PM | 8.3 | 8.3 | 32.4 | 28.8 | 2.1 | 4.0 |
| WSR02 | 20230708 | Sunny | Moderate | Mid-Ebb | Middle | 5 | 4:32:00 PM | 8.5 | 8.3 | 32.6 | 28.9 | 2.3 | 4.0 |
| WSR02 | 20230708 | Sunny | Moderate | Mid-Ebb | Middle | 5 | 4:32:00 PM | 8.5 | 8.3 | 32.4 | 28.8 | 2.1 | 2.5 |
| WSR02 | 20230708 | Sunny | Moderate | Mid-Ebb | Bottom | 9 | 4:31:00 PM | 8.3 | 8.3 | 32.6 | 29.0 | 1.9 | 3.0 |
| WSR02 | 20230708 | Sunny | Moderate | Mid-Ebb | Bottom | 9 | 4:31:00 PM | 8.5 | 8.4 | 32.6 | 29.0 | 2.3 | 2.5 |
| WSR03 | 20230708 | Sunny | Moderate | Mid-Ebb | Surface | 1 | 4:17:00 PM | 9.2 | 8.2 | 32.7 | 28.4 | 2.0 | 2.5 |
| WSR03 | 20230708 | Sunny | Moderate | Mid-Ebb | Surface | 1 | 4:17:00 PM | 9.2 | 8.2 | 32.7 | 28.4 | 2.4 | 2.5 |
| WSR03 | 20230708 | Sunny | Moderate | Mid-Ebb | Middle | 4 | 4:16:00 PM | 9.1 | 8.2 | 32.7 | 28.3 | 2.4 | 3.0 |
| WSR03 | 20230708 | Sunny | Moderate | Mid-Ebb | Middle | 4 | 4:16:00 PM | 9.3 | 8.2 | 32.6 | 28.4 | 2.1 | 3.0 |
| WSR03 | 20230708 | Sunny | Moderate | Mid-Ebb | Bottom | 7 | 4:15:00 PM | 9.1 | 8.2 | 32.9 | 28.3 | 1.7 | 2.5 |
| WSR03 | 20230708 | Sunny | Moderate | Mid-Ebb | Bottom | 7 | 4:15:00 PM | 9.1 | 8.2 | 32.7 | 28.4 | 2.0 | 2.5 |

| Location | Date | Weather | Sea Condition | Tidal | Water Level | Depth (m) | Time | DO (mg/L) | pH | Sal (ppt) | Temp (oC) | Turbidity (NTU) | Suspended Solids (mg/L) |
|----------|----------|---------|---------------|---------|-------------|-----------|------------|-----------|-----|-----------|-----------|-----------------|-------------------------|
| WSR04 | 20230708 | Sunny | Moderate | Mid-Ebb | Surface | 1 | 4:02:00 PM | 8.6 | 8.2 | 32.0 | 28.5 | 2.1 | 3.0 |
| WSR04 | 20230708 | Sunny | Moderate | Mid-Ebb | Surface | 1 | 4:02:00 PM | 8.7 | 8.2 | 32.2 | 28.5 | 2.1 | 2.5 |
| WSR04 | 20230708 | Sunny | Moderate | Mid-Ebb | Middle | 4 | 4:01:00 PM | 8.7 | 8.2 | 32.1 | 28.6 | 1.9 | 2.5 |
| WSR04 | 20230708 | Sunny | Moderate | Mid-Ebb | Middle | 4 | 4:01:00 PM | 8.6 | 8.2 | 32.1 | 28.4 | 1.9 | 2.5 |
| WSR04 | 20230708 | Sunny | Moderate | Mid-Ebb | Bottom | 6 | 4:00:00 PM | 8.8 | 8.2 | 32.1 | 28.5 | 1.9 | 3.0 |
| WSR04 | 20230708 | Sunny | Moderate | Mid-Ebb | Bottom | 6 | 4:00:00 PM | 8.8 | 8.2 | 32.2 | 28.4 | 2.1 | 5.0 |
| WSR16 | 20230708 | Sunny | Moderate | Mid-Ebb | Surface | 1 | 2:52:00 PM | 9.6 | 8.2 | 32.2 | 28.7 | 2.2 | 2.5 |
| WSR16 | 20230708 | Sunny | Moderate | Mid-Ebb | Surface | 1 | 2:52:00 PM | 9.5 | 8.2 | 32.2 | 28.8 | 2.3 | 2.5 |
| WSR16 | 20230708 | Sunny | Moderate | Mid-Ebb | Middle | 8 | 2:51:00 PM | 9.6 | 8.2 | 32.1 | 28.8 | 1.9 | 2.5 |
| WSR16 | 20230708 | Sunny | Moderate | Mid-Ebb | Middle | 8 | 2:51:00 PM | 9.4 | 8.2 | 32.4 | 28.8 | 2.2 | 2.5 |
| WSR16 | 20230708 | Sunny | Moderate | Mid-Ebb | Bottom | 15 | 2:50:00 PM | 9.4 | 8.2 | 32.4 | 28.7 | 1.9 | 2.5 |
| WSR16 | 20230708 | Sunny | Moderate | Mid-Ebb | Bottom | 15 | 2:50:00 PM | 9.4 | 8.2 | 32.3 | 28.7 | 2.2 | 2.5 |
| WSR33 | 20230708 | Sunny | Moderate | Mid-Ebb | Surface | 1 | 3:47:00 PM | 9.0 | 8.3 | 32.8 | 28.9 | 2.2 | 2.5 |
| WSR33 | 20230708 | Sunny | Moderate | Mid-Ebb | Surface | 1 | 3:47:00 PM | 8.9 | 8.3 | 32.5 | 29.0 | 2.2 | 2.5 |
| WSR33 | 20230708 | Sunny | Moderate | Mid-Ebb | Middle | 4 | 3:46:00 PM | 9.1 | 8.3 | 32.7 | 28.8 | 2.1 | 2.5 |
| WSR33 | 20230708 | Sunny | Moderate | Mid-Ebb | Middle | 4 | 3:46:00 PM | 9.1 | 8.3 | 32.6 | 29.0 | 2.3 | 3.0 |
| WSR33 | 20230708 | Sunny | Moderate | Mid-Ebb | Bottom | 6 | 3:45:00 PM | 8.9 | 8.3 | 32.6 | 28.9 | 2.1 | 3.0 |
| WSR33 | 20230708 | Sunny | Moderate | Mid-Ebb | Bottom | 6 | 3:45:00 PM | 9.1 | 8.3 | 32.7 | 28.9 | 2.3 | 2.5 |
| WSR36 | 20230708 | Sunny | Moderate | Mid-Ebb | Surface | 1 | 3:30:00 PM | 9.2 | 8.4 | 32.4 | 28.8 | 2.3 | 3.0 |
| WSR36 | 20230708 | Sunny | Moderate | Mid-Ebb | Surface | 1 | 3:30:00 PM | 9.2 | 8.4 | 32.6 | 28.7 | 2.1 | 2.5 |
| WSR36 | 20230708 | Sunny | Moderate | Mid-Ebb | Middle | 3 | 3:30:00 PM | 9.2 | 8.4 | 32.4 | 28.8 | 2.4 | 3.0 |
| WSR36 | 20230708 | Sunny | Moderate | Mid-Ebb | Middle | 3 | 3:30:00 PM | 9.2 | 8.4 | 32.4 | 28.8 | 2.4 | 2.5 |
| WSR36 | 20230708 | Sunny | Moderate | Mid-Ebb | Bottom | 6 | 3:29:00 PM | 9.3 | 8.4 | 32.4 | 28.8 | 1.8 | 3.0 |
| WSR36 | 20230708 | Sunny | Moderate | Mid-Ebb | Bottom | 6 | 3:29:00 PM | 9.3 | 8.3 | 32.6 | 28.8 | 2.1 | 2.5 |
| WSR37 | 20230708 | Sunny | Moderate | Mid-Ebb | Surface | 1 | 3:16:00 PM | 8.9 | 8.2 | 33.0 | 28.8 | 2.1 | 3.0 |
| WSR37 | 20230708 | Sunny | Moderate | Mid-Ebb | Surface | 1 | 3:16:00 PM | 8.8 | 8.2 | 32.8 | 28.8 | 2.3 | 3.0 |
| WSR37 | 20230708 | Sunny | Moderate | Mid-Ebb | Middle | 4 | 3:15:00 PM | 9.0 | 8.2 | 32.9 | 28.8 | 2.2 | 2.5 |
| WSR37 | 20230708 | Sunny | Moderate | Mid-Ebb | Middle | 4 | 3:15:00 PM | 8.9 | 8.2 | 33.0 | 28.8 | 2.2 | 3.0 |
| WSR37 | 20230708 | Sunny | Moderate | Mid-Ebb | Bottom | 7 | 3:14:00 PM | 8.8 | 8.2 | 33.0 | 28.9 | 2.3 | 2.5 |
| WSR37 | 20230708 | Sunny | Moderate | Mid-Ebb | Bottom | 7 | 3:14:00 PM | 9.0 | 8.2 | 32.8 | 28.9 | 2.1 | 3.0 |

| Location | Date | Weather | Sea Condition | Tidal | Water Level | Depth (m) | Time | DO (mg/L) | pH | Sal (ppt) | Temp (oC) | Turbidity (NTU) | Suspended Solids (mg/L) |
|----------|----------|---------|---------------|---------|-------------|-----------|------------|-----------|-----|-----------|-----------|-----------------|-------------------------|
| CE | 20230710 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 4:13:00 PM | 8.7 | 8.3 | 31.7 | 28.5 | 2.9 | 5.0 |
| CE | 20230710 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 4:13:00 PM | 8.7 | 8.3 | 31.7 | 28.5 | 3.1 | 3.0 |
| CE | 20230710 | Cloudy | Moderate | Mid-Ebb | Middle | 11 | 4:12:00 PM | 8.8 | 8.2 | 31.8 | 28.4 | 3.0 | 2.5 |
| CE | 20230710 | Cloudy | Moderate | Mid-Ebb | Middle | 11 | 4:12:00 PM | 8.8 | 8.3 | 31.6 | 28.5 | 3.1 | 4.0 |
| CE | 20230710 | Cloudy | Moderate | Mid-Ebb | Bottom | 22 | 4:11:00 PM | 8.6 | 8.3 | 31.7 | 28.5 | 3.2 | 5.0 |
| CE | 20230710 | Cloudy | Moderate | Mid-Ebb | Bottom | 22 | 4:11:00 PM | 8.7 | 8.3 | 31.6 | 28.5 | 3.2 | 5.0 |
| CF | 20230710 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 7:02:00 PM | 9.3 | 8.2 | 31.4 | 27.9 | 2.8 | 4.0 |
| CF | 20230710 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 7:02:00 PM | 9.5 | 8.1 | 31.5 | 27.8 | 2.6 | 5.0 |
| CF | 20230710 | Cloudy | Moderate | Mid-Ebb | Middle | 10 | 7:01:00 PM | 9.2 | 8.2 | 31.5 | 27.9 | 2.7 | 2.5 |
| CF | 20230710 | Cloudy | Moderate | Mid-Ebb | Middle | 10 | 7:01:00 PM | 9.4 | 8.2 | 31.5 | 27.8 | 2.9 | 3.0 |
| CF | 20230710 | Cloudy | Moderate | Mid-Ebb | Bottom | 20 | 7:00:00 PM | 9.4 | 8.2 | 31.3 | 27.8 | 2.6 | 4.0 |
| CF | 20230710 | Cloudy | Moderate | Mid-Ebb | Bottom | 20 | 7:00:00 PM | 9.3 | 8.2 | 31.5 | 27.9 | 2.7 | 5.0 |
| WSR01 | 20230710 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 6:39:00 PM | 9.1 | 8.2 | 31.6 | 27.7 | 2.0 | 3.0 |
| WSR01 | 20230710 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 6:39:00 PM | 9.0 | 8.2 | 31.6 | 27.8 | 2.3 | 2.5 |
| WSR01 | 20230710 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 6:38:00 PM | 8.9 | 8.2 | 31.7 | 27.8 | 1.9 | 3.0 |
| WSR01 | 20230710 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 6:38:00 PM | 8.9 | 8.2 | 31.6 | 27.8 | 2.1 | 2.5 |
| WSR01 | 20230710 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 6:37:00 PM | 8.8 | 8.1 | 31.7 | 27.9 | 1.9 | 4.0 |
| WSR01 | 20230710 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 6:37:00 PM | 8.9 | 8.2 | 31.7 | 27.9 | 2.1 | 2.5 |
| WSR02 | 20230710 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 6:18:00 PM | 8.4 | 8.3 | 31.8 | 27.9 | 2.0 | 2.5 |
| WSR02 | 20230710 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 6:18:00 PM | 8.6 | 8.3 | 31.8 | 27.9 | 2.2 | 2.5 |
| WSR02 | 20230710 | Cloudy | Moderate | Mid-Ebb | Middle | 5 | 6:17:00 PM | 8.4 | 8.3 | 31.8 | 27.9 | 1.8 | 2.5 |
| WSR02 | 20230710 | Cloudy | Moderate | Mid-Ebb | Middle | 5 | 6:17:00 PM | 8.5 | 8.3 | 31.9 | 27.9 | 1.9 | 2.5 |
| WSR02 | 20230710 | Cloudy | Moderate | Mid-Ebb | Bottom | 8 | 6:16:00 PM | 8.4 | 8.2 | 31.7 | 27.9 | 2.1 | 2.5 |
| WSR02 | 20230710 | Cloudy | Moderate | Mid-Ebb | Bottom | 8 | 6:16:00 PM | 8.6 | 8.3 | 31.7 | 27.9 | 2.2 | 3.0 |
| WSR03 | 20230710 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 6:02:00 PM | 8.9 | 8.3 | 31.9 | 27.9 | 2.1 | 2.5 |
| WSR03 | 20230710 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 6:02:00 PM | 8.6 | 8.3 | 31.7 | 28.0 | 2.4 | 2.5 |
| WSR03 | 20230710 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 6:01:00 PM | 8.7 | 8.3 | 31.9 | 27.9 | 2.0 | 2.5 |
| WSR03 | 20230710 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 6:01:00 PM | 8.9 | 8.3 | 31.9 | 27.9 | 2.3 | 2.5 |
| WSR03 | 20230710 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 6:00:00 PM | 8.6 | 8.3 | 31.9 | 27.9 | 1.9 | 2.5 |
| WSR03 | 20230710 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 6:00:00 PM | 8.6 | 8.3 | 31.8 | 27.8 | 2.1 | 2.5 |

| Location | Date | Weather | Sea Condition | Tidal | Water Level | Depth (m) | Time | DO (mg/L) | pH | Sal (ppt) | Temp (oC) | Turbidity (NTU) | Suspended Solids (mg/L) |
|----------|----------|---------|---------------|---------|-------------|-----------|------------|-----------|-----|-----------|-----------|-----------------|-------------------------|
| WSR04 | 20230710 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 5:47:00 PM | 9.0 | 8.2 | 31.8 | 28.3 | 2.1 | 2.5 |
| WSR04 | 20230710 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 5:47:00 PM | 8.9 | 8.2 | 31.6 | 28.4 | 2.2 | 2.5 |
| WSR04 | 20230710 | Cloudy | Moderate | Mid-Ebb | Middle | 3 | 5:46:00 PM | 8.8 | 8.2 | 31.8 | 28.3 | 1.9 | 3.0 |
| WSR04 | 20230710 | Cloudy | Moderate | Mid-Ebb | Middle | 3 | 5:46:00 PM | 9.0 | 8.2 | 31.6 | 28.2 | 2.2 | 2.5 |
| WSR04 | 20230710 | Cloudy | Moderate | Mid-Ebb | Bottom | 6 | 5:45:00 PM | 8.9 | 8.2 | 31.8 | 28.2 | 1.6 | 2.5 |
| WSR04 | 20230710 | Cloudy | Moderate | Mid-Ebb | Bottom | 6 | 5:45:00 PM | 8.9 | 8.2 | 31.7 | 28.4 | 1.9 | 2.5 |
| WSR16 | 20230710 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 4:37:00 PM | 9.0 | 8.1 | 31.5 | 28.2 | 1.8 | 2.5 |
| WSR16 | 20230710 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 4:37:00 PM | 9.0 | 8.1 | 31.6 | 28.2 | 2.1 | 2.5 |
| WSR16 | 20230710 | Cloudy | Moderate | Mid-Ebb | Middle | 8 | 4:36:00 PM | 9.1 | 8.2 | 31.6 | 28.0 | 2.0 | 2.5 |
| WSR16 | 20230710 | Cloudy | Moderate | Mid-Ebb | Middle | 8 | 4:36:00 PM | 9.1 | 8.2 | 31.7 | 28.0 | 2.2 | 2.5 |
| WSR16 | 20230710 | Cloudy | Moderate | Mid-Ebb | Bottom | 14 | 4:35:00 PM | 8.9 | 8.1 | 31.4 | 28.2 | 1.7 | 2.5 |
| WSR16 | 20230710 | Cloudy | Moderate | Mid-Ebb | Bottom | 14 | 4:35:00 PM | 9.1 | 8.2 | 31.5 | 28.1 | 1.9 | 2.5 |
| WSR33 | 20230710 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 5:33:00 PM | 8.9 | 8.3 | 31.3 | 28.2 | 2.2 | 3.0 |
| WSR33 | 20230710 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 5:33:00 PM | 9.0 | 8.3 | 31.4 | 28.2 | 2.2 | 2.5 |
| WSR33 | 20230710 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 5:32:00 PM | 9.0 | 8.3 | 31.1 | 28.3 | 2.3 | 2.5 |
| WSR33 | 20230710 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 5:32:00 PM | 9.1 | 8.3 | 31.3 | 28.2 | 2.4 | 2.5 |
| WSR33 | 20230710 | Cloudy | Moderate | Mid-Ebb | Bottom | 6 | 5:31:00 PM | 8.8 | 8.3 | 31.3 | 28.3 | 2.1 | 2.5 |
| WSR33 | 20230710 | Cloudy | Moderate | Mid-Ebb | Bottom | 6 | 5:31:00 PM | 9.1 | 8.3 | 31.1 | 28.1 | 2.3 | 2.5 |
| WSR36 | 20230710 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 5:16:00 PM | 9.3 | 8.2 | 31.3 | 28.0 | 2.1 | 2.5 |
| WSR36 | 20230710 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 5:16:00 PM | 9.3 | 8.2 | 31.3 | 27.9 | 2.3 | 2.5 |
| WSR36 | 20230710 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 5:16:00 PM | 9.3 | 8.1 | 31.4 | 28.0 | 2.1 | 2.5 |
| WSR36 | 20230710 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 5:16:00 PM | 9.3 | 8.1 | 31.3 | 28.0 | 2.2 | 2.5 |
| WSR36 | 20230710 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 5:15:00 PM | 9.4 | 8.2 | 31.2 | 28.0 | 2.0 | 2.5 |
| WSR36 | 20230710 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 5:15:00 PM | 9.5 | 8.2 | 31.2 | 27.9 | 2.3 | 2.5 |
| WSR37 | 20230710 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 5:00:00 PM | 8.5 | 8.1 | 31.9 | 28.0 | 1.9 | 4.0 |
| WSR37 | 20230710 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 5:00:00 PM | 8.4 | 8.2 | 32.0 | 28.0 | 2.0 | 2.5 |
| WSR37 | 20230710 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 4:59:00 PM | 8.6 | 8.1 | 32.0 | 28.0 | 1.7 | 3.0 |
| WSR37 | 20230710 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 4:59:00 PM | 8.5 | 8.2 | 32.1 | 27.9 | 1.8 | 4.0 |
| WSR37 | 20230710 | Cloudy | Moderate | Mid-Ebb | Bottom | 8 | 4:58:00 PM | 8.6 | 8.1 | 31.9 | 27.8 | 1.9 | 2.5 |
| WSR37 | 20230710 | Cloudy | Moderate | Mid-Ebb | Bottom | 8 | 4:58:00 PM | 8.7 | 8.1 | 32.1 | 27.8 | 2.0 | 2.5 |

| Location | Date | Weather | Sea Condition | Tidal | Water Level | Depth (m) | Time | DO (mg/L) | pH | Sal (ppt) | Temp (oC) | Turbidity (NTU) | Suspended Solids (mg/L) |
|----------|----------|---------|---------------|---------|-------------|-----------|-------------|-----------|-----|-----------|-----------|-----------------|-------------------------|
| CE | 20230712 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 8:02:00 AM | 8.9 | 8.3 | 33.0 | 27.7 | 3.2 | 4.0 |
| CE | 20230712 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 8:02:00 AM | 8.8 | 8.3 | 33.0 | 27.8 | 3.0 | 3.0 |
| CE | 20230712 | Cloudy | Moderate | Mid-Ebb | Middle | 11 | 8:01:00 AM | 8.9 | 8.3 | 32.9 | 27.7 | 2.9 | 3.0 |
| CE | 20230712 | Cloudy | Moderate | Mid-Ebb | Middle | 11 | 8:01:00 AM | 8.7 | 8.3 | 32.9 | 27.8 | 3.0 | 3.0 |
| CE | 20230712 | Cloudy | Moderate | Mid-Ebb | Bottom | 22 | 8:00:00 AM | 8.8 | 8.3 | 33.1 | 27.7 | 3.2 | 2.5 |
| CE | 20230712 | Cloudy | Moderate | Mid-Ebb | Bottom | 22 | 8:00:00 AM | 8.8 | 8.3 | 33.0 | 27.8 | 2.9 | 4.0 |
| CF | 20230712 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 10:36:00 AM | 8.4 | 8.2 | 33.3 | 27.8 | 2.7 | 2.5 |
| CF | 20230712 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 10:36:00 AM | 8.4 | 8.2 | 33.2 | 27.7 | 2.6 | 2.5 |
| CF | 20230712 | Cloudy | Moderate | Mid-Ebb | Middle | 11 | 10:35:00 AM | 8.4 | 8.2 | 33.3 | 27.8 | 2.6 | 4.0 |
| CF | 20230712 | Cloudy | Moderate | Mid-Ebb | Middle | 11 | 10:35:00 AM | 8.4 | 8.2 | 33.2 | 27.8 | 2.7 | 3.0 |
| CF | 20230712 | Cloudy | Moderate | Mid-Ebb | Bottom | 21 | 10:34:00 AM | 8.4 | 8.2 | 33.3 | 27.7 | 2.6 | 2.5 |
| CF | 20230712 | Cloudy | Moderate | Mid-Ebb | Bottom | 21 | 10:34:00 AM | 8.4 | 8.2 | 33.3 | 27.8 | 2.7 | 2.5 |
| WSR01 | 20230712 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 10:12:00 AM | 9.1 | 8.3 | 32.8 | 27.8 | 2.4 | 2.5 |
| WSR01 | 20230712 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 10:12:00 AM | 9.2 | 8.3 | 33.0 | 27.8 | 2.5 | 2.5 |
| WSR01 | 20230712 | Cloudy | Moderate | Mid-Ebb | Middle | 5 | 10:11:00 AM | 9.1 | 8.3 | 33.0 | 27.8 | 2.3 | 3.0 |
| WSR01 | 20230712 | Cloudy | Moderate | Mid-Ebb | Middle | 5 | 10:11:00 AM | 9.1 | 8.4 | 33.0 | 27.8 | 2.1 | 2.5 |
| WSR01 | 20230712 | Cloudy | Moderate | Mid-Ebb | Bottom | 8 | 10:10:00 AM | 9.1 | 8.4 | 33.0 | 27.7 | 2.0 | 2.5 |
| WSR01 | 20230712 | Cloudy | Moderate | Mid-Ebb | Bottom | 8 | 10:10:00 AM | 9.2 | 8.4 | 32.9 | 27.8 | 2.0 | 2.5 |
| WSR02 | 20230712 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 9:54:00 AM | 8.6 | 8.3 | 32.6 | 27.8 | 2.1 | 4.0 |
| WSR02 | 20230712 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 9:54:00 AM | 8.6 | 8.3 | 32.5 | 27.7 | 2.3 | 4.0 |
| WSR02 | 20230712 | Cloudy | Moderate | Mid-Ebb | Middle | 5 | 9:53:00 AM | 8.6 | 8.3 | 32.6 | 27.8 | 2.0 | 4.0 |
| WSR02 | 20230712 | Cloudy | Moderate | Mid-Ebb | Middle | 5 | 9:53:00 AM | 8.5 | 8.3 | 32.6 | 27.8 | 2.2 | 2.5 |
| WSR02 | 20230712 | Cloudy | Moderate | Mid-Ebb | Bottom | 8 | 9:52:00 AM | 8.6 | 8.3 | 32.6 | 27.8 | 1.9 | 2.5 |
| WSR02 | 20230712 | Cloudy | Moderate | Mid-Ebb | Bottom | 8 | 9:52:00 AM | 8.6 | 8.3 | 32.6 | 27.7 | 2.1 | 2.5 |
| WSR03 | 20230712 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 9:39:00 AM | 8.6 | 8.3 | 32.9 | 27.7 | 1.9 | 4.0 |
| WSR03 | 20230712 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 9:39:00 AM | 8.6 | 8.3 | 33.1 | 27.7 | 2.3 | 2.5 |
| WSR03 | 20230712 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 9:38:00 AM | 8.6 | 8.2 | 33.0 | 27.7 | 2.1 | 3.0 |
| WSR03 | 20230712 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 9:38:00 AM | 8.6 | 8.3 | 33.1 | 27.8 | 2.2 | 5.0 |
| WSR03 | 20230712 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 9:37:00 AM | 8.6 | 8.2 | 33.0 | 27.7 | 1.7 | 4.0 |
| WSR03 | 20230712 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 9:37:00 AM | 8.6 | 8.3 | 33.0 | 27.7 | 2.0 | 3.0 |

| Location | Date | Weather | Sea Condition | Tidal | Water Level | Depth (m) | Time | DO (mg/L) | pH | Sal (ppt) | Temp (oC) | Turbidity (NTU) | Suspended Solids (mg/L) |
|----------|----------|---------|---------------|---------|-------------|-----------|------------|-----------|-----|-----------|-----------|-----------------|-------------------------|
| WSR04 | 20230712 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 9:27:00 AM | 8.5 | 8.2 | 33.1 | 27.8 | 2.1 | 2.5 |
| WSR04 | 20230712 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 9:27:00 AM | 8.4 | 8.2 | 33.0 | 27.8 | 2.1 | 3.0 |
| WSR04 | 20230712 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 9:26:00 AM | 8.4 | 8.2 | 33.0 | 27.8 | 1.9 | 2.5 |
| WSR04 | 20230712 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 9:26:00 AM | 8.4 | 8.2 | 33.2 | 27.7 | 2.2 | 2.5 |
| WSR04 | 20230712 | Cloudy | Moderate | Mid-Ebb | Bottom | 6 | 9:25:00 AM | 8.5 | 8.2 | 33.2 | 27.8 | 1.9 | 2.5 |
| WSR04 | 20230712 | Cloudy | Moderate | Mid-Ebb | Bottom | 6 | 9:25:00 AM | 8.4 | 8.2 | 33.2 | 27.8 | 1.7 | 2.5 |
| WSR16 | 20230712 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 8:24:00 AM | 8.5 | 8.3 | 33.7 | 27.8 | 2.2 | 2.5 |
| WSR16 | 20230712 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 8:24:00 AM | 8.5 | 8.3 | 33.6 | 27.8 | 2.2 | 2.5 |
| WSR16 | 20230712 | Cloudy | Moderate | Mid-Ebb | Middle | 8 | 8:23:00 AM | 8.5 | 8.3 | 33.8 | 27.8 | 2.1 | 2.5 |
| WSR16 | 20230712 | Cloudy | Moderate | Mid-Ebb | Middle | 8 | 8:23:00 AM | 8.5 | 8.2 | 33.7 | 27.8 | 2.3 | 2.5 |
| WSR16 | 20230712 | Cloudy | Moderate | Mid-Ebb | Bottom | 15 | 8:22:00 AM | 8.5 | 8.2 | 33.6 | 27.8 | 2.4 | 2.5 |
| WSR16 | 20230712 | Cloudy | Moderate | Mid-Ebb | Bottom | 15 | 8:22:00 AM | 8.5 | 8.2 | 33.7 | 27.7 | 2.1 | 2.5 |
| WSR33 | 20230712 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 9:13:00 AM | 8.7 | 8.2 | 33.6 | 27.8 | 2.0 | 2.5 |
| WSR33 | 20230712 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 9:13:00 AM | 8.7 | 8.2 | 33.7 | 27.7 | 2.3 | 2.5 |
| WSR33 | 20230712 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 9:12:00 AM | 8.7 | 8.2 | 33.7 | 27.7 | 2.1 | 5.0 |
| WSR33 | 20230712 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 9:12:00 AM | 8.7 | 8.2 | 33.6 | 27.7 | 2.4 | 3.0 |
| WSR33 | 20230712 | Cloudy | Moderate | Mid-Ebb | Bottom | 6 | 9:11:00 AM | 8.7 | 8.2 | 33.6 | 27.8 | 1.9 | 3.0 |
| WSR33 | 20230712 | Cloudy | Moderate | Mid-Ebb | Bottom | 6 | 9:11:00 AM | 8.8 | 8.2 | 33.6 | 27.7 | 2.1 | 3.0 |
| WSR36 | 20230712 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 8:59:00 AM | 8.9 | 8.2 | 33.1 | 27.8 | 2.2 | 5.0 |
| WSR36 | 20230712 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 8:59:00 AM | 8.9 | 8.2 | 33.2 | 27.8 | 2.2 | 3.0 |
| WSR36 | 20230712 | Cloudy | Moderate | Mid-Ebb | Middle | 3 | 8:59:00 AM | 8.8 | 8.2 | 33.1 | 27.8 | 2.4 | 4.0 |
| WSR36 | 20230712 | Cloudy | Moderate | Mid-Ebb | Middle | 3 | 8:59:00 AM | 8.8 | 8.2 | 33.1 | 27.8 | 2.2 | 2.5 |
| WSR36 | 20230712 | Cloudy | Moderate | Mid-Ebb | Bottom | 6 | 8:58:00 AM | 8.8 | 8.2 | 33.2 | 27.8 | 1.9 | 3.0 |
| WSR36 | 20230712 | Cloudy | Moderate | Mid-Ebb | Bottom | 6 | 8:58:00 AM | 8.9 | 8.2 | 33.2 | 27.8 | 2.2 | 5.0 |
| WSR37 | 20230712 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 8:46:00 AM | 8.9 | 8.2 | 33.7 | 27.8 | 2.1 | 2.5 |
| WSR37 | 20230712 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 8:46:00 AM | 8.8 | 8.2 | 33.6 | 27.7 | 2.3 | 2.5 |
| WSR37 | 20230712 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 8:45:00 AM | 8.8 | 8.2 | 33.7 | 27.8 | 1.7 | 3.0 |
| WSR37 | 20230712 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 8:45:00 AM | 8.8 | 8.2 | 33.7 | 27.8 | 2.0 | 4.0 |
| WSR37 | 20230712 | Cloudy | Moderate | Mid-Ebb | Bottom | 8 | 8:44:00 AM | 8.9 | 8.2 | 33.7 | 27.8 | 1.7 | 2.5 |
| WSR37 | 20230712 | Cloudy | Moderate | Mid-Ebb | Bottom | 8 | 8:44:00 AM | 8.9 | 8.2 | 33.7 | 27.7 | 2.0 | 2.5 |

| Location | Date | Weather | Sea Condition | Tidal | Water Level | Depth (m) | Time | DO (mg/L) | pH | Sal (ppt) | Temp (oC) | Turbidity (NTU) | Suspended Solids (mg/L) |
|----------|----------|---------|---------------|---------|-------------|-----------|-------------|-----------|-----|-----------|-----------|-----------------|-------------------------|
| CE | 20230714 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 8:33:00 AM | 9.0 | 8.3 | 32.6 | 28.0 | 3.3 | 2.5 |
| CE | 20230714 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 8:33:00 AM | 8.9 | 8.3 | 32.4 | 28.0 | 3.2 | 2.5 |
| CE | 20230714 | Cloudy | Moderate | Mid-Ebb | Middle | 10 | 8:32:00 AM | 8.9 | 8.3 | 32.5 | 28.0 | 3.2 | 2.5 |
| CE | 20230714 | Cloudy | Moderate | Mid-Ebb | Middle | 10 | 8:32:00 AM | 9.0 | 8.3 | 32.4 | 28.0 | 3.1 | 2.5 |
| CE | 20230714 | Cloudy | Moderate | Mid-Ebb | Bottom | 20 | 8:31:00 AM | 9.0 | 8.3 | 32.6 | 28.0 | 3.4 | 2.5 |
| CE | 20230714 | Cloudy | Moderate | Mid-Ebb | Bottom | 20 | 8:31:00 AM | 9.0 | 8.3 | 32.4 | 27.9 | 3.1 | 2.5 |
| CF | 20230714 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 11:17:00 AM | 8.3 | 8.4 | 33.0 | 28.2 | 2.8 | 2.5 |
| CF | 20230714 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 11:17:00 AM | 8.3 | 8.4 | 32.9 | 28.2 | 2.9 | 2.5 |
| CF | 20230714 | Cloudy | Moderate | Mid-Ebb | Middle | 11 | 11:16:00 AM | 8.4 | 8.4 | 33.1 | 28.3 | 2.9 | 2.5 |
| CF | 20230714 | Cloudy | Moderate | Mid-Ebb | Middle | 11 | 11:16:00 AM | 8.4 | 8.3 | 33.1 | 28.2 | 2.8 | 2.5 |
| CF | 20230714 | Cloudy | Moderate | Mid-Ebb | Bottom | 20 | 11:15:00 AM | 8.3 | 8.3 | 33.1 | 28.3 | 2.8 | 2.5 |
| CF | 20230714 | Cloudy | Moderate | Mid-Ebb | Bottom | 20 | 11:15:00 AM | 8.3 | 8.4 | 33.1 | 28.3 | 2.7 | 2.5 |
| WSR01 | 20230714 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 10:53:00 AM | 8.7 | 8.3 | 33.6 | 28.1 | 2.4 | 2.5 |
| WSR01 | 20230714 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 10:53:00 AM | 8.6 | 8.2 | 33.6 | 28.0 | 2.4 | 2.5 |
| WSR01 | 20230714 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 10:52:00 AM | 8.6 | 8.3 | 33.7 | 28.1 | 2.3 | 2.5 |
| WSR01 | 20230714 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 10:52:00 AM | 8.6 | 8.2 | 33.6 | 28.0 | 2.4 | 2.5 |
| WSR01 | 20230714 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 10:51:00 AM | 8.6 | 8.3 | 33.6 | 28.0 | 1.8 | 2.5 |
| WSR01 | 20230714 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 10:51:00 AM | 8.6 | 8.2 | 33.7 | 28.1 | 2.1 | 2.5 |
| WSR02 | 20230714 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 10:35:00 AM | 9.3 | 8.3 | 33.2 | 28.6 | 1.9 | 3.0 |
| WSR02 | 20230714 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 10:35:00 AM | 9.3 | 8.4 | 33.1 | 28.5 | 2.2 | 4.0 |
| WSR02 | 20230714 | Cloudy | Moderate | Mid-Ebb | Middle | 5 | 10:34:00 AM | 9.3 | 8.4 | 33.2 | 28.5 | 1.9 | 2.5 |
| WSR02 | 20230714 | Cloudy | Moderate | Mid-Ebb | Middle | 5 | 10:34:00 AM | 9.3 | 8.3 | 33.2 | 28.5 | 2.0 | 2.5 |
| WSR02 | 20230714 | Cloudy | Moderate | Mid-Ebb | Bottom | 8 | 10:33:00 AM | 9.4 | 8.3 | 33.2 | 28.6 | 1.6 | 2.5 |
| WSR02 | 20230714 | Cloudy | Moderate | Mid-Ebb | Bottom | 8 | 10:33:00 AM | 9.3 | 8.3 | 33.2 | 28.6 | 1.6 | 2.5 |
| WSR03 | 20230714 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 10:17:00 AM | 8.4 | 8.3 | 33.1 | 28.3 | 2.3 | 2.5 |
| WSR03 | 20230714 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 10:17:00 AM | 8.5 | 8.4 | 33.0 | 28.2 | 2.3 | 2.5 |
| WSR03 | 20230714 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 10:16:00 AM | 8.5 | 8.4 | 33.1 | 28.2 | 2.4 | 2.5 |
| WSR03 | 20230714 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 10:16:00 AM | 8.4 | 8.4 | 33.1 | 28.3 | 2.2 | 2.5 |
| WSR03 | 20230714 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 10:15:00 AM | 8.4 | 8.4 | 33.1 | 28.2 | 2.5 | 2.5 |
| WSR03 | 20230714 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 10:15:00 AM | 8.4 | 8.4 | 33.2 | 28.3 | 2.1 | 2.5 |

| Location | Date | Weather | Sea Condition | Tidal | Water Level | Depth (m) | Time | DO (mg/L) | pH | Sal (ppt) | Temp (oC) | Turbidity (NTU) | Suspended Solids (mg/L) |
|----------|----------|---------|---------------|---------|-------------|-----------|-------------|-----------|-----|-----------|-----------|-----------------|-------------------------|
| WSR04 | 20230714 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 10:05:00 AM | 8.5 | 8.3 | 33.0 | 28.2 | 2.5 | 2.5 |
| WSR04 | 20230714 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 10:05:00 AM | 8.6 | 8.3 | 32.9 | 28.3 | 2.3 | 2.5 |
| WSR04 | 20230714 | Cloudy | Moderate | Mid-Ebb | Middle | 3 | 10:04:00 AM | 8.5 | 8.3 | 33.0 | 28.2 | 2.3 | 2.5 |
| WSR04 | 20230714 | Cloudy | Moderate | Mid-Ebb | Middle | 3 | 10:04:00 AM | 8.5 | 8.3 | 32.9 | 28.3 | 2.1 | 2.5 |
| WSR04 | 20230714 | Cloudy | Moderate | Mid-Ebb | Bottom | 6 | 10:03:00 AM | 8.6 | 8.3 | 33.0 | 28.2 | 2.0 | 2.5 |
| WSR04 | 20230714 | Cloudy | Moderate | Mid-Ebb | Bottom | 6 | 10:03:00 AM | 8.5 | 8.3 | 33.1 | 28.2 | 2.3 | 2.5 |
| WSR16 | 20230714 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 8:57:00 AM | 9.1 | 8.2 | 32.8 | 28.0 | 2.0 | 2.5 |
| WSR16 | 20230714 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 8:57:00 AM | 9.1 | 8.2 | 32.9 | 28.0 | 2.0 | 2.5 |
| WSR16 | 20230714 | Cloudy | Moderate | Mid-Ebb | Middle | 8 | 8:56:00 AM | 9.1 | 8.2 | 32.8 | 28.0 | 2.3 | 2.5 |
| WSR16 | 20230714 | Cloudy | Moderate | Mid-Ebb | Middle | 8 | 8:56:00 AM | 9.1 | 8.2 | 32.9 | 28.0 | 2.3 | 2.5 |
| WSR16 | 20230714 | Cloudy | Moderate | Mid-Ebb | Bottom | 15 | 8:55:00 AM | 9.1 | 8.2 | 32.8 | 27.9 | 1.9 | 2.5 |
| WSR16 | 20230714 | Cloudy | Moderate | Mid-Ebb | Bottom | 15 | 8:55:00 AM | 9.0 | 8.2 | 32.9 | 28.0 | 2.0 | 2.5 |
| WSR33 | 20230714 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 9:48:00 AM | 9.1 | 8.2 | 33.6 | 28.3 | 2.5 | 2.5 |
| WSR33 | 20230714 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 9:48:00 AM | 9.1 | 8.2 | 33.5 | 28.4 | 2.3 | 2.5 |
| WSR33 | 20230714 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 9:47:00 AM | 9.2 | 8.2 | 33.7 | 28.3 | 2.1 | 2.5 |
| WSR33 | 20230714 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 9:47:00 AM | 9.1 | 8.2 | 33.6 | 28.3 | 2.3 | 2.5 |
| WSR33 | 20230714 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 9:46:00 AM | 9.2 | 8.2 | 33.6 | 28.3 | 2.3 | 2.5 |
| WSR33 | 20230714 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 9:46:00 AM | 9.1 | 8.2 | 33.5 | 28.4 | 2.5 | 2.5 |
| WSR36 | 20230714 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 9:33:00 AM | 8.5 | 8.3 | 33.1 | 28.0 | 2.2 | 2.5 |
| WSR36 | 20230714 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 9:33:00 AM | 8.6 | 8.3 | 33.3 | 28.0 | 2.2 | 2.5 |
| WSR36 | 20230714 | Cloudy | Moderate | Mid-Ebb | Middle | 3 | 9:33:00 AM | 8.5 | 8.3 | 33.1 | 27.9 | 2.0 | 2.5 |
| WSR36 | 20230714 | Cloudy | Moderate | Mid-Ebb | Middle | 3 | 9:33:00 AM | 8.6 | 8.3 | 33.2 | 28.0 | 2.2 | 2.5 |
| WSR36 | 20230714 | Cloudy | Moderate | Mid-Ebb | Bottom | 5 | 9:32:00 AM | 8.5 | 8.3 | 33.3 | 28.0 | 2.2 | 2.5 |
| WSR36 | 20230714 | Cloudy | Moderate | Mid-Ebb | Bottom | 5 | 9:32:00 AM | 8.5 | 8.3 | 33.2 | 28.0 | 2.4 | 2.5 |
| WSR37 | 20230714 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 9:19:00 AM | 9.2 | 8.4 | 32.8 | 27.9 | 2.3 | 2.5 |
| WSR37 | 20230714 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 9:19:00 AM | 9.3 | 8.4 | 32.9 | 27.9 | 2.5 | 2.5 |
| WSR37 | 20230714 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 9:18:00 AM | 9.3 | 8.4 | 33.0 | 28.0 | 2.4 | 2.5 |
| WSR37 | 20230714 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 9:18:00 AM | 9.3 | 8.3 | 33.0 | 27.9 | 2.5 | 2.5 |
| WSR37 | 20230714 | Cloudy | Moderate | Mid-Ebb | Bottom | 8 | 9:17:00 AM | 9.2 | 8.3 | 33.0 | 28.0 | 2.5 | 2.5 |
| WSR37 | 20230714 | Cloudy | Moderate | Mid-Ebb | Bottom | 8 | 9:17:00 AM | 9.2 | 8.4 | 32.8 | 27.9 | 2.3 | 2.5 |

| Location | Date | Weather | Sea Condition | Tidal | Water Level | Depth (m) | Time | DO (mg/L) | pH | Sal (ppt) | Temp (oC) | Turbidity (NTU) | Suspended Solids (mg/L) |
|----------|----------|---------|---------------|---------|-------------|-----------|-------------|-----------|-----|-----------|-----------|-----------------|-------------------------|
| CE | 20230718 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 11:06:00 AM | 9.1 | 8.4 | 33.4 | 28.4 | 3.1 | 8.0 |
| CE | 20230718 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 11:06:00 AM | 8.9 | 8.3 | 33.6 | 28.3 | 3.2 | 8.0 |
| CE | 20230718 | Cloudy | Moderate | Mid-Ebb | Middle | 12 | 11:05:00 AM | 9.0 | 8.3 | 33.5 | 28.4 | 3.0 | 8.0 |
| CE | 20230718 | Cloudy | Moderate | Mid-Ebb | Middle | 12 | 11:05:00 AM | 9.0 | 8.4 | 33.5 | 28.4 | 3.1 | 5.0 |
| CE | 20230718 | Cloudy | Moderate | Mid-Ebb | Bottom | 23 | 11:04:00 AM | 9.0 | 8.3 | 33.5 | 28.4 | 3.3 | 6.0 |
| CE | 20230718 | Cloudy | Moderate | Mid-Ebb | Bottom | 23 | 11:04:00 AM | 9.1 | 8.3 | 33.6 | 28.4 | 3.3 | 8.0 |
| CF | 20230718 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 1:54:00 PM | 8.4 | 8.3 | 32.5 | 27.9 | 2.6 | 8.0 |
| CF | 20230718 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 1:54:00 PM | 8.5 | 8.3 | 32.6 | 28.0 | 2.4 | 9.0 |
| CF | 20230718 | Cloudy | Moderate | Mid-Ebb | Middle | 11 | 1:53:00 PM | 8.4 | 8.3 | 32.6 | 27.9 | 2.9 | 7.0 |
| CF | 20230718 | Cloudy | Moderate | Mid-Ebb | Middle | 11 | 1:53:00 PM | 8.5 | 8.3 | 32.6 | 27.9 | 2.6 | 8.0 |
| CF | 20230718 | Cloudy | Moderate | Mid-Ebb | Bottom | 20 | 1:52:00 PM | 8.5 | 8.2 | 32.5 | 27.9 | 2.6 | 7.0 |
| CF | 20230718 | Cloudy | Moderate | Mid-Ebb | Bottom | 20 | 1:52:00 PM | 8.4 | 8.2 | 32.5 | 27.9 | 2.7 | 6.0 |
| WSR01 | 20230718 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 1:31:00 PM | 9.5 | 8.3 | 32.6 | 28.4 | 2.2 | 8.0 |
| WSR01 | 20230718 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 1:31:00 PM | 9.6 | 8.3 | 32.6 | 28.3 | 2.3 | 8.0 |
| WSR01 | 20230718 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 1:30:00 PM | 9.5 | 8.2 | 32.7 | 28.3 | 1.9 | 7.0 |
| WSR01 | 20230718 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 1:30:00 PM | 9.5 | 8.3 | 32.7 | 28.3 | 2.2 | 7.0 |
| WSR01 | 20230718 | Cloudy | Moderate | Mid-Ebb | Bottom | 8 | 1:29:00 PM | 9.5 | 8.2 | 32.6 | 28.4 | 1.9 | 7.0 |
| WSR01 | 20230718 | Cloudy | Moderate | Mid-Ebb | Bottom | 8 | 1:29:00 PM | 9.5 | 8.3 | 32.6 | 28.4 | 2.3 | 8.0 |
| WSR02 | 20230718 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 1:10:00 PM | 9.2 | 8.4 | 33.5 | 28.2 | 2.3 | 8.0 |
| WSR02 | 20230718 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 1:10:00 PM | 9.2 | 8.3 | 33.4 | 28.1 | 2.1 | 8.0 |
| WSR02 | 20230718 | Cloudy | Moderate | Mid-Ebb | Middle | 5 | 1:09:00 PM | 9.2 | 8.3 | 33.6 | 28.1 | 1.9 | 8.0 |
| WSR02 | 20230718 | Cloudy | Moderate | Mid-Ebb | Middle | 5 | 1:09:00 PM | 9.2 | 8.3 | 33.5 | 28.1 | 2.3 | 7.0 |
| WSR02 | 20230718 | Cloudy | Moderate | Mid-Ebb | Bottom | 9 | 1:08:00 PM | 9.3 | 8.3 | 33.6 | 28.0 | 2.3 | 7.0 |
| WSR02 | 20230718 | Cloudy | Moderate | Mid-Ebb | Bottom | 9 | 1:08:00 PM | 9.2 | 8.3 | 33.6 | 28.1 | 2.3 | 8.0 |
| WSR03 | 20230718 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 12:54:00 PM | 8.3 | 8.2 | 32.9 | 28.5 | 1.9 | 6.0 |
| WSR03 | 20230718 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 12:54:00 PM | 8.4 | 8.2 | 33.0 | 28.4 | 2.2 | 9.0 |
| WSR03 | 20230718 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 12:53:00 PM | 8.5 | 8.2 | 33.0 | 28.4 | 1.8 | 6.0 |
| WSR03 | 20230718 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 12:53:00 PM | 8.4 | 8.2 | 33.0 | 28.5 | 2.0 | 6.0 |
| WSR03 | 20230718 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 12:52:00 PM | 8.4 | 8.2 | 32.9 | 28.4 | 1.9 | 6.0 |
| WSR03 | 20230718 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 12:52:00 PM | 8.3 | 8.2 | 32.9 | 28.4 | 2.1 | 6.0 |

| Location | Date | Weather | Sea Condition | Tidal | Water Level | Depth (m) | Time | DO (mg/L) | pH | Sal (ppt) | Temp (oC) | Turbidity (NTU) | Suspended Solids (mg/L) |
|----------|----------|---------|---------------|---------|-------------|-----------|-------------|-----------|-----|-----------|-----------|-----------------|-------------------------|
| WSR04 | 20230718 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 12:39:00 PM | 8.8 | 8.2 | 33.1 | 27.7 | 2.3 | 7.0 |
| WSR04 | 20230718 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 12:39:00 PM | 8.7 | 8.2 | 33.2 | 27.8 | 2.4 | 6.0 |
| WSR04 | 20230718 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 12:38:00 PM | 8.7 | 8.2 | 33.2 | 27.7 | 2.1 | 7.0 |
| WSR04 | 20230718 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 12:38:00 PM | 8.7 | 8.2 | 33.1 | 27.8 | 2.2 | 7.0 |
| WSR04 | 20230718 | Cloudy | Moderate | Mid-Ebb | Bottom | 6 | 12:37:00 PM | 8.8 | 8.2 | 33.2 | 27.7 | 2.2 | 7.0 |
| WSR04 | 20230718 | Cloudy | Moderate | Mid-Ebb | Bottom | 6 | 12:37:00 PM | 8.7 | 8.2 | 33.1 | 27.8 | 2.3 | 7.0 |
| WSR16 | 20230718 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 11:29:00 AM | 8.9 | 8.2 | 33.3 | 27.7 | 1.9 | 6.0 |
| WSR16 | 20230718 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 11:29:00 AM | 9.1 | 8.2 | 33.3 | 27.8 | 2.3 | 7.0 |
| WSR16 | 20230718 | Cloudy | Moderate | Mid-Ebb | Middle | 8 | 11:28:00 AM | 9.0 | 8.2 | 33.4 | 27.8 | 1.6 | 10.0 |
| WSR16 | 20230718 | Cloudy | Moderate | Mid-Ebb | Middle | 8 | 11:28:00 AM | 8.9 | 8.2 | 33.3 | 27.8 | 1.8 | 7.0 |
| WSR16 | 20230718 | Cloudy | Moderate | Mid-Ebb | Bottom | 15 | 11:27:00 AM | 9.0 | 8.2 | 33.4 | 27.8 | 1.7 | 8.0 |
| WSR16 | 20230718 | Cloudy | Moderate | Mid-Ebb | Bottom | 15 | 11:27:00 AM | 9.0 | 8.2 | 33.3 | 27.7 | 1.8 | 6.0 |
| WSR33 | 20230718 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 12:24:00 PM | 8.8 | 8.2 | 32.6 | 28.3 | 2.2 | 7.0 |
| WSR33 | 20230718 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 12:24:00 PM | 8.7 | 8.2 | 32.5 | 28.3 | 2.2 | 7.0 |
| WSR33 | 20230718 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 12:23:00 PM | 8.9 | 8.2 | 32.6 | 28.2 | 2.3 | 7.0 |
| WSR33 | 20230718 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 12:23:00 PM | 8.8 | 8.1 | 32.5 | 28.3 | 2.4 | 8.0 |
| WSR33 | 20230718 | Cloudy | Moderate | Mid-Ebb | Bottom | 6 | 12:22:00 PM | 8.7 | 8.2 | 32.6 | 28.3 | 2.0 | 6.0 |
| WSR33 | 20230718 | Cloudy | Moderate | Mid-Ebb | Bottom | 6 | 12:22:00 PM | 8.8 | 8.2 | 32.6 | 28.3 | 2.3 | 8.0 |
| WSR36 | 20230718 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 12:07:00 PM | 9.1 | 8.4 | 32.6 | 27.9 | 2.2 | 7.0 |
| WSR36 | 20230718 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 12:07:00 PM | 9.3 | 8.4 | 32.5 | 27.9 | 2.3 | 9.0 |
| WSR36 | 20230718 | Cloudy | Moderate | Mid-Ebb | Middle | 3 | 12:07:00 PM | 9.2 | 8.3 | 32.6 | 27.8 | 2.0 | 10.0 |
| WSR36 | 20230718 | Cloudy | Moderate | Mid-Ebb | Middle | 3 | 12:07:00 PM | 9.1 | 8.3 | 32.5 | 27.9 | 2.3 | 7.0 |
| WSR36 | 20230718 | Cloudy | Moderate | Mid-Ebb | Bottom | 6 | 12:06:00 PM | 9.2 | 8.3 | 32.5 | 27.9 | 2.1 | 9.0 |
| WSR36 | 20230718 | Cloudy | Moderate | Mid-Ebb | Bottom | 6 | 12:06:00 PM | 9.1 | 8.4 | 32.5 | 27.9 | 2.2 | 7.0 |
| WSR37 | 20230718 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 11:53:00 AM | 9.1 | 8.3 | 33.2 | 27.8 | 2.2 | 6.0 |
| WSR37 | 20230718 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 11:53:00 AM | 9.2 | 8.2 | 33.1 | 27.9 | 2.2 | 8.0 |
| WSR37 | 20230718 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 11:52:00 AM | 9.1 | 8.3 | 33.0 | 27.8 | 2.3 | 9.0 |
| WSR37 | 20230718 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 11:52:00 AM | 9.1 | 8.2 | 33.2 | 27.8 | 2.3 | 10.0 |
| WSR37 | 20230718 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 11:51:00 AM | 9.2 | 8.3 | 33.0 | 27.9 | 2.4 | 9.0 |
| WSR37 | 20230718 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 11:51:00 AM | 9.2 | 8.3 | 33.1 | 27.8 | 2.4 | 8.0 |

| Location | Date | Weather | Sea Condition | Tidal | Water Level | Depth (m) | Time | DO (mg/L) | pH | Sal (ppt) | Temp (oC) | Turbidity (NTU) | Suspended Solids (mg/L) |
|----------|----------|---------|---------------|---------|-------------|-----------|-------------|-----------|-----|-----------|-----------|-----------------|-------------------------|
| CE | 20230720 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 12:13:00 PM | 9.3 | 8.2 | 33.3 | 27.9 | 3.4 | 2.5 |
| CE | 20230720 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 12:13:00 PM | 9.1 | 8.2 | 33.4 | 27.9 | 3.4 | 2.5 |
| CE | 20230720 | Cloudy | Moderate | Mid-Ebb | Middle | 11 | 12:12:00 PM | 9.2 | 8.2 | 33.3 | 27.9 | 3.2 | 2.5 |
| CE | 20230720 | Cloudy | Moderate | Mid-Ebb | Middle | 11 | 12:12:00 PM | 9.1 | 8.2 | 33.3 | 28.0 | 3.4 | 2.5 |
| CE | 20230720 | Cloudy | Moderate | Mid-Ebb | Bottom | 21 | 12:11:00 PM | 9.3 | 8.2 | 33.3 | 28.0 | 3.3 | 3.0 |
| CE | 20230720 | Cloudy | Moderate | Mid-Ebb | Bottom | 21 | 12:11:00 PM | 9.2 | 8.2 | 33.4 | 28.0 | 3.2 | 2.5 |
| CF | 20230720 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 2:58:00 PM | 9.4 | 8.3 | 32.9 | 28.0 | 2.5 | 2.5 |
| CF | 20230720 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 2:58:00 PM | 9.4 | 8.3 | 32.9 | 28.0 | 2.7 | 2.5 |
| CF | 20230720 | Cloudy | Moderate | Mid-Ebb | Middle | 10 | 2:57:00 PM | 9.4 | 8.3 | 32.8 | 27.9 | 2.7 | 3.0 |
| CF | 20230720 | Cloudy | Moderate | Mid-Ebb | Middle | 10 | 2:57:00 PM | 9.4 | 8.3 | 32.9 | 28.0 | 2.8 | 3.0 |
| CF | 20230720 | Cloudy | Moderate | Mid-Ebb | Bottom | 19 | 2:56:00 PM | 9.3 | 8.3 | 32.8 | 28.0 | 2.8 | 2.5 |
| CF | 20230720 | Cloudy | Moderate | Mid-Ebb | Bottom | 19 | 2:56:00 PM | 9.3 | 8.3 | 32.9 | 27.9 | 2.7 | 2.5 |
| WSR01 | 20230720 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 2:34:00 PM | 8.8 | 8.3 | 33.1 | 27.7 | 2.0 | 3.0 |
| WSR01 | 20230720 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 2:34:00 PM | 8.7 | 8.3 | 33.2 | 27.8 | 2.1 | 2.5 |
| WSR01 | 20230720 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 2:33:00 PM | 8.8 | 8.3 | 33.1 | 27.6 | 1.7 | 2.5 |
| WSR01 | 20230720 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 2:33:00 PM | 8.8 | 8.3 | 33.2 | 27.6 | 1.8 | 2.5 |
| WSR01 | 20230720 | Cloudy | Moderate | Mid-Ebb | Bottom | 8 | 2:32:00 PM | 8.9 | 8.3 | 33.1 | 27.6 | 1.9 | 2.5 |
| WSR01 | 20230720 | Cloudy | Moderate | Mid-Ebb | Bottom | 8 | 2:32:00 PM | 8.8 | 8.3 | 33.1 | 27.7 | 1.9 | 2.5 |
| WSR02 | 20230720 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 2:15:00 PM | 9.1 | 8.2 | 33.5 | 27.7 | 2.3 | 2.5 |
| WSR02 | 20230720 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 2:15:00 PM | 9.0 | 8.2 | 33.4 | 27.5 | 2.3 | 3.0 |
| WSR02 | 20230720 | Cloudy | Moderate | Mid-Ebb | Middle | 5 | 2:14:00 PM | 9.1 | 8.2 | 33.4 | 27.6 | 2.2 | 2.5 |
| WSR02 | 20230720 | Cloudy | Moderate | Mid-Ebb | Middle | 5 | 2:14:00 PM | 9.0 | 8.3 | 33.4 | 27.5 | 2.3 | 2.5 |
| WSR02 | 20230720 | Cloudy | Moderate | Mid-Ebb | Bottom | 8 | 2:13:00 PM | 9.2 | 8.2 | 33.4 | 27.6 | 2.1 | 2.5 |
| WSR02 | 20230720 | Cloudy | Moderate | Mid-Ebb | Bottom | 8 | 2:13:00 PM | 8.9 | 8.3 | 33.3 | 27.5 | 2.2 | 2.5 |
| WSR03 | 20230720 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 1:57:00 PM | 9.4 | 8.3 | 33.7 | 27.9 | 2.1 | 2.5 |
| WSR03 | 20230720 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 1:57:00 PM | 9.6 | 8.3 | 33.8 | 28.0 | 2.3 | 2.5 |
| WSR03 | 20230720 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 1:56:00 PM | 9.5 | 8.3 | 33.8 | 28.1 | 2.1 | 2.5 |
| WSR03 | 20230720 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 1:56:00 PM | 9.4 | 8.3 | 33.8 | 28.0 | 2.5 | 3.0 |
| WSR03 | 20230720 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 1:55:00 PM | 9.6 | 8.3 | 33.8 | 28.0 | 2.2 | 2.5 |
| WSR03 | 20230720 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 1:55:00 PM | 9.5 | 8.3 | 33.9 | 28.1 | 2.3 | 2.5 |

| Location | Date | Weather | Sea Condition | Tidal | Water Level | Depth (m) | Time | DO (mg/L) | pH | Sal (ppt) | Temp (oC) | Turbidity (NTU) | Suspended Solids (mg/L) |
|----------|----------|---------|---------------|---------|-------------|-----------|-------------|-----------|-----|-----------|-----------|-----------------|-------------------------|
| WSR04 | 20230720 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 1:45:00 PM | 8.8 | 8.4 | 33.3 | 28.0 | 2.2 | 2.5 |
| WSR04 | 20230720 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 1:45:00 PM | 8.8 | 8.4 | 33.3 | 28.0 | 2.5 | 2.5 |
| WSR04 | 20230720 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 1:44:00 PM | 8.9 | 8.4 | 33.3 | 28.0 | 2.2 | 3.0 |
| WSR04 | 20230720 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 1:44:00 PM | 8.7 | 8.4 | 33.3 | 27.9 | 2.3 | 2.5 |
| WSR04 | 20230720 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 1:43:00 PM | 8.8 | 8.4 | 33.2 | 28.1 | 1.9 | 2.5 |
| WSR04 | 20230720 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 1:43:00 PM | 8.8 | 8.4 | 33.3 | 28.0 | 2.2 | 2.5 |
| WSR16 | 20230720 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 12:35:00 PM | 9.4 | 8.3 | 32.8 | 27.4 | 2.1 | 2.5 |
| WSR16 | 20230720 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 12:35:00 PM | 9.5 | 8.3 | 32.8 | 27.6 | 2.2 | 2.5 |
| WSR16 | 20230720 | Cloudy | Moderate | Mid-Ebb | Middle | 8 | 12:34:00 PM | 9.4 | 8.2 | 32.9 | 27.5 | 2.0 | 2.5 |
| WSR16 | 20230720 | Cloudy | Moderate | Mid-Ebb | Middle | 8 | 12:34:00 PM | 9.5 | 8.3 | 32.8 | 27.6 | 2.1 | 2.5 |
| WSR16 | 20230720 | Cloudy | Moderate | Mid-Ebb | Bottom | 15 | 12:33:00 PM | 9.5 | 8.3 | 32.9 | 27.6 | 2.2 | 2.5 |
| WSR16 | 20230720 | Cloudy | Moderate | Mid-Ebb | Bottom | 15 | 12:33:00 PM | 9.4 | 8.3 | 32.8 | 27.5 | 2.3 | 2.5 |
| WSR33 | 20230720 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 1:28:00 PM | 8.7 | 8.4 | 33.3 | 27.5 | 1.9 | 2.5 |
| WSR33 | 20230720 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 1:28:00 PM | 8.8 | 8.4 | 33.2 | 27.5 | 2.3 | 2.5 |
| WSR33 | 20230720 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 1:27:00 PM | 8.7 | 8.3 | 33.2 | 27.6 | 1.9 | 2.5 |
| WSR33 | 20230720 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 1:27:00 PM | 8.8 | 8.3 | 33.3 | 27.4 | 2.2 | 2.5 |
| WSR33 | 20230720 | Cloudy | Moderate | Mid-Ebb | Bottom | 6 | 1:26:00 PM | 8.9 | 8.3 | 33.2 | 27.5 | 1.9 | 2.5 |
| WSR33 | 20230720 | Cloudy | Moderate | Mid-Ebb | Bottom | 6 | 1:26:00 PM | 8.6 | 8.4 | 33.3 | 27.6 | 2.2 | 2.5 |
| WSR36 | 20230720 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 1:13:00 PM | 8.9 | 8.4 | 33.4 | 27.4 | 2.4 | 3.0 |
| WSR36 | 20230720 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 1:13:00 PM | 8.9 | 8.4 | 33.4 | 27.6 | 2.5 | 2.5 |
| WSR36 | 20230720 | Cloudy | Moderate | Mid-Ebb | Middle | 3 | 1:13:00 PM | 8.8 | 8.4 | 33.4 | 27.4 | 2.2 | 2.5 |
| WSR36 | 20230720 | Cloudy | Moderate | Mid-Ebb | Middle | 3 | 1:13:00 PM | 8.9 | 8.4 | 33.4 | 27.5 | 2.4 | 2.5 |
| WSR36 | 20230720 | Cloudy | Moderate | Mid-Ebb | Bottom | 6 | 1:12:00 PM | 8.9 | 8.4 | 33.3 | 27.6 | 2.0 | 2.5 |
| WSR36 | 20230720 | Cloudy | Moderate | Mid-Ebb | Bottom | 6 | 1:12:00 PM | 9.0 | 8.4 | 33.4 | 27.4 | 2.1 | 3.0 |
| WSR37 | 20230720 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 12:57:00 PM | 8.6 | 8.2 | 33.3 | 27.9 | 2.4 | 2.5 |
| WSR37 | 20230720 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 12:57:00 PM | 8.3 | 8.2 | 33.3 | 28.0 | 2.5 | 2.5 |
| WSR37 | 20230720 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 12:56:00 PM | 8.3 | 8.2 | 33.2 | 28.0 | 2.1 | 2.5 |
| WSR37 | 20230720 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 12:56:00 PM | 8.6 | 8.2 | 33.2 | 28.0 | 2.4 | 2.5 |
| WSR37 | 20230720 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 12:55:00 PM | 8.5 | 8.2 | 33.3 | 27.9 | 1.6 | 2.5 |
| WSR37 | 20230720 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 12:55:00 PM | 8.4 | 8.2 | 33.2 | 27.9 | 1.6 | 2.5 |

| Location | Date | Weather | Sea Condition | Tidal | Water Level | Depth (m) | Time | DO (mg/L) | pH | Sal (ppt) | Temp (oC) | Turbidity (NTU) | Suspended Solids (mg/L) |
|----------|----------|---------|---------------|---------|-------------|-----------|------------|-----------|-----|-----------|-----------|-----------------|-------------------------|
| CE | 20230722 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 1:08:00 PM | 9.2 | 8.4 | 32.8 | 28.0 | 2.9 | 2.5 |
| CE | 20230722 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 1:08:00 PM | 9.2 | 8.3 | 32.7 | 28.0 | 2.9 | 2.5 |
| CE | 20230722 | Cloudy | Moderate | Mid-Ebb | Middle | 12 | 1:07:00 PM | 9.4 | 8.4 | 32.9 | 28.1 | 3.0 | 2.5 |
| CE | 20230722 | Cloudy | Moderate | Mid-Ebb | Middle | 12 | 1:07:00 PM | 9.5 | 8.3 | 32.8 | 28.1 | 3.2 | 2.5 |
| CE | 20230722 | Cloudy | Moderate | Mid-Ebb | Bottom | 23 | 1:06:00 PM | 9.3 | 8.4 | 32.9 | 28.0 | 2.9 | 2.5 |
| CE | 20230722 | Cloudy | Moderate | Mid-Ebb | Bottom | 23 | 1:06:00 PM | 9.5 | 8.4 | 32.8 | 28.1 | 3.0 | 2.5 |
| CF | 20230722 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 3:55:00 PM | 8.4 | 8.4 | 33.0 | 28.0 | 2.5 | 2.5 |
| CF | 20230722 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 3:55:00 PM | 8.6 | 8.4 | 33.0 | 28.0 | 2.7 | 2.5 |
| CF | 20230722 | Cloudy | Moderate | Mid-Ebb | Middle | 10 | 3:54:00 PM | 8.6 | 8.4 | 33.2 | 28.0 | 2.9 | 2.5 |
| CF | 20230722 | Cloudy | Moderate | Mid-Ebb | Middle | 10 | 3:54:00 PM | 8.4 | 8.4 | 33.0 | 28.0 | 2.8 | 4.0 |
| CF | 20230722 | Cloudy | Moderate | Mid-Ebb | Bottom | 18 | 3:53:00 PM | 8.5 | 8.4 | 33.0 | 28.0 | 2.7 | 2.5 |
| CF | 20230722 | Cloudy | Moderate | Mid-Ebb | Bottom | 18 | 3:53:00 PM | 8.5 | 8.4 | 33.2 | 28.0 | 2.7 | 2.5 |
| WSR01 | 20230722 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 3:29:00 PM | 8.7 | 8.3 | 32.0 | 28.1 | 2.2 | 2.5 |
| WSR01 | 20230722 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 3:29:00 PM | 8.5 | 8.3 | 32.2 | 28.1 | 2.3 | 2.5 |
| WSR01 | 20230722 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 3:28:00 PM | 8.5 | 8.3 | 32.3 | 28.2 | 2.0 | 2.5 |
| WSR01 | 20230722 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 3:28:00 PM | 8.5 | 8.3 | 32.0 | 28.2 | 2.1 | 2.5 |
| WSR01 | 20230722 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 3:27:00 PM | 8.6 | 8.3 | 32.2 | 28.2 | 1.9 | 2.5 |
| WSR01 | 20230722 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 3:27:00 PM | 8.6 | 8.3 | 31.9 | 28.2 | 2.0 | 2.5 |
| WSR02 | 20230722 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 3:10:00 PM | 8.5 | 8.3 | 32.4 | 28.4 | 2.3 | 2.5 |
| WSR02 | 20230722 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 3:10:00 PM | 8.7 | 8.2 | 32.3 | 28.3 | 2.4 | 2.5 |
| WSR02 | 20230722 | Cloudy | Moderate | Mid-Ebb | Middle | 5 | 3:09:00 PM | 8.4 | 8.3 | 32.5 | 28.4 | 2.2 | 4.0 |
| WSR02 | 20230722 | Cloudy | Moderate | Mid-Ebb | Middle | 5 | 3:09:00 PM | 8.6 | 8.3 | 32.4 | 28.4 | 2.2 | 2.5 |
| WSR02 | 20230722 | Cloudy | Moderate | Mid-Ebb | Bottom | 9 | 3:08:00 PM | 8.6 | 8.3 | 32.4 | 28.3 | 2.2 | 2.5 |
| WSR02 | 20230722 | Cloudy | Moderate | Mid-Ebb | Bottom | 9 | 3:08:00 PM | 8.5 | 8.3 | 32.4 | 28.3 | 2.3 | 2.5 |
| WSR03 | 20230722 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 2:52:00 PM | 8.8 | 8.3 | 32.4 | 28.2 | 2.4 | 2.5 |
| WSR03 | 20230722 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 2:52:00 PM | 8.9 | 8.3 | 32.5 | 28.3 | 2.3 | 2.5 |
| WSR03 | 20230722 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 2:51:00 PM | 8.8 | 8.3 | 32.3 | 28.3 | 2.2 | 2.5 |
| WSR03 | 20230722 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 2:51:00 PM | 8.9 | 8.3 | 32.4 | 28.2 | 2.2 | 2.5 |
| WSR03 | 20230722 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 2:50:00 PM | 8.7 | 8.3 | 32.3 | 28.3 | 2.1 | 2.5 |
| WSR03 | 20230722 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 2:50:00 PM | 8.7 | 8.3 | 32.4 | 28.2 | 2.3 | 2.5 |

| Location | Date | Weather | Sea Condition | Tidal | Water Level | Depth (m) | Time | DO (mg/L) | pH | Sal (ppt) | Temp (oC) | Turbidity (NTU) | Suspended Solids (mg/L) |
|----------|----------|---------|---------------|---------|-------------|-----------|------------|-----------|-----|-----------|-----------|-----------------|-------------------------|
| WSR04 | 20230722 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 2:37:00 PM | 8.7 | 8.2 | 32.4 | 27.8 | 2.2 | 2.5 |
| WSR04 | 20230722 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 2:37:00 PM | 8.8 | 8.2 | 32.2 | 27.7 | 2.4 | 2.5 |
| WSR04 | 20230722 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 2:36:00 PM | 9.0 | 8.2 | 32.5 | 27.7 | 2.1 | 2.5 |
| WSR04 | 20230722 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 2:36:00 PM | 8.9 | 8.3 | 32.3 | 27.7 | 2.4 | 2.5 |
| WSR04 | 20230722 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 2:35:00 PM | 8.9 | 8.2 | 32.4 | 27.7 | 2.0 | 2.5 |
| WSR04 | 20230722 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 2:35:00 PM | 8.8 | 8.3 | 32.4 | 27.7 | 2.2 | 2.5 |
| WSR16 | 20230722 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 1:31:00 PM | 8.9 | 8.3 | 32.7 | 28.1 | 2.2 | 2.5 |
| WSR16 | 20230722 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 1:31:00 PM | 8.7 | 8.3 | 32.5 | 28.1 | 2.4 | 2.5 |
| WSR16 | 20230722 | Cloudy | Moderate | Mid-Ebb | Middle | 8 | 1:30:00 PM | 8.8 | 8.3 | 32.5 | 28.2 | 2.2 | 2.5 |
| WSR16 | 20230722 | Cloudy | Moderate | Mid-Ebb | Middle | 8 | 1:30:00 PM | 9.0 | 8.3 | 32.4 | 28.1 | 2.2 | 2.5 |
| WSR16 | 20230722 | Cloudy | Moderate | Mid-Ebb | Bottom | 15 | 1:29:00 PM | 8.8 | 8.3 | 32.7 | 28.2 | 2.2 | 2.5 |
| WSR16 | 20230722 | Cloudy | Moderate | Mid-Ebb | Bottom | 15 | 1:29:00 PM | 8.7 | 8.3 | 32.6 | 28.2 | 2.3 | 2.5 |
| WSR33 | 20230722 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 2:22:00 PM | 8.3 | 8.3 | 32.9 | 27.7 | 2.1 | 2.5 |
| WSR33 | 20230722 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 2:22:00 PM | 8.4 | 8.3 | 32.8 | 27.7 | 2.2 | 2.5 |
| WSR33 | 20230722 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 2:21:00 PM | 8.3 | 8.3 | 33.0 | 27.8 | 2.0 | 2.5 |
| WSR33 | 20230722 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 2:21:00 PM | 8.4 | 8.4 | 32.8 | 27.8 | 2.4 | 2.5 |
| WSR33 | 20230722 | Cloudy | Moderate | Mid-Ebb | Bottom | 6 | 2:20:00 PM | 8.3 | 8.3 | 33.0 | 27.7 | 1.9 | 2.5 |
| WSR33 | 20230722 | Cloudy | Moderate | Mid-Ebb | Bottom | 6 | 2:20:00 PM | 8.3 | 8.3 | 33.0 | 27.7 | 1.9 | 3.0 |
| WSR36 | 20230722 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 2:07:00 PM | 8.6 | 8.4 | 32.7 | 28.4 | 2.1 | 2.5 |
| WSR36 | 20230722 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 2:07:00 PM | 8.8 | 8.4 | 32.8 | 28.4 | 2.3 | 2.5 |
| WSR36 | 20230722 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 2:07:00 PM | 8.7 | 8.4 | 33.0 | 28.4 | 2.3 | 2.5 |
| WSR36 | 20230722 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 2:07:00 PM | 8.9 | 8.4 | 32.9 | 28.4 | 2.2 | 2.5 |
| WSR36 | 20230722 | Cloudy | Moderate | Mid-Ebb | Bottom | 6 | 2:06:00 PM | 8.9 | 8.4 | 32.7 | 28.4 | 2.2 | 2.5 |
| WSR36 | 20230722 | Cloudy | Moderate | Mid-Ebb | Bottom | 6 | 2:06:00 PM | 8.9 | 8.4 | 32.9 | 28.4 | 2.4 | 2.5 |
| WSR37 | 20230722 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 1:53:00 PM | 8.5 | 8.2 | 32.8 | 28.5 | 2.2 | 2.5 |
| WSR37 | 20230722 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 1:53:00 PM | 8.4 | 8.2 | 32.8 | 28.4 | 2.2 | 2.5 |
| WSR37 | 20230722 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 1:52:00 PM | 8.3 | 8.2 | 33.0 | 28.4 | 2.0 | 2.5 |
| WSR37 | 20230722 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 1:52:00 PM | 8.6 | 8.2 | 32.8 | 28.4 | 2.2 | 2.5 |
| WSR37 | 20230722 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 1:51:00 PM | 8.4 | 8.2 | 33.1 | 28.4 | 1.9 | 2.5 |
| WSR37 | 20230722 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 1:51:00 PM | 8.4 | 8.3 | 33.1 | 28.5 | 2.2 | 2.5 |

| Location | Date | Weather | Sea Condition | Tidal | Water Level | Depth (m) | Time | DO (mg/L) | pH | Sal (ppt) | Temp (oC) | Turbidity (NTU) | Suspended Solids (mg/L) |
|----------|----------|---------|---------------|---------|-------------|-----------|------------|-----------|-----|-----------|-----------|-----------------|-------------------------|
| CE | 20230725 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 2:38:00 PM | 9.1 | 8.4 | 32.8 | 27.8 | 2.7 | 2.5 |
| CE | 20230725 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 2:38:00 PM | 8.9 | 8.3 | 32.7 | 27.9 | 2.8 | 2.5 |
| CE | 20230725 | Cloudy | Moderate | Mid-Ebb | Middle | 10 | 2:37:00 PM | 8.9 | 8.3 | 32.8 | 27.8 | 2.9 | 5.0 |
| CE | 20230725 | Cloudy | Moderate | Mid-Ebb | Middle | 10 | 2:37:00 PM | 9.0 | 8.3 | 32.7 | 27.8 | 2.9 | 5.0 |
| CE | 20230725 | Cloudy | Moderate | Mid-Ebb | Bottom | 19 | 2:36:00 PM | 9.1 | 8.4 | 32.8 | 27.9 | 3.0 | 4.0 |
| CE | 20230725 | Cloudy | Moderate | Mid-Ebb | Bottom | 19 | 2:36:00 PM | 9.0 | 8.4 | 32.8 | 27.8 | 2.8 | 5.0 |
| CF | 20230725 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 5:24:00 PM | 9.0 | 8.3 | 32.3 | 28.1 | 2.7 | 2.5 |
| CF | 20230725 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 5:24:00 PM | 8.8 | 8.3 | 32.0 | 28.0 | 2.4 | 2.5 |
| CF | 20230725 | Cloudy | Moderate | Mid-Ebb | Middle | 10 | 5:23:00 PM | 9.0 | 8.2 | 32.3 | 28.0 | 2.7 | 3.0 |
| CF | 20230725 | Cloudy | Moderate | Mid-Ebb | Middle | 10 | 5:23:00 PM | 8.9 | 8.2 | 32.1 | 28.1 | 2.6 | 6.0 |
| CF | 20230725 | Cloudy | Moderate | Mid-Ebb | Bottom | 19 | 5:22:00 PM | 9.0 | 8.3 | 32.1 | 28.2 | 2.7 | 4.0 |
| CF | 20230725 | Cloudy | Moderate | Mid-Ebb | Bottom | 19 | 5:22:00 PM | 8.9 | 8.2 | 32.1 | 28.1 | 2.7 | 2.5 |
| WSR01 | 20230725 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 5:00:00 PM | 9.2 | 8.3 | 32.1 | 28.0 | 2.3 | 6.0 |
| WSR01 | 20230725 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 5:00:00 PM | 9.1 | 8.3 | 32.1 | 28.0 | 2.4 | 5.0 |
| WSR01 | 20230725 | Cloudy | Moderate | Mid-Ebb | Middle | 5 | 4:59:00 PM | 9.3 | 8.3 | 32.1 | 27.9 | 1.9 | 2.5 |
| WSR01 | 20230725 | Cloudy | Moderate | Mid-Ebb | Middle | 5 | 4:59:00 PM | 9.2 | 8.4 | 32.3 | 28.0 | 2.1 | 3.0 |
| WSR01 | 20230725 | Cloudy | Moderate | Mid-Ebb | Bottom | 8 | 4:58:00 PM | 9.1 | 8.3 | 32.3 | 28.0 | 1.7 | 3.0 |
| WSR01 | 20230725 | Cloudy | Moderate | Mid-Ebb | Bottom | 8 | 4:58:00 PM | 9.3 | 8.3 | 32.1 | 28.0 | 1.8 | 4.0 |
| WSR02 | 20230725 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 4:40:00 PM | 8.7 | 8.2 | 33.0 | 28.0 | 2.0 | 3.0 |
| WSR02 | 20230725 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 4:40:00 PM | 8.7 | 8.2 | 32.9 | 27.9 | 2.1 | 3.0 |
| WSR02 | 20230725 | Cloudy | Moderate | Mid-Ebb | Middle | 5 | 4:39:00 PM | 8.7 | 8.2 | 32.9 | 28.0 | 1.9 | 4.0 |
| WSR02 | 20230725 | Cloudy | Moderate | Mid-Ebb | Middle | 5 | 4:39:00 PM | 8.6 | 8.2 | 33.1 | 28.0 | 2.2 | 5.0 |
| WSR02 | 20230725 | Cloudy | Moderate | Mid-Ebb | Bottom | 8 | 4:38:00 PM | 8.7 | 8.2 | 32.8 | 28.0 | 1.6 | 4.0 |
| WSR02 | 20230725 | Cloudy | Moderate | Mid-Ebb | Bottom | 8 | 4:38:00 PM | 8.6 | 8.3 | 33.0 | 28.0 | 1.7 | 4.0 |
| WSR03 | 20230725 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 4:22:00 PM | 9.1 | 8.2 | 32.9 | 28.5 | 1.9 | 3.0 |
| WSR03 | 20230725 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 4:22:00 PM | 9.0 | 8.2 | 32.8 | 28.6 | 2.1 | 5.0 |
| WSR03 | 20230725 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 4:21:00 PM | 9.1 | 8.2 | 32.9 | 28.6 | 1.9 | 4.0 |
| WSR03 | 20230725 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 4:21:00 PM | 9.2 | 8.2 | 33.0 | 28.6 | 2.0 | 5.0 |
| WSR03 | 20230725 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 4:20:00 PM | 9.3 | 8.2 | 32.8 | 28.5 | 2.0 | 4.0 |
| WSR03 | 20230725 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 4:20:00 PM | 9.1 | 8.2 | 32.9 | 28.5 | 1.9 | 5.0 |

| Location | Date | Weather | Sea Condition | Tidal | Water Level | Depth (m) | Time | DO (mg/L) | pH | Sal (ppt) | Temp (oC) | Turbidity (NTU) | Suspended Solids (mg/L) |
|----------|----------|---------|---------------|---------|-------------|-----------|------------|-----------|-----|-----------|-----------|-----------------|-------------------------|
| WSR04 | 20230725 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 4:09:00 PM | 9.2 | 8.3 | 32.6 | 27.9 | 2.0 | 3.0 |
| WSR04 | 20230725 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 4:09:00 PM | 9.2 | 8.2 | 32.8 | 27.9 | 2.3 | 6.0 |
| WSR04 | 20230725 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 4:08:00 PM | 9.4 | 8.2 | 32.6 | 28.0 | 2.3 | 5.0 |
| WSR04 | 20230725 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 4:08:00 PM | 9.2 | 8.2 | 32.6 | 28.0 | 2.1 | 3.0 |
| WSR04 | 20230725 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 4:07:00 PM | 9.4 | 8.3 | 32.6 | 27.9 | 1.6 | 5.0 |
| WSR04 | 20230725 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 4:07:00 PM | 9.4 | 8.2 | 32.7 | 27.9 | 1.8 | 5.0 |
| WSR16 | 20230725 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 3:02:00 PM | 9.1 | 8.2 | 32.5 | 28.5 | 2.3 | 3.0 |
| WSR16 | 20230725 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 3:02:00 PM | 9.3 | 8.2 | 32.4 | 28.4 | 2.3 | 3.0 |
| WSR16 | 20230725 | Cloudy | Moderate | Mid-Ebb | Middle | 8 | 3:01:00 PM | 9.2 | 8.3 | 32.5 | 28.5 | 2.3 | 5.0 |
| WSR16 | 20230725 | Cloudy | Moderate | Mid-Ebb | Middle | 8 | 3:01:00 PM | 9.3 | 8.3 | 32.2 | 28.5 | 2.5 | 3.0 |
| WSR16 | 20230725 | Cloudy | Moderate | Mid-Ebb | Bottom | 14 | 3:00:00 PM | 9.2 | 8.3 | 32.4 | 28.4 | 1.9 | 3.0 |
| WSR16 | 20230725 | Cloudy | Moderate | Mid-Ebb | Bottom | 14 | 3:00:00 PM | 9.1 | 8.3 | 32.4 | 28.5 | 2.0 | 3.0 |
| WSR33 | 20230725 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 3:54:00 PM | 9.5 | 8.3 | 32.8 | 28.4 | 2.3 | 3.0 |
| WSR33 | 20230725 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 3:54:00 PM | 9.5 | 8.3 | 32.8 | 28.4 | 2.4 | 4.0 |
| WSR33 | 20230725 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 3:53:00 PM | 9.5 | 8.3 | 32.6 | 28.4 | 2.1 | 2.5 |
| WSR33 | 20230725 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 3:53:00 PM | 9.6 | 8.3 | 32.6 | 28.4 | 2.2 | 2.5 |
| WSR33 | 20230725 | Cloudy | Moderate | Mid-Ebb | Bottom | 6 | 3:52:00 PM | 9.6 | 8.3 | 32.7 | 28.3 | 1.8 | 3.0 |
| WSR33 | 20230725 | Cloudy | Moderate | Mid-Ebb | Bottom | 6 | 3:52:00 PM | 9.4 | 8.2 | 32.8 | 28.3 | 1.8 | 3.0 |
| WSR36 | 20230725 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 3:39:00 PM | 9.1 | 8.2 | 33.1 | 28.0 | 2.2 | 3.0 |
| WSR36 | 20230725 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 3:39:00 PM | 9.3 | 8.2 | 33.1 | 28.0 | 2.4 | 3.0 |
| WSR36 | 20230725 | Cloudy | Moderate | Mid-Ebb | Middle | 3 | 3:39:00 PM | 9.2 | 8.2 | 33.1 | 28.0 | 2.0 | 3.0 |
| WSR36 | 20230725 | Cloudy | Moderate | Mid-Ebb | Middle | 3 | 3:39:00 PM | 9.3 | 8.2 | 33.1 | 28.1 | 2.2 | 3.0 |
| WSR36 | 20230725 | Cloudy | Moderate | Mid-Ebb | Bottom | 6 | 3:38:00 PM | 9.1 | 8.2 | 32.9 | 28.0 | 1.7 | 4.0 |
| WSR36 | 20230725 | Cloudy | Moderate | Mid-Ebb | Bottom | 6 | 3:38:00 PM | 9.3 | 8.2 | 33.0 | 28.1 | 2.0 | 4.0 |
| WSR37 | 20230725 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 3:24:00 PM | 8.7 | 8.2 | 32.3 | 27.8 | 2.3 | 4.0 |
| WSR37 | 20230725 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 3:24:00 PM | 8.7 | 8.2 | 32.0 | 27.8 | 2.5 | 3.0 |
| WSR37 | 20230725 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 3:23:00 PM | 8.8 | 8.2 | 32.2 | 27.9 | 2.1 | 3.0 |
| WSR37 | 20230725 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 3:23:00 PM | 8.9 | 8.2 | 32.3 | 27.8 | 2.1 | 6.0 |
| WSR37 | 20230725 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 3:22:00 PM | 8.7 | 8.2 | 32.2 | 27.9 | 2.1 | 4.0 |
| WSR37 | 20230725 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 3:22:00 PM | 8.9 | 8.2 | 32.1 | 27.8 | 2.5 | 3.0 |

| Location | Date | Weather | Sea Condition | Tidal | Water Level | Depth (m) | Time | DO (mg/L) | pH | Sal (ppt) | Temp (oC) | Turbidity (NTU) | Suspended Solids (mg/L) |
|----------|----------|---------|---------------|---------|-------------|-----------|-------------|-----------|-----|-----------|-----------|-----------------|-------------------------|
| CE | 20230727 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 8:02:00 AM | 9.7 | 8.2 | 33.1 | 27.4 | 2.9 | 9.0 |
| CE | 20230727 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 8:02:00 AM | 9.8 | 8.2 | 33.2 | 27.3 | 3.3 | 7.0 |
| CE | 20230727 | Cloudy | Moderate | Mid-Ebb | Middle | 11 | 8:01:00 AM | 9.8 | 8.2 | 33.2 | 27.4 | 3.0 | 2.5 |
| CE | 20230727 | Cloudy | Moderate | Mid-Ebb | Middle | 11 | 8:01:00 AM | 9.8 | 8.3 | 33.2 | 27.4 | 3.2 | 2.5 |
| CE | 20230727 | Cloudy | Moderate | Mid-Ebb | Bottom | 21 | 8:00:00 AM | 9.8 | 8.2 | 33.2 | 27.3 | 3.1 | 2.5 |
| CE | 20230727 | Cloudy | Moderate | Mid-Ebb | Bottom | 21 | 8:00:00 AM | 9.8 | 8.2 | 33.1 | 27.4 | 2.9 | 2.5 |
| CF | 20230727 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 10:48:00 AM | 9.0 | 8.3 | 33.9 | 27.4 | 2.5 | 2.5 |
| CF | 20230727 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 10:48:00 AM | 9.1 | 8.3 | 34.1 | 27.4 | 2.7 | 2.5 |
| CF | 20230727 | Cloudy | Moderate | Mid-Ebb | Middle | 11 | 10:47:00 AM | 9.1 | 8.3 | 34.0 | 27.5 | 2.6 | 2.5 |
| CF | 20230727 | Cloudy | Moderate | Mid-Ebb | Middle | 11 | 10:47:00 AM | 9.1 | 8.2 | 33.9 | 27.4 | 2.7 | 2.5 |
| CF | 20230727 | Cloudy | Moderate | Mid-Ebb | Bottom | 20 | 10:46:00 AM | 9.0 | 8.3 | 34.0 | 27.5 | 2.7 | 2.5 |
| CF | 20230727 | Cloudy | Moderate | Mid-Ebb | Bottom | 20 | 10:46:00 AM | 9.2 | 8.2 | 34.1 | 27.5 | 2.8 | 2.5 |
| WSR01 | 20230727 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 10:24:00 AM | 9.6 | 8.3 | 33.4 | 27.3 | 2.1 | 3.0 |
| WSR01 | 20230727 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 10:24:00 AM | 9.7 | 8.3 | 33.5 | 27.3 | 2.2 | 2.5 |
| WSR01 | 20230727 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 10:23:00 AM | 9.7 | 8.3 | 33.4 | 27.3 | 1.9 | 4.0 |
| WSR01 | 20230727 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 10:23:00 AM | 9.6 | 8.3 | 33.3 | 27.4 | 1.9 | 2.5 |
| WSR01 | 20230727 | Cloudy | Moderate | Mid-Ebb | Bottom | 8 | 10:22:00 AM | 9.7 | 8.3 | 33.3 | 27.4 | 1.9 | 3.0 |
| WSR01 | 20230727 | Cloudy | Moderate | Mid-Ebb | Bottom | 8 | 10:22:00 AM | 9.5 | 8.3 | 33.4 | 27.4 | 2.0 | 2.5 |
| WSR02 | 20230727 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 10:03:00 AM | 9.4 | 8.4 | 34.0 | 27.2 | 2.0 | 2.5 |
| WSR02 | 20230727 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 10:03:00 AM | 9.5 | 8.3 | 34.1 | 27.2 | 2.4 | 3.0 |
| WSR02 | 20230727 | Cloudy | Moderate | Mid-Ebb | Middle | 5 | 10:02:00 AM | 9.4 | 8.3 | 34.1 | 27.2 | 1.8 | 3.0 |
| WSR02 | 20230727 | Cloudy | Moderate | Mid-Ebb | Middle | 5 | 10:02:00 AM | 9.4 | 8.4 | 34.2 | 27.2 | 2.0 | 2.5 |
| WSR02 | 20230727 | Cloudy | Moderate | Mid-Ebb | Bottom | 9 | 10:01:00 AM | 9.6 | 8.4 | 34.1 | 27.2 | 1.8 | 2.5 |
| WSR02 | 20230727 | Cloudy | Moderate | Mid-Ebb | Bottom | 9 | 10:01:00 AM | 9.4 | 8.3 | 34.1 | 27.2 | 1.9 | 2.5 |
| WSR03 | 20230727 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 9:46:00 AM | 9.7 | 8.3 | 33.5 | 27.0 | 2.4 | 2.5 |
| WSR03 | 20230727 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 9:46:00 AM | 9.6 | 8.3 | 33.6 | 27.0 | 2.1 | 2.5 |
| WSR03 | 20230727 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 9:45:00 AM | 9.7 | 8.3 | 33.6 | 27.0 | 2.4 | 2.5 |
| WSR03 | 20230727 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 9:45:00 AM | 9.7 | 8.3 | 33.7 | 27.0 | 2.3 | 3.0 |
| WSR03 | 20230727 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 9:44:00 AM | 9.8 | 8.3 | 33.7 | 27.0 | 2.0 | 2.5 |
| WSR03 | 20230727 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 9:44:00 AM | 9.7 | 8.3 | 33.5 | 27.1 | 2.1 | 4.0 |

| Location | Date | Weather | Sea Condition | Tidal | Water Level | Depth (m) | Time | DO (mg/L) | pH | Sal (ppt) | Temp (oC) | Turbidity (NTU) | Suspended Solids (mg/L) |
|----------|----------|---------|---------------|---------|-------------|-----------|------------|-----------|-----|-----------|-----------|-----------------|-------------------------|
| WSR04 | 20230727 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 9:32:00 AM | 9.5 | 8.2 | 34.1 | 27.2 | 2.3 | 3.0 |
| WSR04 | 20230727 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 9:32:00 AM | 9.6 | 8.3 | 34.0 | 27.2 | 2.3 | 2.5 |
| WSR04 | 20230727 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 9:31:00 AM | 9.5 | 8.2 | 34.1 | 27.2 | 2.0 | 5.0 |
| WSR04 | 20230727 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 9:31:00 AM | 9.6 | 8.2 | 33.9 | 27.2 | 2.1 | 7.0 |
| WSR04 | 20230727 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 9:30:00 AM | 9.6 | 8.3 | 34.1 | 27.2 | 1.8 | 3.0 |
| WSR04 | 20230727 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 9:30:00 AM | 9.6 | 8.3 | 34.0 | 27.2 | 1.8 | 2.5 |
| WSR16 | 20230727 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 8:24:00 AM | 9.0 | 8.3 | 34.1 | 27.2 | 2.0 | 4.0 |
| WSR16 | 20230727 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 8:24:00 AM | 9.0 | 8.3 | 33.9 | 27.2 | 2.1 | 2.5 |
| WSR16 | 20230727 | Cloudy | Moderate | Mid-Ebb | Middle | 8 | 8:23:00 AM | 9.1 | 8.3 | 34.1 | 27.3 | 2.2 | 3.0 |
| WSR16 | 20230727 | Cloudy | Moderate | Mid-Ebb | Middle | 8 | 8:23:00 AM | 9.1 | 8.3 | 33.9 | 27.2 | 2.4 | 2.5 |
| WSR16 | 20230727 | Cloudy | Moderate | Mid-Ebb | Bottom | 16 | 8:22:00 AM | 9.0 | 8.3 | 34.0 | 27.2 | 1.8 | 7.0 |
| WSR16 | 20230727 | Cloudy | Moderate | Mid-Ebb | Bottom | 16 | 8:22:00 AM | 9.1 | 8.3 | 34.1 | 27.3 | 1.9 | 7.0 |
| WSR33 | 20230727 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 9:16:00 AM | 9.0 | 8.2 | 33.8 | 27.2 | 2.2 | 2.5 |
| WSR33 | 20230727 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 9:16:00 AM | 9.0 | 8.2 | 33.7 | 27.3 | 2.2 | 2.5 |
| WSR33 | 20230727 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 9:15:00 AM | 9.0 | 8.3 | 33.7 | 27.3 | 1.9 | 5.0 |
| WSR33 | 20230727 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 9:15:00 AM | 9.1 | 8.3 | 33.7 | 27.3 | 2.0 | 4.0 |
| WSR33 | 20230727 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 9:14:00 AM | 9.1 | 8.2 | 33.7 | 27.3 | 1.6 | 2.5 |
| WSR33 | 20230727 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 9:14:00 AM | 9.1 | 8.2 | 33.7 | 27.3 | 1.9 | 2.5 |
| WSR36 | 20230727 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 9:01:00 AM | 9.1 | 8.4 | 34.1 | 27.4 | 2.1 | 2.5 |
| WSR36 | 20230727 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 9:01:00 AM | 9.0 | 8.4 | 34.0 | 27.4 | 2.3 | 3.0 |
| WSR36 | 20230727 | Cloudy | Moderate | Mid-Ebb | Middle | 3 | 9:01:00 AM | 9.0 | 8.4 | 34.1 | 27.4 | 2.0 | 4.0 |
| WSR36 | 20230727 | Cloudy | Moderate | Mid-Ebb | Middle | 3 | 9:01:00 AM | 9.1 | 8.4 | 34.0 | 27.4 | 2.4 | 2.5 |
| WSR36 | 20230727 | Cloudy | Moderate | Mid-Ebb | Bottom | 6 | 9:00:00 AM | 8.9 | 8.4 | 34.1 | 27.4 | 2.0 | 2.5 |
| WSR36 | 20230727 | Cloudy | Moderate | Mid-Ebb | Bottom | 6 | 9:00:00 AM | 9.0 | 8.4 | 34.2 | 27.5 | 2.2 | 2.5 |
| WSR37 | 20230727 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 8:46:00 AM | 8.9 | 8.3 | 33.4 | 26.9 | 2.2 | 2.5 |
| WSR37 | 20230727 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 8:46:00 AM | 8.9 | 8.3 | 33.3 | 26.9 | 2.5 | 3.0 |
| WSR37 | 20230727 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 8:45:00 AM | 8.9 | 8.3 | 33.5 | 26.9 | 2.2 | 2.5 |
| WSR37 | 20230727 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 8:45:00 AM | 8.8 | 8.3 | 33.4 | 27.0 | 2.2 | 2.5 |
| WSR37 | 20230727 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 8:44:00 AM | 9.0 | 8.3 | 33.4 | 27.0 | 2.1 | 2.5 |
| WSR37 | 20230727 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 8:44:00 AM | 9.0 | 8.3 | 33.4 | 26.9 | 2.4 | 3.0 |

| Location | Date | Weather | Sea Condition | Tidal | Water Level | Depth (m) | Time | DO (mg/L) | pH | Sal (ppt) | Temp (oC) | Turbidity (NTU) | Suspended Solids (mg/L) |
|----------|----------|---------|---------------|---------|-------------|-----------|-------------|-----------|-----|-----------|-----------|-----------------|-------------------------|
| CE | 20230729 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 8:02:00 AM | 9.1 | 8.3 | 33.3 | 27.2 | 3.4 | 5.0 |
| CE | 20230729 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 8:02:00 AM | 9.1 | 8.3 | 33.2 | 27.2 | 3.1 | 3.0 |
| CE | 20230729 | Cloudy | Moderate | Mid-Ebb | Middle | 11 | 8:01:00 AM | 9.0 | 8.3 | 33.2 | 27.2 | 2.9 | 2.5 |
| CE | 20230729 | Cloudy | Moderate | Mid-Ebb | Middle | 11 | 8:01:00 AM | 9.2 | 8.3 | 33.1 | 27.2 | 3.1 | 2.5 |
| CE | 20230729 | Cloudy | Moderate | Mid-Ebb | Bottom | 21 | 8:00:00 AM | 9.1 | 8.3 | 33.2 | 27.2 | 3.3 | 2.5 |
| CE | 20230729 | Cloudy | Moderate | Mid-Ebb | Bottom | 21 | 8:00:00 AM | 9.1 | 8.3 | 33.3 | 27.3 | 3.0 | 3.0 |
| CF | 20230729 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 10:49:00 AM | 9.1 | 8.4 | 33.0 | 27.1 | 2.8 | 2.5 |
| CF | 20230729 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 10:49:00 AM | 9.1 | 8.4 | 33.0 | 27.1 | 2.7 | 3.0 |
| CF | 20230729 | Cloudy | Moderate | Mid-Ebb | Middle | 10 | 10:48:00 AM | 9.2 | 8.4 | 33.0 | 27.1 | 2.8 | 2.5 |
| CF | 20230729 | Cloudy | Moderate | Mid-Ebb | Middle | 10 | 10:48:00 AM | 9.1 | 8.4 | 32.8 | 27.1 | 2.7 | 2.5 |
| CF | 20230729 | Cloudy | Moderate | Mid-Ebb | Bottom | 20 | 10:47:00 AM | 9.1 | 8.4 | 32.9 | 27.1 | 2.7 | 2.5 |
| CF | 20230729 | Cloudy | Moderate | Mid-Ebb | Bottom | 20 | 10:47:00 AM | 9.1 | 8.4 | 33.0 | 27.0 | 2.8 | 2.5 |
| WSR01 | 20230729 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 10:23:00 AM | 9.4 | 8.4 | 32.6 | 27.3 | 2.5 | 2.5 |
| WSR01 | 20230729 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 10:23:00 AM | 9.4 | 8.4 | 32.6 | 27.4 | 2.2 | 2.5 |
| WSR01 | 20230729 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 10:22:00 AM | 9.4 | 8.4 | 32.6 | 27.4 | 2.4 | 3.0 |
| WSR01 | 20230729 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 10:22:00 AM | 9.4 | 8.4 | 32.5 | 27.3 | 2.2 | 2.5 |
| WSR01 | 20230729 | Cloudy | Moderate | Mid-Ebb | Bottom | 8 | 10:21:00 AM | 9.3 | 8.4 | 32.5 | 27.4 | 2.3 | 2.5 |
| WSR01 | 20230729 | Cloudy | Moderate | Mid-Ebb | Bottom | 8 | 10:21:00 AM | 9.5 | 8.4 | 32.6 | 27.4 | 2.2 | 2.5 |
| WSR02 | 20230729 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 10:04:00 AM | 9.2 | 8.4 | 32.8 | 27.2 | 2.4 | 2.5 |
| WSR02 | 20230729 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 10:04:00 AM | 9.3 | 8.4 | 32.8 | 27.3 | 2.5 | 2.5 |
| WSR02 | 20230729 | Cloudy | Moderate | Mid-Ebb | Middle | 5 | 10:03:00 AM | 9.4 | 8.4 | 32.8 | 27.3 | 2.5 | 2.5 |
| WSR02 | 20230729 | Cloudy | Moderate | Mid-Ebb | Middle | 5 | 10:03:00 AM | 9.3 | 8.4 | 32.9 | 27.2 | 2.3 | 2.5 |
| WSR02 | 20230729 | Cloudy | Moderate | Mid-Ebb | Bottom | 9 | 10:02:00 AM | 9.3 | 8.4 | 32.8 | 27.2 | 2.0 | 3.0 |
| WSR02 | 20230729 | Cloudy | Moderate | Mid-Ebb | Bottom | 9 | 10:02:00 AM | 9.2 | 8.4 | 32.8 | 27.3 | 2.1 | 4.0 |
| WSR03 | 20230729 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 9:46:00 AM | 9.3 | 8.3 | 33.4 | 27.3 | 2.1 | 2.5 |
| WSR03 | 20230729 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 9:46:00 AM | 9.5 | 8.3 | 33.4 | 27.3 | 2.1 | 2.5 |
| WSR03 | 20230729 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 9:45:00 AM | 9.5 | 8.3 | 33.3 | 27.2 | 2.3 | 2.5 |
| WSR03 | 20230729 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 9:45:00 AM | 9.4 | 8.3 | 33.2 | 27.3 | 2.3 | 5.0 |
| WSR03 | 20230729 | Cloudy | Moderate | Mid-Ebb | Bottom | 8 | 9:44:00 AM | 9.4 | 8.3 | 33.3 | 27.4 | 2.0 | 2.5 |
| WSR03 | 20230729 | Cloudy | Moderate | Mid-Ebb | Bottom | 8 | 9:44:00 AM | 9.3 | 8.3 | 33.4 | 27.3 | 2.4 | 2.5 |









| Location | Date | Weather | Sea Condition | Tidal | Water Level | Depth (m) | Time | DO (mg/L) | pH | Sal (ppt) | Temp (oC) | Turbidity (NTU) | Suspended Solids (mg/L) |
|----------|----------|---------|---------------|---------|-------------|-----------|------------|-----------|-----|-----------|-----------|-----------------|-------------------------|
| WSR04 | 20230729 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 9:34:00 AM | 8.5 | 8.3 | 32.8 | 26.7 | 2.2 | 2.5 |
| WSR04 | 20230729 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 9:34:00 AM | 8.4 | 8.3 | 32.7 | 26.7 | 2.4 | 2.5 |
| WSR04 | 20230729 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 9:33:00 AM | 8.3 | 8.3 | 32.7 | 26.6 | 2.5 | 2.5 |
| WSR04 | 20230729 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 9:33:00 AM | 8.4 | 8.3 | 32.8 | 26.7 | 2.1 | 2.5 |
| WSR04 | 20230729 | Cloudy | Moderate | Mid-Ebb | Bottom | 6 | 9:32:00 AM | 8.4 | 8.2 | 32.7 | 26.7 | 2.3 | 2.5 |
| WSR04 | 20230729 | Cloudy | Moderate | Mid-Ebb | Bottom | 6 | 9:32:00 AM | 8.4 | 8.2 | 32.8 | 26.7 | 2.1 | 2.5 |
| WSR16 | 20230729 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 8:25:00 AM | 8.8 | 8.1 | 32.8 | 27.3 | 2.2 | 2.5 |
| WSR16 | 20230729 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 8:25:00 AM | 8.9 | 8.2 | 32.8 | 27.3 | 2.2 | 2.5 |
| WSR16 | 20230729 | Cloudy | Moderate | Mid-Ebb | Middle | 8 | 8:24:00 AM | 8.9 | 8.1 | 32.9 | 27.3 | 2.5 | 4.0 |
| WSR16 | 20230729 | Cloudy | Moderate | Mid-Ebb | Middle | 8 | 8:24:00 AM | 8.9 | 8.2 | 32.8 | 27.4 | 2.2 | 2.5 |
| WSR16 | 20230729 | Cloudy | Moderate | Mid-Ebb | Bottom | 14 | 8:23:00 AM | 8.8 | 8.2 | 32.9 | 27.3 | 2.2 | 2.5 |
| WSR16 | 20230729 | Cloudy | Moderate | Mid-Ebb | Bottom | 14 | 8:23:00 AM | 8.8 | 8.2 | 32.9 | 27.3 | 2.4 | 2.5 |
| WSR33 | 20230729 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 9:17:00 AM | 8.7 | 8.3 | 32.8 | 27.0 | 2.2 | 3.0 |
| WSR33 | 20230729 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 9:17:00 AM | 8.7 | 8.2 | 32.8 | 27.0 | 2.2 | 3.0 |
| WSR33 | 20230729 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 9:16:00 AM | 8.6 | 8.3 | 32.9 | 27.0 | 2.3 | 2.5 |
| WSR33 | 20230729 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 9:16:00 AM | 8.6 | 8.3 | 32.8 | 27.0 | 2.2 | 2.5 |
| WSR33 | 20230729 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 9:15:00 AM | 8.7 | 8.3 | 32.8 | 26.9 | 2.5 | 2.5 |
| WSR33 | 20230729 | Cloudy | Moderate | Mid-Ebb | Bottom | 7 | 9:15:00 AM | 8.6 | 8.3 | 32.9 | 27.0 | 2.2 | 2.5 |
| WSR36 | 20230729 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 9:03:00 AM | 8.7 | 8.3 | 32.8 | 27.3 | 2.5 | 2.5 |
| WSR36 | 20230729 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 9:03:00 AM | 8.8 | 8.3 | 32.9 | 27.3 | 2.1 | 2.5 |
| WSR36 | 20230729 | Cloudy | Moderate | Mid-Ebb | Middle | 3 | 9:03:00 AM | 8.8 | 8.3 | 32.8 | 27.3 | 1.7 | 2.5 |
| WSR36 | 20230729 | Cloudy | Moderate | Mid-Ebb | Middle | 3 | 9:03:00 AM | 8.8 | 8.3 | 32.8 | 27.4 | 1.9 | 2.5 |
| WSR36 | 20230729 | Cloudy | Moderate | Mid-Ebb | Bottom | 6 | 9:02:00 AM | 8.7 | 8.4 | 32.9 | 27.3 | 2.0 | 2.5 |
| WSR36 | 20230729 | Cloudy | Moderate | Mid-Ebb | Bottom | 6 | 9:02:00 AM | 8.7 | 8.4 | 32.9 | 27.4 | 2.0 | 2.5 |
| WSR37 | 20230729 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 8:47:00 AM | 8.4 | 8.3 | 33.0 | 26.9 | 2.4 | 4.0 |
| WSR37 | 20230729 | Cloudy | Moderate | Mid-Ebb | Surface | 1 | 8:47:00 AM | 8.3 | 8.2 | 33.1 | 26.9 | 2.4 | 4.0 |
| WSR37 | 20230729 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 8:46:00 AM | 8.4 | 8.2 | 33.2 | 26.9 | 2.0 | 3.0 |
| WSR37 | 20230729 | Cloudy | Moderate | Mid-Ebb | Middle | 4 | 8:46:00 AM | 8.4 | 8.2 | 33.1 | 26.9 | 2.1 | 3.0 |
| WSR37 | 20230729 | Cloudy | Moderate | Mid-Ebb | Bottom | 8 | 8:45:00 AM | 8.4 | 8.2 | 33.1 | 26.9 | 1.8 | 4.0 |
| WSR37 | 20230729 | Cloudy | Moderate | Mid-Ebb | Bottom | 8 | 8:45:00 AM | 8.3 | 8.3 | 33.0 | 26.9 | 2.1 | 4.0 |

Landfill Gas Monitoring - Field Measurement Recording Sheet

Contract Title Design, Build and Operate First Stage of Tseung Kwan O Desalination Plant

Contract No. : 13/WSD/17

| Serial No. | Monitoring Equipment | Last Calibration |
|------------|----------------------|------------------|
| 254938 | GMI-PS500 | 2/9/2022 |

| Monitoring Location | Date (dd/mm/yyyy) | Time (hh:mm) | Weather Condition | Landfill Gas Parameters | | | | Physical Parameters | Trench Depth (m) | Measured by | |
|---------------------|-------------------|-----------------------|---|-------------------------|------------|--------------------|----------------------------|---------------------------|------------------|-------------|---|
| | | | Sunny/ Fine/ Overcast/ Drizzle/ Rain/ Storm/ Hazy | Methane (%LEL) | Oxygen (%) | Carbon Dioxide (%) | Balance Gas (%) (e.g. H2S) | Temp (°C) / Pressure mBar | | Name | Signature |
| Ch1+340 - Ch1+600 | 3 /7/2023 | 08:30 & before excav. | Sunny | 0 | 20.9 | 0.03 | 0 | 27.9 / 1008.8 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 3 /7/2023 | 13:30 | Sunny | 0 | 20.9 | 0.03 | 0 | 30.8 / 1008.8 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 3 /7/2023 | 15:30 | Sunny | 0 | 20.9 | 0.03 | 0 | 30.3 / 1008.8 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 4 /7/2023 | 08:30 & before excav. | Fine | 0 | 20.9 | 0.03 | 0 | 28.7 / 1008.7 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 4 /7/2023 | 13:30 | Rain | 0 | 20.9 | 0.03 | 0 | 30.2 / 1008.7 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 4 /7/2023 | 15:30 | Sunny | 0 | 20.9 | 0.03 | 0 | 28.7 / 1008.7 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 5 /7/2023 | 08:30 & before excav. | Sunny | 0 | 20.9 | 0.03 | 0 | 28.9 / 1008.4 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 5 /7/2023 | 13:30 | Sunny | 0 | 20.9 | 0.03 | 0 | 32.3 / 1008.4 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 5 /7/2023 | 15:30 | Sunny | 0 | 20.9 | 0.03 | 0 | 30.2 / 1008.4 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 6 /7/2023 | 08:30 & before excav. | Sunny | 0 | 20.9 | 0.03 | 0 | 28.4 / 1008.9 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 6 /7/2023 | 13:30 | Sunny | 0 | 20.9 | 0.03 | 0 | 32.8 / 1008.9 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 6 /7/2023 | 15:30 | Sunny | 0 | 20.9 | 0.03 | 0 | 30.4 / 1008.9 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 7 /7/2023 | 08:30 & before excav. | Sunny | 0 | 20.9 | 0.03 | 0 | 29.4 / 1009.7 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 7 /7/2023 | 13:30 | Sunny | 0 | 20.9 | 0.03 | 0 | 32.3 / 1009.7 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 7 /7/2023 | 15:30 | Sunny | 0 | 20.9 | 0.03 | 0 | 31.4 / 1009.7 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | /7/2023 | | | | | | | | | Peter Au | |












Checked by :  M.F. Ym ALW-7
 Date 7/7/2023

Landfill Gas Monitoring - Field Measurement Recording Sheet

Contract Title Design, Build and Operate First Stage of Tseung Kwan O Desalination Plant

Contract No. : 13/WSD/17

| Serial No. | Monitoring Equipment | Last Calibration |
|------------|----------------------|------------------|
| 254938 | GMI-PS500 | 2/9/2022 |

| Monitoring Location | Date (dd/mm/yyyy) | Time (hh:mm) | Weather Condition | Landfill Gas Parameters | | | | Physical Parameters | Trench Depth (m) | Measured by | |
|---------------------|-------------------|-----------------------|---|-------------------------|------------|--------------------|----------------------------|---------------------------|------------------|-------------|---|
| | | | Sunny/ Fine/ Overcast/ Drizzle/ Rain/ Storm/ Hazy | Methane (%LEL) | Oxygen (%) | Carbon Dioxide (%) | Balance Gas (%) (e.g. H2S) | Temp (°C) / Pressure mBar | | Name | Signature |
| Ch1+340 - Ch1+600 | 8 /7/2023 | 08:30 & before excav. | Sunny | 0 | 20.9 | 0.03 | 0 | 29.8 / 1010.4 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 8 /7/2023 | 13:30 | Sunny | 0 | 20.9 | 0.03 | 0 | 33.2 / 1010.4 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 8 /7/2023 | 15:30 | Sunny | 0 | 20.9 | 0.03 | 0 | 30.4 / 1010.4 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 10 /7/2023 | 08:30 & before excav. | Sunny | 0 | 20.9 | 0.03 | 0 | 30.7 / 1010.4 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 10 /7/2023 | 13:30 | Sunny | 0 | 20.9 | 0.03 | 0 | 33.7 / 1009.8 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 10 /7/2023 | 15:30 | Sunny | 0 | 20.9 | 0.03 | 0 | 28.9 / 1009.8 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 11 /7/2023 | 08:30 & before excav. | Sunny | 0 | 20.9 | 0.03 | 0 | 30.7 / 1008.4 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 11 /7/2023 | 13:30 | Sunny | 0 | 20.9 | 0.03 | 0 | 34.5 / 1008.4 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 11 /7/2023 | 15:30 | Sunny | 0 | 20.9 | 0.03 | 0 | 28.9 / 1008.4 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 12 /7/2023 | 08:30 & before excav. | Sunny | 0 | 20.9 | 0.03 | 0 | 30.7 / 1008.2 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 12 /7/2023 | 13:30 | Sunny | 0 | 20.9 | 0.03 | 0 | 33.5 / 1008.2 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 12 /7/2023 | 15:30 | Sunny | 0 | 20.9 | 0.03 | 0 | 29.8 / 1008.2 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 13 /7/2023 | 08:30 & before excav. | Sunny | 0 | 20.9 | 0.03 | 0 | 30.9 / 1006.8 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 13 /7/2023 | 13:30 | Sunny | 0 | 20.9 | 0.03 | 0 | 33.9 / 1006.8 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 13 /7/2023 | 15:30 | Sunny | 0 | 20.9 | 0.03 | 0 | 32.8 / 1006.8 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | /7/2023 | | | | | | | | | Peter Au | |











Checked by : Yan Hin Fung A10w-7
 Date 13/7/2023


Landfill Gas Monitoring - Field Measurement Recording Sheet

Contract Title Design, Build and Operate First Stage of Tseung Kwan O Desalination Plant

Contract No. : 13/WSD/17

| Serial No. | Monitoring Equipment | Last Calibration |
|------------|----------------------|------------------|
| 254938 | GMI-PS500 | 2/9/2022 |

| Monitoring Location | Date (dd/mm/yyyy) | Time (hh:mm) | Weather Condition | Landfill Gas Parameters | | | | Physical Parameters | Trench Depth (m) | Measured by | |
|---------------------|-------------------|-----------------------|---|-------------------------|------------|--------------------|----------------------------|---------------------------|------------------|-------------|---|
| | | | Sunny/ Fine/ Overcast/ Drizzle/ Rain/ Storm/ Hazy | Methane (%LEL) | Oxygen (%) | Carbon Dioxide (%) | Balance Gas (%) (e.g. H2S) | Temp (°C) / Pressure mBar | | Name | Signature |
| Ch1+340 - Ch1+600 | 14/7/2023 | 08:30 & before excav. | Sunny | 0 | 20.9 | 0.03 | 0 | 28.5 / 1004.4 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 14/7/2023 | 13:30 | Sunny | 0 | 20.9 | 0.03 | 0 | 33.3 / 1004.4 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 14/7/2023 | 15:30 | Sunny | 0 | 20.9 | 0.03 | 0 | 31.3 / 1004.4 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 15/7/2023 | 08:30 & before excav. | Fine | 0 | 20.9 | 0.03 | 0 | 28.3 / 1000.8 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 15/7/2023 | 13:30 | Sunny | 0 | 20.9 | 0.03 | 0 | 34.5 / 1000.8 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 15/7/2023 | 15:30 | Sunny | 0 | 20.9 | 0.03 | 0 | 31.2 / 1000.8 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 18/7/2023 | 08:30 & before excav. | Fine | 0 | 20.9 | 0.03 | 0 | 27.4 / 1004.5 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 18/7/2023 | 13:30 | Rain | 0 | 20.9 | 0.03 | 0 | 29.5 / 1004.5 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 18/7/2023 | 15:30 | Sunny | 0 | 20.9 | 0.03 | 0 | 28.3 / 1004.5 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 19/7/2023 | 08:30 & before excav. | Sunny | 0 | 20.9 | 0.03 | 0 | 27.5 / 1007.5 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 19/7/2023 | 13:30 | Sunny | 0 | 20.9 | 0.03 | 0 | 30.2 / 1007.5 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 19/7/2023 | 15:30 | Sunny | 0 | 20.9 | 0.03 | 0 | 30.1 / 1007.5 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 20/7/2023 | 08:30 & before excav. | Sunny | 0 | 20.9 | 0.03 | 0 | 27.8 / 1008.5 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 20/7/2023 | 13:30 | Sunny | 0 | 20.9 | 0.03 | 0 | 32.3 / 1008.5 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 20/7/2023 | 15:30 | Sunny | 0 | 20.9 | 0.03 | 0 | 30.1 / 1008.5 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 17/2023 | | | | | | | | | Peter Au | |











Checked by :  H.F. Yan ATW-7
 Date : 20-7-2023

Landfill Gas Monitoring - Field Measurement Recording Sheet

Contract Title Design, Build and Operate First Stage of Tseung Kwan O Desalination Plant

Contract No. : 13/WSD/17

| Serial No. | Monitoring Equipment | Last Calibration |
|------------|----------------------|------------------|
| 254938 | GMI-PS500 | 2/9/2022 |

| Monitoring Location | Date (dd/mm/yyyy) | Time (hh:mm) | Weather Condition | Landfill Gas Parameters | | | | Physical Parameters | Trench Depth (m) | Measured by | |
|---------------------|-------------------|-----------------------|---|-------------------------|------------|--------------------|----------------------------|---------------------------|------------------|-------------|---|
| | | | Sunny/ Fine/ Overcast/ Drizzle/ Rain/ Storm/ Hazy | Methane (%LEL) | Oxygen (%) | Carbon Dioxide (%) | Balance Gas (%) (e.g. H2S) | Temp (°C) / Pressure mBar | | Name | Signature |
| Ch1+340 - Ch1+600 | 21 /7/2023 | 08:30 & before excav. | Sunny | 0 | 20.9 | 0.03 | 0 | 28.7 / 1009.7 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 21 /7/2023 | 13:30 | Sunny | 0 | 20.9 | 0.03 | 0 | 32.3 / 1009.7 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 21 /7/2023 | 15:30 | Sunny | 0 | 20.9 | 0.03 | 0 | 30.2 / 1009.7 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 22 /7/2023 | 08:30 & before excav. | Sunny | 0 | 20.9 | 0.03 | 0 | 29.5 / 1010.8 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 22 /7/2023 | 13:30 | Sunny | 0 | 20.9 | 0.03 | 0 | 32.4 / 1010.8 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 22 /7/2023 | 15:30 | Sunny | 0 | 20.9 | 0.03 | 0 | 30.1 / 1010.8 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 24 /7/2023 | 08:30 & before excav. | Sunny | 0 | 20.9 | 0.03 | 0 | 28.7 / 1010.8 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 24 /7/2023 | 13:30 | Sunny | 0 | 20.9 | 0.03 | 0 | 32.1 / 1009.5 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 24 /7/2023 | 15:30 | Sunny | 0 | 20.9 | 0.03 | 0 | 31.5 / 1009.5 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 25 /7/2023 | 08:30 & before excav. | Sunny | 0 | 20.9 | 0.03 | 0 | 29.6 / 1009.5 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 25 /7/2023 | 13:30 | Sunny | 0 | 20.9 | 0.03 | 0 | 33.2 / 1006.3 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 25 /7/2023 | 15:30 | Sunny | 0 | 20.9 | 0.03 | 0 | 30.1 / 1006.3 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 26 /7/2023 | 08:30 & before excav. | Sunny | 0 | 20.9 | 0.03 | 0 | 29.7 / 1002.3 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 26 /7/2023 | 13:30 | Sunny | 0 | 20.9 | 0.03 | 0 | 31.2 / 1002.3 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 26 /7/2023 | 15:30 | Sunny | 0 | 20.9 | 0.03 | 0 | 30.1 / 1002.3 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | /7/2023 | | | | | | | | | Peter Au | |

Checked by :

 H.F. Yip A1.w7

Date







26-7-2023

Landfill Gas Monitoring - Field Measurement Recording Sheet

Contract Title Design, Build and Operate First Stage of Tseung Kwan O Desalination Plant

Contract No. : 13/WSD/17

| Serial No. | Monitoring Equipment | Last Calibration |
|------------|----------------------|------------------|
| 254938 | GMI-PS500 | 2/9/2022 |

| Monitoring Location | Date (dd/mm/yyyy) | Time (hh:mm) | Weather Condition Sunny/ Fine/ Overcast/ Drizzle/ Rain/ Storm/ Hazy | Landfill Gas Parameters | | | | Physical Parameters | Trench Depth (m) | Measured by | |
|---------------------|-------------------|-----------------------|---|-------------------------|------------|--------------------|-------------------------------|---------------------------|------------------|-------------|---|
| | | | | Methane (%LEL) | Oxygen (%) | Carbon Dioxide (%) | Balance Gas (%) (e.g. H2S) | Temp (°C) / Pressure mBar | | Name | Signature |
| Ch1+340 - Ch1+600 | 27/7/2023 | 08:30 & before excav. | Sunny | 0 | 20.9 | 0.03 | 0 | 30.1 '997.7 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 27/7/2023 | 13:30 | Sunny | 0 | 20.9 | 0.03 | 0 | 33.2 '997.7 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 27/7/2023 | 15:30 | Sunny | 0 | 20.9 | 0.03 | 0 | 30.3 '997.7 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 28/7/2023 | 08:30 & before excav. | Sunny | 0 | 20.9 | 0.03 | 0 | 31.5 '996.8 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 28/7/2023 | 13:30 | Sunny | 0 | 20.9 | 0.03 | 0 | 33.9 '996.8 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 28/7/2023 | 15:30 | Sunny | 0 | 20.9 | 0.03 | 0 | 32.4 '996.8 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 29/7/2023 | 08:30 & before excav. | Fine | 0 | 20.9 | 0.03 | 0 | 28.4 '1002.3 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 29/7/2023 | 13:30 | Rain | 0 | 20.9 | 0.03 | 0 | 30.5 '1002.3 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 29/7/2023 | 15:30 | Fine | 0 | 20.9 | 0.03 | 0 | 31.5 '1002.3 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 31/7/2023 | 08:30 & before excav. | Rain | 0 | 20.9 | 0.03 | 0 | 27.4 '1006.3 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 31/7/2023 | 13:30 | Rain | 0 | 20.9 | 0.03 | 0 | 32.5 '1006.3 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | 31/7/2023 | 15:30 | Fine | 0 | 20.9 | 0.03 | 0 | 30.5 '1006.3 | 2 | Peter Au |  |
| Ch1+340 - Ch1+600 | /7/2023 | 08:30 & before excav. | | | | | | / | | Peter Au | |
| Ch1+340 - Ch1+600 | /7/2023 | 13:30 | | | | | | / | | Peter Au | |
| Ch1+340 - Ch1+600 | /7/2023 | 15:30 | | | | | | / | | Peter Au | |
| Ch1+340 - Ch1+600 | /7/2023 | | | | | | | | | Peter Au | |

Checked by : Yau Hiu Fung A10W-7 
 Date 31-7-2023

Appendix H

Waste Flow Table

Monthly Summary Waste Flow Table for 2023 (year)

| Month | Actual Quantities of Inert C&D Materials Generated Monthly | | | | | | Actual Quantities of C&D Wastes Generated Monthly | | | | |
|-----------|--|-------------------------------------|------------------------|--------------------------|-------------------------|---------------|---|----------------------------|-----------------------|----------------|-----------------------------|
| | Total Quantity Generated | Hard Rock and Large Broken Concrete | Reused in the Contract | Reused in other Projects | Disposed as Public Fill | Imported Fill | Metals | Paper/ cardboard packaging | Plastics (see Note 3) | Chemical Waste | Others, e.g. general refuse |
| | (in '000kg) | (in '000kg) | (in '000kg) | (in '000kg) | (in '000kg) | (in '000kg) | (in '000 kg) | (in '000kg) | (in '000kg) | (in '000kg) | (in '000kg) |
| Jan | 3383.820 | 0.000 | 0.000 | 0.000 | 3383.820 | 0.000 | 0.000 | 0.000 | 0.000 | 143.690 | |
| Feb | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.002 | 0.138 | 0.010 | 0.000 | 115.880 | |
| Mar | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 205.410 | |
| Apr | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 0.000 | 255.720 | |
| May | 2088.990 | 0.000 | 0.000 | 0.000 | 2088.990 | 0.000 | 0.000 | 0.000 | 0.000 | 202.270 | |
| Jun | 1955.240 | 0.000 | 0.000 | 0.000 | 1955.240 | 0.000 | 0.000 | 0.0017 | 0.000 | 189.680 | |
| Sub-total | 7428.050 | 0.000 | 0.000 | 0.000 | 7428.050 | 0.002 | 0.138 | 0.012 | 0.000 | 1112.650 | |
| Jul | 121.060 | 0.000 | 0.000 | 0.000 | 121.060 | 0.008 | 0.150 | 0.042 | 0.000 | 182.910 | |
| Aug | | | | | | | | | | | |
| Sep | | | | | | | | | | | |
| Oct | | | | | | | | | | | |
| Nov | | | | | | | | | | | |
| Dec | | | | | | | | | | | |
| Total | 7549.110 | 0.000 | 0.000 | 0.000 | 7549.110 | 0.010 | 0.288 | 0.054 | 0.000 | 1297.550 | |

Notes:

- (1) The performance targets are given in Section 1.69 of Specification B
- (2) The waste flow table shall also include C&D materials that are specified in the Contract to be imported for use at the Site.
- (3) Plastics refer to plastic bottles/containers, plastic sheets/ foam from packaging material

Appendix I

Site Inspection Proforma

Contract no. 13/WSD/17 Design, Build and Operate First Stage of Tseung Kwan O Desalination Plant

WEEKLY ENVIRONMENTAL INSPECTION CHECKLIST

Inspection Date: 4/7/2023 Inspected by: ET: Howard Chan SO: Mr. Raymond Kok WSD: /
 Contractor: Ms. Tiffany Tsang IEC: Mr. Jacky Chan

Inspection Time: 14:30-15:30

| | | | | | | | |
|-------------|------------------------------------|---|-----------------------------------|----------------------------------|--|--------------------------------|-------------------------------|
| Weather | | | | | | | |
| Condition | <input type="checkbox"/> Sunny | <input checked="" type="checkbox"/> Fine | <input type="checkbox"/> Overcast | <input type="checkbox"/> Drizzle | <input type="checkbox"/> Rain | <input type="checkbox"/> Storm | <input type="checkbox"/> Hazy |
| Temperature | <input type="text" value="30"/> °C | | Humidity | <input type="checkbox"/> High | <input checked="" type="checkbox"/> Moderate | <input type="checkbox"/> Low | |
| Wind | <input type="checkbox"/> Calm | <input checked="" type="checkbox"/> Light | <input type="checkbox"/> Breeze | <input type="checkbox"/> Strong | | | |

| Item No. | EIA ref. | | N/A | Yes | No | Photo/Remarks |
|-------------|----------|---|-------------------------------------|-------------------------------------|--------------------------|---------------|
| 0.00 | | General | | | | |
| 0.01 | | Is the current Environmental Permit displayed conspicuously at all vehicle site entrances/exits for public's information at any time? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 0.02 | | Is ET Leader's log-book kept readily available for inspections? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 1.00 | | Construction Dust | | | | |
| 1.01 | S4.8.1 | Are dusty materials, such as excavated materials, building debris and construction materials, and exposed earth surface properly covered to prevent dust emission? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 1.02 | S4.8.1 | Are screenings, enclosures, water spraying, or vacuum cleaning devices provided to dusty construction works for dust suppression? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 1.03 | S4.8.1 | Are fumes or smoke emitting plants or construction activities shielded by a screen? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 1.04 | S4.8.1 | Are wheel-washing facilities with high-pressure water jets provided at all site exits? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 1.05 | S4.8.1 | Is wheel-washing provided to all vehicles leaving the site? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 1.06 | S4.8.1 | Are road section near the site exit free from dusty material? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 1.07 | S4.8.1 | Are all main haul roads inside the site paved or sprayed with water to minimize dust emission during vehicle movement? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 1.08 | S4.8.1 | Are water spraying provided immediately prior to any loading or transfer of dusty materials? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 1.09 | S4.8.1 | Are covers provided to all dump trucks carrying dusty materials when entering and leaving the site? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 1.10 | S4.8.1 | Are the working areas for uprooting of trees, shrubs, or vegetation or the removal of boulders, poles, pillars sprayed with water to maintain the entire surface wet? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 1.11 | S4.8.1 | Is exposed earth properly treated within six months after the last construction activity on site? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 1.12 | S4.8.1 | Does the operation of plants on site free form dark smoke emission? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 1.13 | S4.8.1 | Are vehicles travelling at speed not exceeding 15km/hr within the site? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 1.14 | S4.8.1 | Are stock of more than 20 bags of cement or day PFA covered or sheltered on top and 3 sides? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |

Contract no. 13/WSD/17 Design, Build and Operate First Stage of Tseung Kwan O Desalination Plant

| Item No. | EIA ref. | | N/A | Yes | No | Photo/Remarks |
|-------------|----------|--|-------------------------------------|-------------------------------------|--------------------------|---------------|
| 1.15 | S4.8.1 | Are de-bagging, batching and mixing processes of bagged cement carried out in sheltered areas? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 1.16 | S4.8.1 | Are hoarding of at least 2.4m high provided along the site boundary adjoining areas accessible by the public? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 1.17 | S4.8.1 | Is open burning prohibited? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 2.00 | | Construction Noise (Airborne) | | | | |
| 2.01 | S5.7 | Are quiet plants adopted on site? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 2.02 | S5.7 | Are the PMEs operating on site well-maintained to minimize the generation of excessive noise? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 2.03 | S5.7 | Are plants throttled down or turned off when not in use? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 2.04 | S5.7 | Are the plants known to emit noise strongly in one direction oriented to face away from NSRs? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 2.05 | S5.7 | Are moveable barriers provided to screen NSRs from plant or noisy operations? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 2.06 | S5.7 | Are silencers, mufflers and enclosures provided to plants? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 2.07 | S5.7 | Are the hoods, cover panels and inspection hatches of PMEs closed during operation? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 2.08 | S5.7 | Are purposely-built site hoarding construction with appropriate materials provided along the site boundary? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 2.09 | S5.7 | Are noisy operation properly scheduled to minimize exposure and cumulative impacts to nearby sensitive receivers? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 2.10 | S5.7 | Are valid noise emission label(s) affixed to all hand-held breakers operating on site? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 2.11 | S5.7 | Are valid noise emission label(s) affixed to all air compressors operating on site? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 2.12 | S5.7 | Are all construction noise permit(s) applied for percussive piling work? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 2.13 | S5.7 | Are construction noise permit(s) applied for general construction works during restricted hours? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 2.14 | S5.7 | Are valid construction noise permit(s) displayed at all vehicular exits? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 3.00 | | Water Quality | | | | |
| 3.01 | S6.9 | Is effluent discharge license obtained for wastewater discharge from site? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 3.02 | S6.9 | Is effluent discharged according to the effluent discharge license? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 3.03 | S6.9 | Is wastewater discharge from site properly treated prior to discharge? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 3.04 | S6.9 | Are perimeter channels provided to intercept storm runoff from outside the site? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 3.05 | S6.9 | Are sand/silt removal facilities such as sand/silt traps and sediment basins provided to remove sand/silt particles from runoff? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |

Contract no. 13/WSD/17 Design, Build and Operate First Stage of Tseung Kwan O Desalination Plant

| Item No. | EIA ref. | | N/A | Yes | No | Photo/Remarks |
|----------|----------|--|-------------------------------------|-------------------------------------|--------------------------|---------------|
| 3.06 | S6.9 | Is surface runoff diverted to sedimentation facilities? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 3.07 | S6.9 | Is the drainage system properly maintained? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 3.08 | S6.9 | Are construction works carefully programmed to minimize soil excavation works during rainy seasons? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 3.09 | S6.9 | Are exposed soil surface protected by paving as soon as possible to reduce the potential of soil erosion? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 3.10 | S6.9 | Are temporary access roads protected by crushed gravel? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 3.11 | S6.9 | Are exposed slope surface properly protected? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 3.12 | S6.9 | Is trench excavation avoided in the wet season as far as practicable, or if necessary, backfilled in short sections after excavation? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 3.13 | S6.9 | Are open stockpiles of construction materials on site covered by tarpaulin or similar fabric during construction? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 3.14 | S6.9 | Is runoff from wheel-washing facilities avoided? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 3.15 | S6.9 | Is oil leakage or spillage prevented? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 3.16 | S6.9 | Are there any measures to prevent the release of oil and grease into the storm drainage system? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 3.17 | S6.9 | Are the oil interceptors/ grease traps properly maintained? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 3.18 | S6.9 | Are debris and rubbish generated on site collected, handled and disposed of properly to avoid them entering the streams? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 3.19 | S6.9 | Are all fuel tanks and storage areas provided with locks and be sited on sealed areas, within bunds of capacity equal to 110% of the storage capacity of the largest tank? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 3.20 | S6.9 | Are tanks, containers, storage area bunded and the locations locked as far as possible from the sensitive watercourse and stormwater drains? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 3.21 | S6.9 | Are sufficient chemical toilets provided on site to handle sewage from construction work force? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 3.22 | S6.9 | Are sewage disposal and toilet maintenance of the portable chemical toilets provided by the licensed contractors? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 3.23 | S6.9 | Is concrete washing water properly collected and treated prior to discharge? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 3.24 | S6.9 | Is suitable type of silt curtains deployed during dredging to reduce the elevation of suspended solids to nearby sensitive receivers? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 3.25 | S6.9 | Is closed grab dredger used to reduce the potential leakage of sediments? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 3.26 | S6.9 | Is closed grab dredger of 3 to 6 m ³ used for dredging at seawater intake? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 3.27 | S6.9 | Is specific work staff assigned the responsibility for monitoring the number of grab dredged per hour? Is number of cycle limited to 20-21 grab per hour for 3m ³ closed grab, 10-11 grab per hour for 6m ³ closed grab? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |

Contract no. 13/WSD/17 Design, Build and Operate First Stage of Tseung Kwan O Desalination Plant

| Item No. | EIA ref. | | N/A | Yes | No | Photo/Remarks |
|-------------|----------|--|-------------------------------------|-------------------------------------|--------------------------|---------------|
| 3.28 | S6.9 | Is the grab operated in slow and controlled manner such that the impact to seabed by the grab when being lowered could be minimized? Is the operator ensured the grab be properly closed before lifting the grab? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.29 | S6.9 | Is the maximum allowed dredging rate at the seawater intake limited to 750 m3/day while the maximum allowed dredging rate at the submarine outfall is 3,500 m3/day? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.30 | S6.9 | Is dredged marine sediment disposed of in a gazetted marine disposal area in accordance with marine dumping permit conditions of the Dumping at Sea Ordinance (DASO)? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.31 | S6.9 | Are disposal vessels fitted with tight bottom seals in order to prevent leakage of material during transport? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.32 | S6.9 | Are barges filled to a level which ensures that material does not spill over during transport to the disposal site and that adequate freeboard is maintained to ensure that the decks are not washed by wave action? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.33 | S6.9 | Are excess materials cleaned from decks and exposed fittings before the vessel is moved from the dredging area after dredging? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.34 | S6.9 | Are the contractor(s) confirmed that the works cause no visible foam, oil, grease, litter or other objectionable matter to be present in the water within and adjacent to the dredging site? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.35 | S6.9 | When the dredged material has been unloaded at the disposal areas, is any material accumulated on the deck or other exposed parts of the vessel removed and placed in the hold or a hopper? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.36 | S6.9 | Is dredger maintained adequate clearance between vessels and the seabed at all states of the tide and reduce operations speed to ensure that excessive turbidity is not generated by turbulence from vessel movement or propeller wash? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.37 | S6.9 | Is the contractor shall regularly inspect the silt curtains and check that they are moored and marked to avoid danger to marine traffic? Is regular inspection on the integrity of the silt curtain carried out by the contractor and any damage to the silt curtain shall be repaired by the contractor promptly? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.38 | S6.9 | Are all vessels have a clean ballast system? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.39 | S6.9 | Are all vessels well maintained and inspected before use to limit any potential discharges to the marine environment? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.40 | S6.9 | Is any discharge of sewage/grey wastewater? Is wastewater from potentially contaminated area on working vessels should be minimized and collected? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.41 | S6.9 | Is any soil waste disposed overboard? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 4.00 | | Waste Management | | | | |
| 4.01 | S8.5 | Is a trip-ticket system implemented to monitor the disposal of C&D and solid wastes at public filling facilities and landfills? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 4.02 | S8.5 | Is a recording system implemented to record the amount of wastes generated, recycled and disposed of? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 4.03 | S8.5 | Is the Contractor registered as a chemical waste producer? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |

Contract no. 13/WSD/17 Design, Build and Operate First Stage of Tseung Kwan O Desalination Plant

| Item No. | EIA ref. | | N/A | Yes | No | Photo/Remarks |
|-------------|----------------|--|-------------------------------------|-------------------------------------|--------------------------|---------------|
| 4.04 | S8.5 | Is chemical waste separated from other waste and collected by a licensed chemical waste collector? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 4.05 | S8.5 | Are trip tickets for chemical waste disposal available for inspection? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 4.06 | S8.5 | Is drip tray provided for chemical storage? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 4.07 | S8.5 | Are all containers for chemical waste properly labelled? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 4.08 | S8.5 | Is chemical waste storage area used solely for storage of chemical waste and properly labelled? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 4.09 | S8.5 | Are incompatible chemical wastes stored in different areas? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 4.10 | S8.5 | Is the chemical waste storage area enclosed on at least 3 sides and adequately ventilated? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 4.11 | S8.5 | Is an impermeable floor and bunding, of capacity to accommodate 110% of the volume of the largest container or of 20% by volume of the chemical waste stored in that area, whichever is the greatest, provide? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 4.12 | S8.5 | Are a routine cleaning and maintenance programme implemented for drainage systems, sump pits, and oil interceptors? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 4.13 | S8.5 | Are sufficient general refuse disposal/collection points provided on site? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 4.14 | S8.5 | Is general refuse disposed of properly and regularly? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 4.15 | S8.5 | Are appropriate measures adopted to minimize windblown litter and dust during transportation of waste? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 4.16 | S8.5 | Are individual collectors for aluminum cans, plastic bottles and packaging material and office paper provided to encourage waste segregation? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 4.17 | S8.5 | Are C&D wastes sorted on site? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 4.18 | S8.5 | Are C&D waste disposed of properly? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 4.19 | S8.5 | Are unused C&D materials or chemicals recycled or reused to reduce the quantity of waste? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 4.20 | S8.5 | Are public fill and C&D waste reuse on site as far as practicable to avoid disposal off-site? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 4.21 | S8.5 | Are the construction materials stored properly to minimize the potential for damage or contamination? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 4.22 | S8.5 | Is a dumping license obtained to deliver public fill to public filling areas? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 5.00 | S11.10 | Landscape and Visual | | | | |
| 5.01 | & 11.11 | Are Is site hoarding provided? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 5.02 | S11.10 & 11.11 | Are vegetation disturbance minimized or soil protected to reduce potential soil erosion? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 5.03 | S11.10 & 11.11 | Is construction light oriented away from the sensitive receivers? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |

Contract no. 13/WSD/17 Design, Build and Operate First Stage of Tseung Kwan O Desalination Plant

| Item No. | EIA ref. | | N/A | Yes | No | Photo/Remarks |
|----------|----------------|--|-------------------------------------|-------------------------------------|--------------------------|---------------|
| 5.04 | S11.10 & 11.11 | Is grass hydroseeding provided to slopes as soon as the completion of works? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 5.05 | S11.10 & 11.11 | Are damages to trees outside site boundary due construction works avoided? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 5.06 | S11.10 & 11.11 | Is excavation works carried out manually instead of machinery operation within 2.5m vicinity of any preserved trees? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 5.07 | S11.10 & 11.11 | Are the retained and transplanted tree(s) properly protected and in good conditions? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 5.08 | S11.10 & 11.11 | Are surgery works carried out for damaged trees? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 6.00 | S9.7 | Ecology | | | | |
| 6.01 | | Is site runoff properly treated to prevent any silty runoff? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 6.02 | S9.7 | Are silt trap installed and well-maintained? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 6.03 | S9.7 | Are stockpiles properly covered to avoid generating silty runoff? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 6.04 | S9.7 | Are construction works restricted to works area which are clearly defined? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 6.05 | S9.7 | For slope mitigation works within the Clear Water Bay Country Park, are tree felling and damages to trees, the exact locations of the flexible barrier foundation plates, soil nails and rock dowels adjusted during detailed design, and a setback distance from existing trees is recommended to be maintained as far as practical? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 6.06 | S9.7 | Are pruning of tree canopies along the alignment of the flexible barriers limited to a minimum? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 6.07 | S9.7 | Is the alignment of flexible barriers optimized to preserve all species of conservation interest and minimize the impact to the existing vegetation as far as practicable? Are the alignment of flexible barriers positioned at minimum 1.5 m in a radius away from these individuals? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 6.08 | S9.7 | Is temporary fencing installed to fence off the concerned species either in groups of individually within the works area and in the close proximity to prevent from being damaged and disturbed during construction? Is a sign identifying the site attached to the fence and flagging tape shall be attached to the individuals to visualize their locations? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 6.09 | S9.7 | Is a specification for fencing and demarcating individuals of Marsdenia lachnostoma (or other flora species of conservation interest, if found) adjacent to the proposed alignment of the flexible barriers prepared to protect the species? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 6.10 | S9.7 | Is any induction training provided to all site personnel in order to brief them on this flora of conservation interest including the locations and their importance? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 6.11 | S9.7 | Is the resident site supervisory staff closely monitor the conditions of concerned individuals during construction of flexible barriers in the close proximity? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 6.12 | S9.7 | Are fences erected along the boundary of the works area before the commencement of works to prevent vehicle movements and encroachment of personnel onto adjacent areas? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 6.13 | S9.7 | Is regular check of the work site boundaries performed to ensure that they are not breached and that damage does not occur to surrounding areas? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 6.14 | S9.7 | Is any damage and disturbance avoided, particularly those caused by filling and illegal dumping, to the surrounding habitats through proper management of waste disposal? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |

Contract no. 13/WSD/17 Design, Build and Operate First Stage of Tseung Kwan O Desalination Plant

| Item No. | EIA ref. | | N/A | Yes | No | Photo/Remarks |
|-------------|----------|---|-------------------------------------|-------------------------------------|--------------------------|---------------|
| 6.15 | S9.7 | Are temporarily affected areas reinstated, particularly the habitats of plantation and shrubland-grassland immediately after completion of construction works, through on-site tree/shrub planting? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 6.16 | S9.7 | Are affected habitats within the Clear Water Bay Country Bay reinstated by hydro-seeding and planting of climbers and native shrub seedlings where practical upon completion of the slope mitigation works? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 7.00 | | Landfill Gas Hazard | | | | |
| 7.01 | S12.7 | Are the safety procedures implemented to minimise the risks of fires and explosions, asphyxiation of works and toxicity effects during all works? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 7.02 | S12.7 | Are the gas detection equipment and precautions being used during trenching and excavation as well as creation of confined spaces? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 7.03 | S12.7 | Are the training with regard to the awareness of potential hazards of working in confined spaces provided from the Contractor to the workers? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 7.04 | S12.7 | Are the safety officers trained with regard to landfill gas and leachate related hazards and presented on the site throughout the works undertaken below grade? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 7.05 | S12.7 | Are the all personnel working on site and all visitor made aware of the possibility of ignition of gas, the possible presence of contaminated water and the need to avoid physical contact? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 7.06 | S12.7 | Is the monitoring of landfill gas being undertaken in all excavations, manholes, chambers and any confined spaces? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 7.07 | S12.7 | Are the monitoring frequency and areas being specified by the safety officers or appropriately qualified person? Are the all measurements being recorded and documented? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 7.08 | S12.7 | Is the drilling proceeded with adequate care and precautions against the potential hazards? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 7.09 | S12.7 | Is the method statement covering all normal and emergency procedures provided by the drilling contractor prior to the commencement of the site works? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 7.10 | S12.7 | Are the below ground services entries being sealed to prevent gas entry? Are the grilled metal covers being used for below grade cable trenches? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 7.11 | S12.7 | Is each manhole or utility pit monitored with two measurements (at mid-depth and base) for minimum of 10 minutes? Is the steady reading and peak reading recorded at each manhole or utility pit? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 7.12 | S12.7 | Are the warning signs of the hazards of landfill gas and its possible presence on site posted in prominent places? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 8.00 | | Overall | | | | |
| 8.01 | | Is the EM&A properly implemented in general? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |

Contract no. 13/WSD/17 Design, Build and Operate First Stage of Tseung Kwan O Desalination Plant

Remark / Follow up of Observation(s) and Non-compliance(s) of Last Weekly Site Inspection:

No major environmental deficiency was observed during site inspection.


Signatures:

ET
Representative




(Name: Howard Chan)

Contractor's
Representative



(Name: Timothy Tsang)

Supervising Officer's
Representative



(Name: Raymond Kou)

IEC's
Representative



(Name: Jasby Chow)

WSD's
Representative

(Name:)

Contract no. 13/WSD/17 Design, Build and Operate First Stage of Tseung Kwan O Desalination Plant

WEEKLY ENVIRONMENTAL INSPECTION CHECKLIST

Inspection Date: 11/7/2023 Inspected by: ET: Jacky Lam SO: Mr. Raymond Kok WSD: ✓
 Inspection Time: 14:30 - 16:00 Contractor: Ms. Tiffany Tsang IEC: Mr. Alex Chen

| | | | | | | | |
|----------------|---|---|-----------------------------------|----------------------------------|--|--------------------------------|-------------------------------|
| Weather | | | | | | | |
| Condition | <input checked="" type="checkbox"/> Sunny | <input type="checkbox"/> Fine | <input type="checkbox"/> Overcast | <input type="checkbox"/> Drizzle | <input type="checkbox"/> Rain | <input type="checkbox"/> Storm | <input type="checkbox"/> Hazy |
| Temperature | <u>34</u> °C | | Humidity | <input type="checkbox"/> High | <input checked="" type="checkbox"/> Moderate | <input type="checkbox"/> Low | |
| Wind | <input type="checkbox"/> Calm | <input checked="" type="checkbox"/> Light | <input type="checkbox"/> Breeze | <input type="checkbox"/> Strong | | | |

| Item No. | EIA ref. | | N/A | Yes | No | Photo/Remarks |
|-------------|----------|---|-------------------------------------|-------------------------------------|--------------------------|------------------|
| 0.00 | | General | | | | |
| 0.01 | | Is the current Environmental Permit displayed conspicuously at all vehicle site entrances/exits for public's information at any time? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 0.02 | | Is ET Leader's log-book kept readily available for inspections? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 1.00 | | Construction Dust | | | | |
| 1.01 | S4.8.1 | Are dusty materials, such as excavated materials, building debris and construction materials, and exposed earth surface properly covered to prevent dust emission? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 1.02 | S4.8.1 | Are screenings, enclosures, water spraying, or vacuum cleaning devices provided to dusty construction works for dust suppression? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 1.03 | S4.8.1 | Are fumes or smoke emitting plants or construction activities shielded by a screen? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 1.04 | S4.8.1 | Are wheel-washing facilities with high-pressure water jets provided at all site exits? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 1.05 | S4.8.1 | Is wheel-washing provided to all vehicles leaving the site? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 1.06 | S4.8.1 | Are road section near the site exit free from dusty material? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 1.07 | S4.8.1 | Are all main haul roads inside the site paved or sprayed with water to minimize dust emission during vehicle movement? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <u>Reminder!</u> |
| 1.08 | S4.8.1 | Are water spraying provided immediately prior to any loading or transfer of dusty materials? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 1.09 | S4.8.1 | Are covers provided to all dump trucks carrying dusty materials when entering and leaving the site? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 1.10 | S4.8.1 | Are the working areas for uprooting of trees, shrubs, or vegetation or the removal of boulders, poles, pillars sprayed with water to maintain the entire surface wet? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 1.11 | S4.8.1 | Is exposed earth properly treated within six months after the last construction activity on site? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 1.12 | S4.8.1 | Does the operation of plants on site free form dark smoke emission? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 1.13 | S4.8.1 | Are vehicles travelling at speed not exceeding 15km/hr within the site? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 1.14 | S4.8.1 | Are stock of more than 20 bags of cement or day PFA covered or sheltered on top and 3 sides? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |

Contract no. 13/WSD/17 Design, Build and Operate First Stage of Tseung Kwan O Desalination Plant

| Item No. | EIA ref. | | N/A | Yes | No | Photo/Remarks |
|-------------|----------|--|-------------------------------------|-------------------------------------|--------------------------|---------------|
| 1.15 | S4.8.1 | Are de-bagging, batching and mixing processes of bagged cement carried out in sheltered areas? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 1.16 | S4.8.1 | Are hoarding of at least 2.4m high provided along the site boundary adjoining areas accessible by the public? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 1.17 | S4.8.1 | Is open burning prohibited? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 2.00 | | Construction Noise (Airborne) | | | | |
| 2.01 | S5.7 | Are quiet plants adopted on site? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 2.02 | S5.7 | Are the PMEs operating on site well-maintained to minimize the generation of excessive noise? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 2.03 | S5.7 | Are plants throttled down or turned off when not in use? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 2.04 | S5.7 | Are the plants known to emit noise strongly in one direction oriented to face away from NSRs? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 2.05 | S5.7 | Are moveable barriers provided to screen NSRs from plant or noisy operations? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 2.06 | S5.7 | Are silencers, mufflers and enclosures provided to plants? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 2.07 | S5.7 | Are the hoods, cover panels and inspection hatches of PMEs closed during operation? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 2.08 | S5.7 | Are purposely-built site hoarding construction with appropriate materials provided along the site boundary? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 2.09 | S5.7 | Are noisy operation properly scheduled to minimize exposure and cumulative impacts to nearby sensitive receivers? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 2.10 | S5.7 | Are valid noise emission label(s) affixed to all hand-held breakers operating on site? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 2.11 | S5.7 | Are valid noise emission label(s) affixed to all air compressors operating on site? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 2.12 | S5.7 | Are all construction noise permit(s) applied for percussive piling work? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 2.13 | S5.7 | Are construction noise permit(s) applied for general construction works during restricted hours? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 2.14 | S5.7 | Are valid construction noise permit(s) displayed at all vehicular exits? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 3.00 | | Water Quality | | | | |
| 3.01 | S6.9 | Is effluent discharge license obtained for wastewater discharge from site? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 3.02 | S6.9 | Is effluent discharged according to the effluent discharge license? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 3.03 | S6.9 | Is wastewater discharge from site properly treated prior to discharge? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 3.04 | S6.9 | Are perimeter channels provided to intercept storm runoff from outside the site? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 3.05 | S6.9 | Are sand/silt removal facilities such as sand/silt traps and sediment basins provided to remove sand/silt particles from runoff? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |

Contract no. 13/WSD/17 Design, Build and Operate First Stage of Tseung Kwan O Desalination Plant

| Item No. | EIA ref. | | N/A | Yes | No | Photo/Remarks |
|----------|----------|--|-------------------------------------|-------------------------------------|--------------------------|---------------|
| 3.06 | S6.9 | Is surface runoff diverted to sedimentation facilities? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 3.07 | S6.9 | Is the drainage system properly maintained? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 3.08 | S6.9 | Are construction works carefully programmed to minimize soil excavation works during rainy seasons? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 3.09 | S6.9 | Are exposed soil surface protected by paving as soon as possible to reduce the potential of soil erosion? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 3.10 | S6.9 | Are temporary access roads protected by crushed gravel? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 3.11 | S6.9 | Are exposed slope surface properly protected? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 3.12 | S6.9 | Is trench excavation avoided in the wet season as far as practicable, or if necessary, backfilled in short sections after excavation? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 3.13 | S6.9 | Are open stockpiles of construction materials on site covered by tarpaulin or similar fabric during construction? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 3.14 | S6.9 | Is runoff from wheel-washing facilities avoided? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 3.15 | S6.9 | Is oil leakage or spillage prevented? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 3.16 | S6.9 | Are there any measures to prevent the release of oil and grease into the storm drainage system? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 3.17 | S6.9 | Are the oil interceptors/ grease traps properly maintained? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 3.18 | S6.9 | Are debris and rubbish generated on site collected, handled and disposed of properly to avoid them entering the streams? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 3.19 | S6.9 | Are all fuel tanks and storage areas provided with locks and be sited on sealed areas, within bunds of capacity equal to 110% of the storage capacity of the largest tank? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 3.20 | S6.9 | Are tanks, containers, storage area bunded and the locations locked as far as possible from the sensitive watercourse and stormwater drains? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 3.21 | S6.9 | Are sufficient chemical toilets provided on site to handle sewage from construction work force? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 3.22 | S6.9 | Are sewage disposal and toilet maintenance of the portable chemical toilets provided by the licensed contractors? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 3.23 | S6.9 | Is concrete washing water properly collected and treated prior to discharge? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 3.24 | S6.9 | Is suitable type of silt curtains deployed during dredging to reduce the elevation of suspended solids to nearby sensitive receivers? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 3.25 | S6.9 | Is closed grab dredger used to reduce the potential leakage of sediments? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 3.26 | S6.9 | Is closed grab dredger of 3 to 6 m ³ used for dredging at seawater intake? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 3.27 | S6.9 | Is specific work staff assigned the responsibility for monitoring the number of grab dredged per hour? Is number of cycle limited to 20-21 grab per hour for 3m ³ closed grab, 10-11 grab per hour for 6m ³ closed grab? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |

Contract no. 13/WSD/17 Design, Build and Operate First Stage of Tseung Kwan O Desalination Plant

| Item No. | EIA ref. | | N/A | Yes | No | Photo/Remarks |
|-------------|----------|--|-------------------------------------|-------------------------------------|--------------------------|---------------|
| 3.28 | S6.9 | Is the grab operated in slow and controlled manner such that the impact to seabed by the grab when being lowered could be minimized? Is the operator ensured the grab be properly closed before lifting the grab? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.29 | S6.9 | Is the maximum allowed dredging rate at the seawater intake limited to 750 m3/day while the maximum allowed dredging rate at the submarine outfall is 3,500 m3/day? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.30 | S6.9 | Is dredged marine sediment disposed of in a gazetted marine disposal area in accordance with marine dumping permit conditions of the Dumping at Sea Ordinance (DASO)? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.31 | S6.9 | Are disposal vessels fitted with tight bottom seals in order to prevent leakage of material during transport? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.32 | S6.9 | Are barges filled to a level which ensures that material does not spill over during transport to the disposal site and that adequate freeboard is maintained to ensure that the decks are not washed by wave action? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.33 | S6.9 | Are excess materials cleaned from decks and exposed fittings before the vessel is moved from the dredging area after dredging? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.34 | S6.9 | Are the contractor(s) confirmed that the works cause no visible foam, oil, grease, litter or other objectionable matter to be present in the water within and adjacent to the dredging site? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.35 | S6.9 | When the dredged material has been unloaded at the disposal areas, is any material accumulated on the deck or other exposed parts of the vessel removed and placed in the hold or a hopper? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.36 | S6.9 | Is dredger maintained adequate clearance between vessels and the seabed at all states of the tide and reduce operations speed to ensure that excessive turbidity is not generated by turbulence from vessel movement or propeller wash? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.37 | S6.9 | Is the contractor shall regularly inspect the silt curtains and check that they are moored and marked to avoid danger to marine traffic? Is regular inspection on the integrity of the silt curtain carried out by the contractor and any damage to the silt curtain shall be repaired by the contractor promptly? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.38 | S6.9 | Are all vessels have a clean ballast system? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.39 | S6.9 | Are all vessels well maintained and inspected before use to limit any potential discharges to the marine environment? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.40 | S6.9 | Is any discharge of sewage/grey wastewater? Is wastewater from potentially contaminated area on working vessels should be minimized and collected? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.41 | S6.9 | Is any soil waste disposed overboard? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 4.00 | | Waste Management | | | | |
| 4.01 | S8.5 | Is a trip-ticket system implemented to monitor the disposal of C&D and solid wastes at public filling facilities and landfills? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 4.02 | S8.5 | Is a recording system implemented to record the amount of wastes generated, recycled and disposed of? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 4.03 | S8.5 | Is the Contractor registered as a chemical waste producer? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |

Contract no. 13/WSD/17 Design, Build and Operate First Stage of Tseung Kwan O Desalination Plant

| Item No. | EIA ref. | | N/A | Yes | No | Photo/Remarks |
|-------------|----------------|--|-------------------------------------|-------------------------------------|--------------------------|------------------|
| 4.04 | S8.5 | Is chemical waste separated from other waste and collected by a licensed chemical waste collector? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 4.05 | S8.5 | Are trip tickets for chemical waste disposal available for inspection? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 4.06 | S8.5 | Is drip tray provided for chemical storage? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 4.07 | S8.5 | Are all containers for chemical waste properly labelled? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 4.08 | S8.5 | Is chemical waste storage area used solely for storage of chemical waste and properly labelled? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 4.09 | S8.5 | Are incompatible chemical wastes stored in different areas? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 4.10 | S8.5 | Is the chemical waste storage area enclosed on at least 3 sides and adequately ventilated? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 4.11 | S8.5 | Is an impermeable floor and bunding, of capacity to accommodate 110% of the volume of the largest container or of 20% by volume of the chemical waste stored in that area, whichever is the greatest, provide? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 4.12 | S8.5 | Are a routine cleaning and maintenance programme implemented for drainage systems, sump pits, and oil interceptors? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 4.13 | S8.5 | Are sufficient general refuse disposal/collection points provided on site? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 4.14 | S8.5 | Is general refuse disposed of properly and regularly? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <i>Reminders</i> |
| 4.15 | S8.5 | Are appropriate measures adopted to minimize windblown litter and dust during transportation of waste? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 4.16 | S8.5 | Are individual collectors for aluminum cans, plastic bottles and packaging material and office paper provided to encourage waste segregation? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 4.17 | S8.5 | Are C&D wastes sorted on site? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 4.18 | S8.5 | Are C&D waste disposed of properly? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 4.19 | S8.5 | Are unused C&D materials or chemicals recycled or reused to reduce the quantity of waste? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 4.20 | S8.5 | Are public fill and C&D waste reuse on site as far as practicable to avoid disposal off-site? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 4.21 | S8.5 | Are the construction materials stored properly to minimize the potential for damage or contamination? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 4.22 | S8.5 | Is a dumping license obtained to deliver public fill to public filling areas? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 5.00 | S11.10 | Landscape and Visual | | | | |
| 5.01 | & 11.11 | Are Is site hoarding provided? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 5.02 | S11.10 & 11.11 | Are vegetation disturbance minimized or soil protected to reduce potential soil erosion? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 5.03 | S11.10 & 11.11 | Is construction light oriented away from the sensitive receivers? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |

Contract no. 13/WSD/17 Design, Build and Operate First Stage of Tseung Kwan O Desalination Plant

| Item No. | EIA ref. | | N/A | Yes | No | Photo/Remarks |
|----------|----------------|--|-------------------------------------|-------------------------------------|--------------------------|---------------|
| 5.04 | S11.10 & 11.11 | Is grass hydroseeding provided to slopes as soon as the completion of works? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 5.05 | S11.10 & 11.11 | Are damages to trees outside site boundary due construction works avoided? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 5.06 | S11.10 & 11.11 | Is excavation works carried out manually instead of machinery operation within 2.5m vicinity of any preserved trees? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 5.07 | S11.10 & 11.11 | Are the retained and transplanted tree(s) properly protected and in good conditions? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 5.08 | S11.10 & 11.11 | Are surgery works carried out for damaged trees? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 6.00 | S9.7 | Ecology | | | | |
| 6.01 | S9.7 | Is site runoff properly treated to prevent any silly runoff? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 6.02 | S9.7 | Are silt trap installed and well-maintained? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 6.03 | S9.7 | Are stockpiles properly covered to avoid generating silty runoff? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 6.04 | S9.7 | Are construction works restricted to works area which are clearly defined? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 6.05 | S9.7 | For slope mitigation works within the Clear Water Bay Country Park, are tree felling and damages to trees, the exact locations of the flexible barrier foundation plates, soil nails and rock dowels adjusted during detailed design, and a setback distance from existing trees is recommended to be maintained as far as practical? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 6.06 | S9.7 | Are pruning of tree canopies along the alignment of the flexible barriers limited to a minimum? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 6.07 | S9.7 | Is the alignment of flexible barriers optimized to preserve all species of conservation interest and minimize the impact to the existing vegetation as far as practicable? Are the alignment of flexible barriers positioned at minimum 1.5 m in a radius away from these individuals? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 6.08 | S9.7 | Is temporary fencing installed to fence off the concerned species either in groups of individually within the works area and in the close proximity to prevent from being damaged and disturbed during construction? Is a sign identifying the site attached to the fence and flagging tape shall be attached to the individuals to visualize their locations? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 6.09 | S9.7 | Is a specification for fencing and demarcating individuals of Marsdenai lachnostoma (or other flora species of conservation interest, if found) adjacent to the proposed alignment of the flexible barriers prepared to protect the species? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 6.10 | S9.7 | Is any induction training provided to all site personnel in order to brief them on this flora of conservation interest including the locations and their importance? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 6.11 | S9.7 | Is the resident site supervisory staff closely monitor the conditions of concerned individuals during construction of flexible barriers in the close proximity? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 6.12 | S9.7 | Are fences erected along the boundary of the works area before the commencement of works to prevent vehicle movements and encroachment of personnel onto adjacent areas? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 6.13 | S9.7 | Is regular check of the work site boundaries performed to ensure that they are not breached and that damage does not occur to surrounding areas? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 6.14 | S9.7 | Is any damage and disturbance avoided, particularly those caused by filling and illegal dumping, to the surrounding habitats through proper management of waste disposal? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |

Contract no. 13/WSD/17 Design, Build and Operate First Stage of Tseung Kwan O Desalination Plant

| Item No. | EIA ref. | | N/A | Yes | No | Photo/Remarks |
|-------------|----------|---|-------------------------------------|-------------------------------------|--------------------------|---------------|
| 6.15 | S9.7 | Are temporarily affected areas reinstated, particularly the habitats of plantation and shrubland-grassland immediately after completion of construction works, through on-site tree/shrub planting? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 6.16 | S9.7 | Are affected habitats within the Clear Water Bay Country Bay reinstated by hydro-seeding and planting of climbers and native shrub seedlings where practical upon completion of the slope mitigation works? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 7.00 | | Landfill Gas Hazard | | | | |
| 7.01 | S12.7 | Are the safety procedures implemented to minimise the risks of fires and explosions, asphyxiation of works and toxicity effects during all works? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 7.02 | S12.7 | Are the gas detection equipment and precautions being used during trenching and excavation as well as creation of confined spaces? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 7.03 | S12.7 | Are the training with regard to the awareness of potential hazards of working in confined spaces provided from the Contractor to the workers? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 7.04 | S12.7 | Are the safety officers trained with regard to landfill gas and leachate related hazards and presented on the site throughout the works undertaken below grade? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 7.05 | S12.7 | Are the all personnel working on site and all visitor made aware of the possibility of ignition of gas, the possible presence of contaminated water and the need to avoid physical contact? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 7.06 | S12.7 | Is the monitoring of landfill gas being undertaken in all excavations, manholes, chambers and any confined spaces? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 7.07 | S12.7 | Are the monitoring frequency and areas being specified by the safety officers or appropriately qualified person? Are the all measurements being recorded and documented? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 7.08 | S12.7 | Is the drilling proceeded with adequate care and precautions against the potential hazards? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 7.09 | S12.7 | Is the method statement covering all normal and emergency procedures provided by the drilling contractor prior to the commencement of the site works? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 7.10 | S12.7 | Are the below ground services entries being sealed to prevent gas entry? Are the grilled metal covers being used for below grade cable trenches? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 7.11 | S12.7 | Is each manhole or utility pit monitored with two measurements (at mid-depth and base) for minimum of 10 minutes? Is the steady reading and peak reading recorded at each manhole or utility pit? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 7.12 | S12.7 | Are the warning signs of the hazards of landfill gas and its possible presence on site posted in prominent places? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 8.00 | | Overall | | | | |
| 8.01 | | Is the EM&A properly implemented in general? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |



Contract no. 13/WSD/17 Design, Build and Operate First Stage of Tseung Kwan O Desalination Plant

Remark / Follow up of Observation(s) and Non-compliance(s) of Last Weekly Site Inspection:

Reminder

- 1.) The Contractors are reminded to increase the frequency of water spraying along the haul roads for dust suppression.
- 2.) The Contractors are reminded to increase the waste collections at the waste ~~at~~ collection points to avoid ~~over~~ garbage overflow.

Signatures:

| | | | | |
|---|---|---|--|---|
| ET Representative | Contractor's Representative | Supervising Officer's Representative | IEC's Representative | WSD's Representative |
|  |  |  |  |  |
| (Name: <i>Yung Ching Ho</i>) | (Name: <i>Tiffany Tang</i>) | (Name: <i>Raymond Koli</i>) | (Name: <i>Alex Chau</i>) | (Name:) |

Contract no. 13/WSD/17 Design, Build and Operate First Stage of Tseung Kwan O Desalination Plant

WEEKLY ENVIRONMENTAL INSPECTION CHECKLIST

Inspection Date: 18/7/2023 Inspected by: ET: Jacky Leung SO: Mr. K.M. Tsang WSD:
 Inspection Time: 14:30-16:00 Contractor: Ms. Tathay Tsang IEC: Mr. Jacky Chau

| | | | | | | | |
|-------------|---|--------------------------------|-----------------------------------|----------------------------------|--|--------------------------------|-------------------------------|
| Weather | | | | | | | |
| Condition | <input checked="" type="checkbox"/> Sunny | <input type="checkbox"/> Fine | <input type="checkbox"/> Overcast | <input type="checkbox"/> Drizzle | <input type="checkbox"/> Rain | <input type="checkbox"/> Storm | <input type="checkbox"/> Hazy |
| Temperature | <input type="text" value="30"/> °C | | Humidity | <input type="checkbox"/> High | <input checked="" type="checkbox"/> Moderate | <input type="checkbox"/> Low | |
| Wind | <input type="checkbox"/> Calm | <input type="checkbox"/> Light | <input type="checkbox"/> Breeze | <input type="checkbox"/> Strong | | | |

| Item No. | EIA ref. | | N/A | Yes | No | Photo/Remarks |
|----------|----------|---|-------------------------------------|-------------------------------------|--------------------------|------------------|
| 0.00 | | General | | | | |
| 0.01 | | Is the current Environmental Permit displayed conspicuously at all vehicle site entrances/exits for public's information at any time? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 0.02 | | Is ET Leader's log-book kept readily available for inspections? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 1.00 | S4.8.1 | Construction Dust | | | | |
| 1.01 | | Are dusty materials, such as excavated materials, building debris and construction materials, and exposed earth surface properly covered to prevent dust emission? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <u>Reminder!</u> |
| 1.02 | S4.8.1 | Are screenings, enclosures, water spraying, or vacuum cleaning devices provided to dusty construction works for dust suppression? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 1.03 | S4.8.1 | Are fumes or smoke emitting plants or construction activities shielded by a screen? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 1.04 | S4.8.1 | Are wheel-washing facilities with high-pressure water jets provided at all site exits? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 1.05 | S4.8.1 | Is wheel-washing provided to all vehicles leaving the site? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 1.06 | S4.8.1 | Are road section near the site exit free from dusty material? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 1.07 | S4.8.1 | Are all main haul roads inside the site paved or sprayed with water to minimize dust emission during vehicle movement? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 1.08 | S4.8.1 | Are water spraying provided immediately prior to any loading or transfer of dusty materials? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 1.09 | S4.8.1 | Are covers provided to all dump trucks carrying dusty materials when entering and leaving the site? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 1.10 | S4.8.1 | Are the working areas for uprooting of trees, shrubs, or vegetation or the removal of boulders, poles, pillars sprayed with water to maintain the entire surface wet? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 1.11 | S4.8.1 | Is exposed earth properly treated within six months after the last construction activity on site? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 1.12 | S4.8.1 | Does the operation of plants on site free form dark smoke emission? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 1.13 | S4.8.1 | Are vehicles travelling at speed not exceeding 15km/hr within the site? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 1.14 | S4.8.1 | Are stock of more than 20 bags of cement or day PFA covered or sheltered on top and 3 sides? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |

Contract no. 13/WSD/17 Design, Build and Operate First Stage of Tseung Kwan O Desalination Plant

| Item No. | EIA ref. | | N/A | Yes | No | Photo/Remarks |
|-------------|----------|--|-------------------------------------|-------------------------------------|--------------------------|---------------|
| 1.15 | S4.8.1 | Are de-bagging, batching and mixing processes of bagged cement carried out in sheltered areas? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 1.16 | S4.8.1 | Are hoarding of at least 2.4m high provided along the site boundary adjoining areas accessible by the public? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 1.17 | S4.8.1 | Is open burning prohibited? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 2.00 | | Construction Noise (Airborne) | | | | |
| 2.01 | S5.7 | Are quiet plants adopted on site? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 2.02 | S5.7 | Are the PME's operating on site well-maintained to minimize the generation of excessive noise? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 2.03 | S5.7 | Are plants throttled down or turned off when not in use? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 2.04 | S5.7 | Are the plants known to emit noise strongly in one direction oriented to face away from NSRs? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 2.05 | S5.7 | Are moveable barriers provided to screen NSRs from plant or noisy operations? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 2.06 | S5.7 | Are silencers, mufflers and enclosures provided to plants? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 2.07 | S5.7 | Are the hoods, cover panels and inspection hatches of PME's closed during operation? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 2.08 | S5.7 | Are purposely-built site hoarding construction with appropriate materials provided along the site boundary? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 2.09 | S5.7 | Are noisy operation properly scheduled to minimize exposure and cumulative impacts to nearby sensitive receivers? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 2.10 | S5.7 | Are valid noise emission label(s) affixed to all hand-held breakers operating on site? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 2.11 | S5.7 | Are valid noise emission label(s) affixed to all air compressors operating on site? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 2.12 | S5.7 | Are all construction noise permit(s) applied for percussive piling work? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 2.13 | S5.7 | Are construction noise permit(s) applied for general construction works during restricted hours? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 2.14 | S5.7 | Are valid construction noise permit(s) displayed at all vehicular exits? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 3.00 | | Water Quality | | | | |
| 3.01 | S6.9 | Is effluent discharge license obtained for wastewater discharge from site? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 3.02 | S6.9 | Is effluent discharged according to the effluent discharge license? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 3.03 | S6.9 | Is wastewater discharge from site properly treated prior to discharge? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 3.04 | S6.9 | Are perimeter channels provided to intercept storm runoff from outside the site? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 3.05 | S6.9 | Are sand/silt removal facilities such as sand/silt traps and sediment basins provided to remove sand/silt particles from runoff? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |

Contract no. 13/WSD/17 Design, Build and Operate First Stage of Tseung Kwan O Desalination Plant

| Item No. | EIA ref. | | N/A | Yes | No | Photo/Remarks |
|----------|----------|--|-------------------------------------|-------------------------------------|--------------------------|---------------|
| 3.06 | S6.9 | Is surface runoff diverted to sedimentation facilities? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 3.07 | S6.9 | Is the drainage system properly maintained? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 3.08 | S6.9 | Are construction works carefully programmed to minimize soil excavation works during rainy seasons? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 3.09 | S6.9 | Are exposed soil surface protected by paving as soon as possible to reduce the potential of soil erosion? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 3.10 | S6.9 | Are temporary access roads protected by crushed gravel? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 3.11 | S6.9 | Are exposed slope surface properly protected? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 3.12 | S6.9 | Is trench excavation avoided in the wet season as far as practicable, or if necessary, backfilled in short sections after excavation? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 3.13 | S6.9 | Are open stockpiles of construction materials on site covered by tarpaulin or similar fabric during construction? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 3.14 | S6.9 | Is runoff from wheel-washing facilities avoided? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 3.15 | S6.9 | Is oil leakage or spillage prevented? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 3.16 | S6.9 | Are there any measures to prevent the release of oil and grease into the storm drainage system? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 3.17 | S6.9 | Are the oil interceptors/ grease traps properly maintained? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 3.18 | S6.9 | Are debris and rubbish generated on site collected, handled and disposed of properly to avoid them entering the streams? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 3.19 | S6.9 | Are all fuel tanks and storage areas provided with locks and be sited on sealed areas, within bunds of capacity equal to 110% of the storage capacity of the largest tank? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 3.20 | S6.9 | Are tanks, containers, storage area bunded and the locations locked as far as possible from the sensitive watercourse and stormwater drains? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 3.21 | S6.9 | Are sufficient chemical toilets provided on site to handle sewage from construction work force? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 3.22 | S6.9 | Are sewage disposal and toilet maintenance of the portable chemical toilets provided by the licensed contractors? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 3.23 | S6.9 | Is concrete washing water properly collected and treated prior to discharge? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 3.24 | S6.9 | Is suitable type of silt curtains deployed during dredging to reduce the elevation of suspended solids to nearby sensitive receivers? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 3.25 | S6.9 | Is closed grab dredger used to reduce the potential leakage of sediments? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 3.26 | S6.9 | Is closed grab dredger of 3 to 6 m ³ used for dredging at seawater intake? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 3.27 | S6.9 | Is specific work staff assigned the responsibility for monitoring the number of grab dredged per hour? Is number of cycle limited to 20-21 grab per hour for 3m ³ closed grab, 10-11 grab per hour for 6m ³ closed grab? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |

Contract no. 13/WSD/17 Design, Build and Operate First Stage of Tseung Kwan O Desalination Plant

| Item No. | EIA ref. | | N/A | Yes | No | Photo/Remarks |
|----------|----------|--|-------------------------------------|-------------------------------------|--------------------------|---------------|
| 3.28 | S6.9 | Is the grab operated in slow and controlled manner such that the impact to seabed by the grab when being lowered could be minimized? Is the operator ensured the grab be properly closed before lifting the grab? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.29 | S6.9 | Is the maximum allowed dredging rate at the seawater intake limited to 750 m3/day while the maximum allowed dredging rate at the submarine outfall is 3,500 m3/day? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.30 | S6.9 | Is dredged marine sediment disposed of in a gazetted marine disposal area in accordance with marine dumping permit conditions of the Dumping at Sea Ordinance (DASO)? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.31 | S6.9 | Are disposal vessels fitted with tight bottom seals in order to prevent leakage of material during transport? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.32 | S6.9 | Are barges filled to a level which ensures that material does not spill over during transport to the disposal site and that adequate freeboard is maintained to ensure that the decks are not washed by wave action? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.33 | S6.9 | Are excess materials cleaned from decks and exposed fittings before the vessel is moved from the dredging area after dredging? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.34 | S6.9 | Are the contractor(s) confirmed that the works cause no visible foam, oil, grease, litter or other objectionable matter to be present in the water within and adjacent to the dredging site? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.35 | S6.9 | When the dredged material has been unloaded at the disposal areas, is any material accumulated on the deck or other exposed parts of the vessel removed and placed in the hold or a hopper? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.36 | S6.9 | Is dredger maintained adequate clearance between vessels and the seabed at all states of the tide and reduce operations speed to ensure that excessive turbidity is not generated by turbulence from vessel movement or propeller wash? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.37 | S6.9 | Is the contractor shall regularly inspect the silt curtains and check that they are moored and marked to avoid danger to marine traffic? Is regular inspection on the integrity of the silt curtain carried out by the contractor and any damage to the silt curtain shall be repaired by the contractor promptly? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.38 | S6.9 | Are all vessels have a clean ballast system? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.39 | S6.9 | Are all vessels well maintained and inspected before use to limit any potential discharges to the marine environment? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.40 | S6.9 | Is any discharge of sewage/grey wastewater? Is wastewater from potentially contaminated area on working vessels should be minimized and collected? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.41 | S6.9 | Is any soil waste disposed overboard? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 4.00 | | Waste Management | | | | |
| 4.01 | S8.5 | Is a trip-ticket system implemented to monitor the disposal of C&D and solid wastes at public filling facilities and landfills? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 4.02 | S8.5 | Is a recording system implemented to record the amount of wastes generated, recycled and disposed of? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 4.03 | S8.5 | Is the Contractor registered as a chemical waste producer? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |

Contract no. 13/WSD/17 Design, Build and Operate First Stage of Tseung Kwan O Desalination Plant

| Item No. | EIA ref. | | N/A | Yes | No | Photo/Remarks |
|----------|----------------|--|-------------------------------------|-------------------------------------|-------------------------------------|---------------|
| 4.04 | S8.5 | Is chemical waste separated from other waste and collected by a licensed chemical waste collector? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 4.05 | S8.5 | Are trip tickets for chemical waste disposal available for inspection? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 4.06 | S8.5 | Is drip tray provided for chemical storage? | <input type="checkbox"/> | <input type="checkbox"/> | <input checked="" type="checkbox"/> | observation! |
| 4.07 | S8.5 | Are all containers for chemical waste properly labelled? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 4.08 | S8.5 | Is chemical waste storage area used solely for storage of chemical waste and properly labelled? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 4.09 | S8.5 | Are incompatible chemical wastes stored in different areas? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 4.10 | S8.5 | Is the chemical waste storage area enclosed on at least 3 sides and adequately ventilated? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 4.11 | S8.5 | Is an impermeable floor and bunding, of capacity to accommodate 110% of the volume of the largest container or of 20% by volume of the chemical waste stored in that area, whichever is the greatest, provide? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 4.12 | S8.5 | Are a routine cleaning and maintenance programme implemented for drainage systems, sump pits, and oil interceptors? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 4.13 | S8.5 | Are sufficient general refuse disposal/collection points provided on site? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 4.14 | S8.5 | Is general refuse disposed of properly and regularly? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | Reminder |
| 4.15 | S8.5 | Are appropriate measures adopted to minimize windblown litter and dust during transportation of waste? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 4.16 | S8.5 | Are individual collectors for aluminum cans, plastic bottles and packaging material and office paper provided to encourage waste segregation? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 4.17 | S8.5 | Are C&D wastes sorted on site? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 4.18 | S8.5 | Are C&D waste disposed of properly? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 4.19 | S8.5 | Are unused C&D materials or chemicals recycled or reused to reduce the quantity of waste? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 4.20 | S8.5 | Are public fill and C&D waste reuse on site as far as practicable to avoid disposal off-site? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 4.21 | S8.5 | Are the construction materials stored properly to minimize the potential for damage or contamination? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 4.22 | S8.5 | Is a dumping license obtained to deliver public fill to public filling areas? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 5.00 | S11.10 | Landscape and Visual | | | | |
| 5.01 | & 11.11 | Are Is site hoarding provided? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 5.02 | S11.10 & 11.11 | Are vegetation disturbance minimized or soil protected to reduce potential soil erosion? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 5.03 | S11.10 & 11.11 | Is construction light oriented away from the sensitive receivers? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |

Contract no. 13/WSD/17 Design, Build and Operate First Stage of Tseung Kwan O Desalination Plant

| Item No. | EIA ref. | | N/A | Yes | No | Photo/Remarks |
|----------|----------------|--|-------------------------------------|-------------------------------------|--------------------------|---------------|
| 5.04 | S11.10 & 11.11 | Is grass hydroseeding provided to slopes as soon as the completion of works? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 5.05 | S11.10 & 11.11 | Are damages to trees outside site boundary due construction works avoided? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 5.06 | S11.10 & 11.11 | Is excavation works carried out manually instead of machinery operation within 2.5m vicinity of any preserved trees? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 5.07 | S11.10 & 11.11 | Are the retained and transplanted tree(s) properly protected and in good conditions? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 5.08 | S11.10 & 11.11 | Are surgery works carried out for damaged trees? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 6.00 | S9.7 | Ecology | | | | |
| 6.01 | | Is site runoff properly treated to prevent any silty runoff? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 6.02 | S9.7 | Are silt trap installed and well-maintained? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 6.03 | S9.7 | Are stockpiles properly covered to avoid generating silty runoff? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | Reminder 1 |
| 6.04 | S9.7 | Are construction works restricted to works area which are clearly defined? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 6.05 | S9.7 | For slope mitigation works within the Clear Water Bay Country Park, are tree felling and damages to trees, the exact locations of the flexible barrier foundation plates, soil nails and rock dowels adjusted during detailed design, and a setback distance from existing trees is recommended to be maintained as far as practical? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 6.06 | S9.7 | Are pruning of tree canopies along the alignment of the flexible barriers limited to a minimum? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 6.07 | S9.7 | Is the alignment of flexible barriers optimized to preserve all species of conservation interest and minimize the impact to the existing vegetation as far as practicable? Are the alignment of flexible barriers positioned at minimum 1.5 m in a radius away from these individuals? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 6.08 | S9.7 | Is temporary fencing installed to fence off the concerned species either in groups of individually within the works area and in the close proximity to prevent from being damaged and disturbed during construction? Is a sign identifying the site attached to the fence and flagging tape shall be attached to the individuals to visualize their locations? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 6.09 | S9.7 | Is a specification for fencing and demarcating individuals of Marsdenia tinctoria (or other flora species of conservation interest, if found) adjacent to the proposed alignment of the flexible barriers prepared to protect the species? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 6.10 | S9.7 | Is any induction training provided to all site personnel in order to brief them on this flora of conservation interest including the locations and their importance? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 6.11 | S9.7 | Is the resident site supervisory staff closely monitor the conditions of concerned individuals during construction of flexible barriers in the close proximity? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 6.12 | S9.7 | Are fences erected along the boundary of the works area before the commencement of works to prevent vehicle movements and encroachment of personnel onto adjacent areas? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 6.13 | S9.7 | Is regular check of the work site boundaries performed to ensure that they are not breached and that damage does not occur to surrounding areas? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 6.14 | S9.7 | Is any damage and disturbance avoided, particularly those caused by filling and illegal dumping, to the surrounding habitats through proper management of waste disposal? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |

Contract no. 13/WSD/17 Design, Build and Operate First Stage of Tseung Kwan O Desalination Plant

| Item No. | EIA ref. | | N/A | Yes | No | Photo/Remarks |
|-------------|----------|---|-------------------------------------|-------------------------------------|--------------------------|---------------|
| 6.15 | S9.7 | Are temporarily affected areas reinstated, particularly the habitats of plantation and shrubland-grassland immediately after completion of construction works, through on-site tree/shrub planting? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 6.16 | S9.7 | Are affected habitats within the Clear Water Bay Country Bay reinstated by hydro-seeding and planting of climbers and native shrub seedlings where practical upon completion of the slope mitigation works? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 7.00 | | Landfill Gas Hazard | | | | |
| 7.01 | S12.7 | Are the safety procedures implemented to minimise the risks of fires and explosions, asphyxiation of works and toxicity effects during all works? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 7.02 | S12.7 | Are the gas detection equipment and precautions being used during trenching and excavation as well as creation of confined spaces? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 7.03 | S12.7 | Are the training with regard to the awareness of potential hazards of working in confined spaces provided from the Contractor to the workers? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 7.04 | S12.7 | Are the safety officers trained with regard to landfill gas and leachate related hazards and presented on the site throughout the works undertaken below grade? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 7.05 | S12.7 | Are the all personnel working on site and all visitor made aware of the possibility of ignition of gas, the possible presence of contaminated water and the need to avoid physical contact? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 7.06 | S12.7 | Is the monitoring of landfill gas being undertaken in all excavations, manholes, chambers and any confined spaces? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 7.07 | S12.7 | Are the monitoring frequency and areas being specified by the safety officers or appropriately qualified person? Are the all measurements being recorded and documented? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 7.08 | S12.7 | Is the drilling proceeded with adequate care and precautions against the potential hazards? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 7.09 | S12.7 | Is the method statement covering all normal and emergency procedures provided by the drilling contractor prior to the commencement of the site works? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 7.10 | S12.7 | Are the below ground services entries being sealed to prevent gas entry? Are the grilled metal covers being used for below grade cable trenches? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 7.11 | S12.7 | Is each manhole or utility pit monitored with two measurements (at mid-depth and base) for minimum of 10 minutes? Is the steady reading and peak reading recorded at each manhole or utility pit? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 7.12 | S12.7 | Are the warning signs of the hazards of landfill gas and its possible presence on site posted in prominent places? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 8.00 | | Overall | | | | |
| 8.01 | | Is the EM&A properly implemented in general? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |

Contract no. 13/WSD/17 Design, Build and Operate First Stage of Tseung Kwan O Desalination Plant

Remark / Follow up of Observation(s) and Non-compliance(s) of Last Weekly Site Inspection:

Observation

1.) The Chemical Containers found near the R.O. Building shall be stored on a drip tray or proper storage.

Reminder

- 1.) The Contractors are reminded to cover the soil stockpile with tarpaulin to prevent spreading dust.
- 2.) The Contractors are reminded to remove the waste and un used materials near the waste containers near the R.O. Building and Chemical Building

Signatures:

ET Representative

Contractor's Representative

Supervising Officer's Representative

IEC's Representative

WSD's Representative

(Name: *Tseung Man Ho*)

(Name: *Tiffany Tsang*)

(Name: *K.M. Boy*)

(Name: *Sauky Chow*)

(Name:)

Contract no. 13/WSD/17 Design, Build and Operate First Stage of Tseung Kwan O Desalination Plant

WEEKLY ENVIRONMENTAL INSPECTION CHECKLIST

Inspection Date: 25/7/2023 Inspected by: ET: Jacky Leung SO: Mr. Raymond Kok WSD: Mr. W.P. Ho
 Contractor: Mr. Brian Lam IEC: Mr. Alex Chea
 Inspection Time: 09:15 - 12:00

| | | | | | | | |
|----------------|---|---|-----------------------------------|----------------------------------|--|--------------------------------|-------------------------------|
| Weather | | | | | | | |
| Condition | <input checked="" type="checkbox"/> Sunny | <input type="checkbox"/> Fine | <input type="checkbox"/> Overcast | <input type="checkbox"/> Drizzle | <input type="checkbox"/> Rain | <input type="checkbox"/> Storm | <input type="checkbox"/> Hazy |
| Temperature | <input type="text" value="32"/> °C | | Humidity | <input type="checkbox"/> High | <input checked="" type="checkbox"/> Moderate | <input type="checkbox"/> Low | |
| Wind | <input type="checkbox"/> Calm | <input checked="" type="checkbox"/> Light | <input type="checkbox"/> Breeze | <input type="checkbox"/> Strong | | | |

| Item No. | EIA ref. | | N/A | Yes | No | Photo/Remarks |
|----------|----------|---|-------------------------------------|-------------------------------------|--------------------------|-------------------|
| 0.00 | | General | | | | |
| 0.01 | | Is the current Environmental Permit displayed conspicuously at all vehicle site entrances/exits for public's information at any time? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 0.02 | | Is ET Leader's log-book kept readily available for inspections? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 1.00 | S4.8.1 | Construction Dust | | | | |
| 1.01 | | Are dusty materials, such as excavated materials, building debris and construction materials, and exposed earth surface properly covered to prevent dust emission? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <i>Reminder 2</i> |
| 1.02 | S4.8.1 | Are screenings, enclosures, water spraying, or vacuum cleaning devices provided to dusty construction works for dust suppression? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 1.03 | S4.8.1 | Are fumes or smoke emitting plants or construction activities shielded by a screen? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 1.04 | S4.8.1 | Are wheel-washing facilities with high-pressure water jets provided at all site exits? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 1.05 | S4.8.1 | Is wheel-washing provided to all vehicles leaving the site? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 1.06 | S4.8.1 | Are road section near the site exit free from dusty material? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 1.07 | S4.8.1 | Are all main haul roads inside the site paved or sprayed with water to minimize dust emission during vehicle movement? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 1.08 | S4.8.1 | Are water spraying provided immediately prior to any loading or transfer of dusty materials? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 1.09 | S4.8.1 | Are covers provided to all dump trucks carrying dusty materials when entering and leaving the site? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 1.10 | S4.8.1 | Are the working areas for uprooting of trees, shrubs, or vegetation or the removal of boulders, poles, pillars sprayed with water to maintain the entire surface wet? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 1.11 | S4.8.1 | Is exposed earth properly treated within six months after the last construction activity on site? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 1.12 | S4.8.1 | Does the operation of plants on site free form dark smoke emission? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 1.13 | S4.8.1 | Are vehicles travelling at speed not exceeding 15km/hr within the site? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 1.14 | S4.8.1 | Are stock of more than 20 bags of cement or day PFA covered or sheltered on top and 3 sides? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |

Contract no. 13/WSD/17 Design, Build and Operate First Stage of Tseung Kwan O Desalination Plant

| Item No. | EIA ref. | | N/A | Yes | No | Photo/Remarks |
|-------------|----------|--|-------------------------------------|-------------------------------------|--------------------------|---------------|
| 1.15 | S4.8.1 | Are de-bagging, batching and mixing processes of bagged cement carried out in sheltered areas? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 1.16 | S4.8.1 | Are hoarding of at least 2.4m high provided along the site boundary adjoining areas accessible by the public? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 1.17 | S4.8.1 | Is open burning prohibited? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 2.00 | | Construction Noise (Airborne) | | | | |
| 2.01 | S5.7 | Are quiet plants adopted on site? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 2.02 | S5.7 | Are the PMEs operating on site well-maintained to minimize the generation of excessive noise? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 2.03 | S5.7 | Are plants throttled down or turned off when not in use? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 2.04 | S5.7 | Are the plants known to emit noise strongly in one direction oriented to face away from NSRs? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 2.05 | S5.7 | Are moveable barriers provided to screen NSRs from plant or noisy operations? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 2.06 | S5.7 | Are silencers, mufflers and enclosures provided to plants? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 2.07 | S5.7 | Are the hoods, cover panels and inspection hatches of PMEs closed during operation? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 2.08 | S5.7 | Are purposely-built site hoarding construction with appropriate materials provided along the site boundary? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 2.09 | S5.7 | Are noisy operation properly scheduled to minimize exposure and cumulative impacts to nearby sensitive receivers? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 2.10 | S5.7 | Are valid noise emission label(s) affixed to all hand-held breakers operating on site? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 2.11 | S5.7 | Are valid noise emission label(s) affixed to all air compressors operating on site? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 2.12 | S5.7 | Are all construction noise permit(s) applied for percussive piling work? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 2.13 | S5.7 | Are construction noise permit(s) applied for general construction works during restricted hours? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 2.14 | S5.7 | Are valid construction noise permit(s) displayed at all vehicular exits? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.00 | | Water Quality | | | | |
| 3.01 | S6.9 | Is effluent discharge license obtained for wastewater discharge from site? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.02 | S6.9 | Is effluent discharged according to the effluent discharge license? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.03 | S6.9 | Is wastewater discharge from site properly treated prior to discharge? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.04 | S6.9 | Are perimeter channels provided to intercept storm runoff from outside the site? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.05 | S6.9 | Are sand/silt removal facilities such as sand/silt traps and sediment basins provided to remove sand/silt particles from runoff? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |

Contract no. 13/WSD/17 Design, Build and Operate First Stage of Tseung Kwan O Desalination Plant

| Item No. | EIA ref. | | N/A | Yes | No | Photo/Remarks |
|----------|----------|--|-------------------------------------|-------------------------------------|--------------------------|---------------|
| 3.06 | S6.9 | Is surface runoff diverted to sedimentation facilities? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.07 | S6.9 | Is the drainage system properly maintained? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.08 | S6.9 | Are construction works carefully programmed to minimize soil excavation works during rainy seasons? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.09 | S6.9 | Are exposed soil surface protected by paving as soon as possible to reduce the potential of soil erosion? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.10 | S6.9 | Are temporary access roads protected by crushed gravel? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.11 | S6.9 | Are exposed slope surface properly protected? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.12 | S6.9 | Is trench excavation avoided in the wet season as far as practicable, or if necessary, backfilled in short sections after excavation? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.13 | S6.9 | Are open stockpiles of construction materials on site covered by tarpaulin or similar fabric during construction? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.14 | S6.9 | Is runoff from wheel-washing facilities avoided? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.15 | S6.9 | Is oil leakage or spillage prevented? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.16 | S6.9 | Are there any measures to prevent the release of oil and grease into the storm drainage system? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.17 | S6.9 | Are the oil interceptors/ grease traps properly maintained? | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.18 | S6.9 | Are debris and rubbish generated on site collected, handled and disposed of properly to avoid them entering the streams? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.19 | S6.9 | Are all fuel tanks and storage areas provided with locks and be sited on sealed areas, within bunds of capacity equal to 110% of the storage capacity of the largest tank? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.20 | S6.9 | Are tanks, containers, storage area bunded and the locations locked as far as possible from the sensitive watercourse and stormwater drains? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.21 | S6.9 | Are sufficient chemical toilets provided on site to handle sewage from construction work force? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.22 | S6.9 | Are sewage disposal and toilet maintenance of the portable chemical toilets provided by the licensed contractors? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.23 | S6.9 | Is concrete washing water properly collected and treated prior to discharge? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.24 | S6.9 | Is suitable type of silt curtains deployed during dredging to reduce the elevation of suspended solids to nearby sensitive receivers? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.25 | S6.9 | Is closed grab dredger used to reduce the potential leakage of sediments? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.26 | S6.9 | Is closed grab dredger of 3 to 6 m ³ used for dredging at seawater intake? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.27 | S6.9 | Is specific work staff assigned the responsibility for monitoring the number of grab dredged per hour? Is number of cycle limited to 20-21 grab per hour for 3m ³ closed grab, 10-11 grab per hour for 6m ³ closed grab? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |

Contract no. 13/WSD/17 Design, Build and Operate First Stage of Tseung Kwan O Desalination Plant

| Item No. | EIA ref. | | N/A | Yes | No | Photo/Remarks |
|-------------|----------|--|-------------------------------------|-------------------------------------|--------------------------|---------------|
| 3.28 | S6.9 | Is the grab operated in slow and controlled manner such that the impact to seabed by the grab when being lowered could be minimized? Is the operator ensured the grab be properly closed before lifting the grab? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.29 | S6.9 | Is the maximum allowed dredging rate at the seawater intake limited to 750 m ³ /day while the maximum allowed dredging rate at the submarine outfall is 3,500 m ³ /day? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.30 | S6.9 | Is dredged marine sediment disposed of in a gazetted marine disposal area in accordance with marine dumping permit conditions of the Dumping at Sea Ordinance (DASO)? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.31 | S6.9 | Are disposal vessels fitted with tight bottom seals in order to prevent leakage of material during transport? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.32 | S6.9 | Are barges filled to a level which ensures that material does not spill over during transport to the disposal site and that adequate freeboard is maintained to ensure that the decks are not washed by wave action? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.33 | S6.9 | Are excess materials cleaned from decks and exposed fittings before the vessel is moved from the dredging area after dredging? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.34 | S6.9 | Are the contractor(s) confirmed that the works cause no visible foam, oil, grease, litter or other objectionable matter to be present in the water within and adjacent to the dredging site? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.35 | S6.9 | When the dredged material has been unloaded at the disposal areas, is any material accumulated on the deck or other exposed parts of the vessel removed and placed in the hold or a hopper? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.36 | S6.9 | Is dredger maintained adequate clearance between vessels and the seabed at all states of the tide and reduce operations speed to ensure that excessive turbidity is not generated by turbulence from vessel movement or propeller wash? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.37 | S6.9 | Is the contractor shall regularly inspect the silt curtains and check that they are moored and marked to avoid danger to marine traffic? Is regular inspection on the integrity of the silt curtain carried out by the contractor and any damage to the silt curtain shall be repaired by the contractor promptly? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.38 | S6.9 | Are all vessels have a clean ballast system? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.39 | S6.9 | Are all vessels well maintained and inspected before use to limit any potential discharges to the marine environment? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.40 | S6.9 | Is any discharge of sewage/grey wastewater? Is wastewater from potentially contaminated area on working vessels should be minimized and collected? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 3.41 | S6.9 | Is any soil waste disposed overboard? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 4.00 | | Waste Management | | | | |
| 4.01 | S8.5 | Is a trip-ticket system implemented to monitor the disposal of C&D and solid wastes at public filling facilities and landfills? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 4.02 | S8.5 | Is a recording system implemented to record the amount of wastes generated, recycled and disposed of? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 4.03 | S8.5 | Is the Contractor registered as a chemical waste producer? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |

Contract no. 13/WSD/17 Design, Build and Operate First Stage of Tseung Kwan O Desalination Plant

| Item No. | EIA ref. | | N/A | Yes | No | Photo/Remarks |
|-------------|----------------|--|-------------------------------------|-------------------------------------|-------------------------------------|-------------------|
| 4.04 | S8.5 | Is chemical waste separated from other waste and collected by a licensed chemical waste collector? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 4.05 | S8.5 | Are trip tickets for chemical waste disposal available for inspection? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 4.06 | S8.5 | Is drip tray provided for chemical storage? | <input type="checkbox"/> | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <i>observed</i> |
| 4.07 | S8.5 | Are all containers for chemical waste properly labelled? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 4.08 | S8.5 | Is chemical waste storage area used solely for storage of chemical waste and properly labelled? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 4.09 | S8.5 | Are incompatible chemical wastes stored in different areas? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 4.10 | S8.5 | Is the chemical waste storage area enclosed on at least 3 sides and adequately ventilated? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 4.11 | S8.5 | Is an impermeable floor and bunding, of capacity to accommodate 110% of the volume of the largest container or of 20% by volume of the chemical waste stored in that area, whichever is the greatest, provide? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 4.12 | S8.5 | Are a routine cleaning and maintenance programme implemented for drainage systems, sump pits, and oil interceptors? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 4.13 | S8.5 | Are sufficient general refuse disposal/collection points provided on site? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 4.14 | S8.5 | Is general refuse disposed of properly and regularly? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <i>Reminder-1</i> |
| 4.15 | S8.5 | Are appropriate measures adopted to minimize windblown litter and dust during transportation of waste? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 4.16 | S8.5 | Are individual collectors for aluminum cans, plastic bottles and packaging material and office paper provided to encourage waste segregation? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 4.17 | S8.5 | Are C&D wastes sorted on site? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 4.18 | S8.5 | Are C&D waste disposed of properly? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 4.19 | S8.5 | Are unused C&D materials or chemicals recycled or reused to reduce the quantity of waste? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 4.20 | S8.5 | Are public fill and C&D waste reuse on site as far as practicable to avoid disposal off-site? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 4.21 | S8.5 | Are the construction materials stored properly to minimize the potential for damage or contamination? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 4.22 | S8.5 | Is a dumping license obtained to deliver public fill to public filling areas? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 5.00 | S11.10 | Landscape and Visual | | | | |
| 5.01 | & 11.11 | Are Is site hoarding provided? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 5.02 | S11.10 & 11.11 | Are vegetation disturbance minimized or soil protected to reduce potential soil erosion? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 5.03 | S11.10 & 11.11 | Is construction light oriented away from the sensitive receivers? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |

Contract no. 13/WSD/17 Design, Build and Operate First Stage of Tseung Kwan O Desalination Plant

| Item No. | EIA ref. | | N/A | Yes | No | Photo/Remarks |
|----------|----------------|--|-------------------------------------|-------------------------------------|--------------------------|-----------------|
| 5.04 | S11.10 & 11.11 | Is grass hydroseeding provided to slopes as soon as the completion of works? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 5.05 | S11.10 & 11.11 | Are damages to trees outside site boundary due construction works avoided? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 5.06 | S11.10 & 11.11 | Is excavation works carried out manually instead of machinery operation within 2.5m vicinity of any preserved trees? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 5.07 | S11.10 & 11.11 | Are the retained and transplanted tree(s) properly protected and in good conditions? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 5.08 | S11.10 & 11.11 | Are surgery works carried out for damaged trees? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 6.00 | S9.7 | Ecology | | | | |
| 6.01 | S9.7 | Is site runoff properly treated to prevent any silty runoff? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 6.02 | S9.7 | Are silt trap installed and well-maintained? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 6.03 | S9.7 | Are stockpiles properly covered to avoid generating silty runoff? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <i>Reminder</i> |
| 6.04 | S9.7 | Are construction works restricted to works area which are clearly defined? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 6.05 | S9.7 | For slope mitigation works within the Clear Water Bay Country Park, are tree felling and damages to trees, the exact locations of the flexible barrier foundation plates, soil nails and rock dowels adjusted during detailed design, and a setback distance from existing trees is recommended to be maintained as far as practical? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 6.06 | S9.7 | Are pruning of tree canopies along the alignment of the flexible barriers limited to a minimum? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 6.07 | S9.7 | Is the alignment of flexible barriers optimized to preserve all species of conservation interest and minimize the impact to the existing vegetation as far as practicable? Are the alignment of flexible barriers positioned at minimum 1.5 m in a radius away from these individuals? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 6.08 | S9.7 | Is temporary fencing installed to fence off the concerned species either in groups of individually within the works area and in the close proximity to prevent from being damaged and disturbed during construction? Is a sign identifying the site attached to the fence and flagging tape shall be attached to the individuals to visualize their locations? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 6.09 | S9.7 | Is a specification for fencing and demarcating individuals of Marsdenia lachnostoma (or other flora species of conservation interest, if found) adjacent to the proposed alignment of the flexible barriers prepared to protect the species? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 6.10 | S9.7 | Is any induction training provided to all site personnel in order to brief them on this flora of conservation interest including the locations and their importance? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 6.11 | S9.7 | Is the resident site supervisory staff closely monitor the conditions of concerned individuals during construction of flexible barriers in the close proximity? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 6.12 | S9.7 | Are fences erected along the boundary of the works area before the commencement of works to prevent vehicle movements and encroachment of personnel onto adjacent areas? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | |
| 6.13 | S9.7 | Is regular check of the work site boundaries performed to ensure that they are not breached and that damage does not occur to surrounding areas? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |
| 6.14 | S9.7 | Is any damage and disturbance avoided, particularly those caused by filling and illegal dumping, to the surrounding habitats through proper management of waste disposal? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | |

Contract no. 13/WSD/17 Design, Build and Operate First Stage of Tseung Kwan O Desalination Plant

| Item No. | EIA ref. | | N/A | Yes | No | Photo/Remarks |
|-------------|----------|---|-------------------------------------|-------------------------------------|--------------------------|---------------|
| 6.15 | S9.7 | Are temporarily affected areas reinstated, particularly the habitats of plantation and shrubland-grassland immediately after completion of construction works, through on-site tree/shrub planting? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 6.16 | S9.7 | Are affected habitats within the Clear Water Bay Country Bay reinstated by hydro-seeding and planting of climbers and native shrub seedlings where practical upon completion of the slope mitigation works? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 7.00 | | Landfill Gas Hazard | | | | |
| 7.01 | S12.7 | Are the safety procedures implemented to minimise the risks of fires and explosions, asphyxiation of works and toxicity effects during all works? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 7.02 | S12.7 | Are the gas detection equipment and precautions being used during trenching and excavation as well as creation of confined spaces? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 7.03 | S12.7 | Are the training with regard to the awareness of potential hazards of working in confined spaces provided from the Contractor to the workers? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 7.04 | S12.7 | Are the safety officers trained with regard to landfill gas and leachate related hazards and presented on the site throughout the works undertaken below grade? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 7.05 | S12.7 | Are the all personnel working on site and all visitor made aware of the possibility of ignition of gas, the possible presence of contaminated water and the need to avoid physical contact? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 7.06 | S12.7 | Is the monitoring of landfill gas being undertaken in all excavations, manholes, chambers and any confined spaces? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 7.07 | S12.7 | Are the monitoring frequency and areas being specified by the safety officers or appropriately qualified person? Are the all measurements being recorded and documented? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 7.08 | S12.7 | Is the drilling proceeded with adequate care and precautions against the potential hazards? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 7.09 | S12.7 | Is the method statement covering all normal and emergency procedures provided by the drilling contractor prior to the commencement of the site works? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 7.10 | S12.7 | Are the below ground services entries being sealed to prevent gas entry? Are the grilled metal covers being used for below grade cable trenches? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 7.11 | S12.7 | Is each manhole or utility pit monitored with two measurements (at mid-depth and base) for minimum of 10 minutes? Is the steady reading and peak reading recorded at each manhole or utility pit? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | _____ |
| 7.12 | S12.7 | Are the warning signs of the hazards of landfill gas and its possible presence on site posted in prominent places? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |
| 8.00 | | Overall | | | | |
| 8.01 | | Is the EM&A properly implemented in general? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | _____ |

Contract no. 13/WSD/17 Design, Build and Operate First Stage of Tseung Kwan O Desalination Plant

Remark / Follow up of Observation(s) and Non-compliance(s) of Last Weekly Site Inspection:

Observations

1.) The chemical containers found near the R.O. Building shall ~~provide a~~ ^{be stored on a} drip tray or provide proper storage to prevent leakage.

Reminders:

1.) ~~The garbage containers around the site shall be clean up more frequent.~~

The contractors are reminded to increase the frequency of garbage collection as we are observed a number of the containers were over stocked.

2.) The contractors are reminded to cover the stock pile (sand) near the Chemical Building to prevent dust spreading.

Signatures:

ET Representative

(Name: LEUNG MUN HO)

Contractor's Representative

(Name: Brian Kam)

Supervising Officer's Representative

(Name: Raymond Kow)

IEC's Representative

(Name: Alan Chan)

WSD's Representative

(Name: HO WING KONG)

Appendix J

Complaint Log

Statistical Summary of Environmental Complaints

| Reporting Period | Environmental Complaint Statistics | | |
|------------------|------------------------------------|------------|------------------|
| | Frequency | Cumulative | Complaint Nature |
| 1 – 31 July 2023 | 0 | 1 | N/A |

Statistical Summary of Environmental Summons

| Reporting Period | Environmental Summons Statistics | | |
|------------------|----------------------------------|------------|---------|
| | Frequency | Cumulative | Details |
| 1 – 31 July 2023 | 0 | 0 | N/A |

Statistical Summary of Environmental Prosecution

| Reporting Period | Environmental Prosecution Statistics | | |
|------------------|--------------------------------------|------------|---------|
| | Frequency | Cumulative | Details |
| 1 – 31 July 2023 | 0 | 0 | N/A |

Appendix K

Exceedance Report (s)

Bi-Weekly Incident Report on Action Level or Limit Level Non-Compliance

| Date of exceedance | Monitoring Station | Tide | Parameter | Measurement Result (mg/L) | Sampling depth | Depth Average Result (mg/L) | Action Level (mg/L) | | Limit Level (mg/L) | | Exceedance | Marine construction activities with contact with water (Y/N) | Exceedance related to Project (Y/N) | Reasons of non-project related exceedance | | | | | | | |
|--------------------|--------------------|-------|-----------------|---------------------------|----------------|-----------------------------|---------------------|--------------|--------------------|--------------|--------------|--|-------------------------------------|---|-----|-----|-----|-----|-----|-----|-----|
| | | | | | | | 95%-ile | Control 120% | 99%-ile | Control 130% | | | | (1) | (2) | (3) | (4) | (5) | (6) | (7) | (8) |
| 18/07/2023 | WSR16 | Ebb | Suspended Solid | -- | -- | 5.67 | 5.00 | 8.60 | 6.00 | 9.32 | Action Level | N | N | ✓ | ✓ | ✓ | ✓ | | ✓ | ✓ | |
| | WSR36 | | | -- | -- | 5.83 | | | | | Limit Level | N | N | | ✓ | ✓ | ✓ | | ✓ | ✓ | |
| | WSR37 | | | -- | -- | 6.83 | | | | | Limit Level | N | N | | ✓ | ✓ | ✓ | | ✓ | ✓ | |
| | WSR1 | Flood | Suspended Solid | -- | -- | 7.50 | 5.00 | 6.60 | 6.00 | 7.15 | Limit Level | N | N | ✓ | ✓ | ✓ | ✓ | | ✓ | ✓ | |
| | WSR2 | | | -- | -- | 7.67 | | | | | Limit Level | N | N | ✓ | ✓ | ✓ | ✓ | | ✓ | ✓ | |
| | WSR3 | | | -- | -- | 6.50 | | | | | Limit Level | N | N | ✓ | ✓ | ✓ | ✓ | | ✓ | ✓ | |
| | WSR4 | | | -- | -- | 6.83 | | | | | Limit Level | N | N | ✓ | ✓ | ✓ | ✓ | | ✓ | ✓ | |
| | WSR16 | | | -- | -- | 7.33 | | | | | Limit Level | N | N | ✓ | ✓ | ✓ | ✓ | | ✓ | ✓ | |
| | WSR33 | | | -- | -- | 7.17 | | | | | Limit Level | N | N | | ✓ | ✓ | ✓ | | ✓ | ✓ | |
| | WSR36 | | | -- | -- | 8.17 | | | | | Limit Level | N | N | | ✓ | ✓ | ✓ | | ✓ | ✓ | |
| | WSR37 | | | -- | -- | 8.33 | | | | | Limit Level | N | N | | ✓ | ✓ | ✓ | | ✓ | ✓ | |

- 1) WSR1, WSR2, WSR3, WSR4, WSR16 were located distant from the construction site and possibility of being affected by marine construction activity was considered limited.
- 2) Control station value already exceed either the Action or Limit Level.
- 3) No algal bloom, silt plume or pollution discharge from site area was observed.
- 4) Rainfall was recorded at Tseung Kwan O during the monitoring period, rainfall may lead to release of SS content form the soil of the nearby lands (e.g., Country Park, fill bank).
- 5) No action and limit level exceedance observed at WSR37 (Outfall Shaft).
- 6) No marine construction activity was conducted at WSR36 (Intake Shaft).
- 7) No marine construction activity was conducted at WSR37 (Outfall Shaft).
- 8) Water quality mitigation measures were observed maintained / implemented properly (double silt curtain).

Conclusion:

During water quality monitoring on 18 July 2023, two (2) Action Level exceedances and one (1) Limit Level exceedance were recorded during mid-ebb tide, and eight (8) Limit Level exceedances of Suspended Solids were recorded during mid-flood tide. After investigation, all exceedances were considered non-project related.

Total eleven (11) Action Level and nine (9) Limit Level exceedances for Suspended Solid of impact water quality monitoring were recorded between 18 July to 29 July 2023. After investigation, all exceedances were considered non-project related.

No action or limit level exceedance for turbidity was recorded during the in-situ water quality monitoring between 18 July to 29 July 2023.

Supporting Photo:

| Date of exceedance | Monitoring station(s) | | | |
|--------------------|-----------------------|-------|-------|------|
| 18/07/2023 | | | | |
| | WSR1 | WSR2 | WSR3 | WSR4 |
| | | | | |
| WSR16 | WSR33 | WSR36 | WSR37 | |

Rainfall Record from Hong Kong Observatory:

